

IO-Link Profile Smart Sensors 2nd Edition

Specification

**Version 1.1
September 2021**

Order No: 10.042

File name: **IOL-Smart-Sensor-Profile-2ndEd_V1.1_Sep2021.docx**

This profile specification has been prepared by the IO-Link Smart Sensor profile group.

Any comments, proposals, requests on this document are appreciated. Please use www.io-link-projects.com for your entries and provide name and email address.

Login: *IOL-SM-Profile*

Password: *Report*

Important notes:

NOTE 1 The IO-Link Community Rules shall be observed prior to the development and marketing of IO-Link products. The document can be downloaded from the www.io-link.com portal.

NOTE 2 Any IO-Link device shall provide an associated IODD file. Easy access to the file and potential updates shall be possible. It is the responsibility of the IO-Link device manufacturer to test the IODD file with the help of the IODD-Checker tool available per download from www.io-link.com.

NOTE 3 Any IO-Link devices shall provide an associated manufacturer declaration on the conformity of the device with this specification, its related IODD, and test documents, available per download from www.io-link.com.


Disclaimer:

The attention of adopters is directed to the possibility that compliance with or adoption of IO-Link Community specifications may require use of an invention covered by patent rights. The IO-Link Community shall not be responsible for identifying patents for which a license may be required by any IO-Link Community specification, or for conducting legal inquiries into the legal validity or scope of those patents that are brought to its attention. IO-Link Community specifications are prospective and advisory only. Prospective users are responsible for protecting themselves against liability for infringement of patents.

The information contained in this document is subject to change without notice. The material in this document details an IO-Link Community specification in accordance with the license and notices set forth on this page. This document does not represent a commitment to implement any portion of this specification in any company's products.

WHILE THE INFORMATION IN THIS PUBLICATION IS BELIEVED TO BE ACCURATE, THE IO-LINK COMMUNITY MAKES NO WARRANTY OF ANY KIND, EXPRESS OR IMPLIED, WITH REGARD TO THIS MATERIAL INCLUDING, BUT NOT LIMITED TO ANY WARRANTY OF TITLE OR OWNERSHIP, IMPLIED WARRANTY OF MERCHANTABILITY OR WARRANTY OF FITNESS FOR PARTICULAR PURPOSE OR USE.

In no event shall the IO-Link Community be liable for errors contained herein or for indirect, incidental, special, consequential, reliance or cover damages, including loss of profits, revenue, data or use, incurred by any user or any third party. Compliance with this specification does not absolve manufacturers of IO-Link equipment, from the requirements of safety and regulatory agencies (TÜV, BIA, UL, CSA, etc.).

 **IO-Link**® is registered trade mark. The use is restricted for members of the IO-Link Community. More detailed terms for the use can be found in the IO-Link Community Rules on www.io-link.com.

Conventions:

In this specification the following key words (in **bold** text) will be used:

shall:	indicates a mandatory requirement. Designers shall implement such mandatory requirements to ensure interoperability and to claim conformity with this specification.
should:	indicates flexibility of choice with a strongly preferred implementation.
can:	indicates flexibility of choice with no implied preference (possibility and capability).
may:	indicates a permission.
highly recommended:	indicates that a feature shall be implemented except for well-founded cases. Vendor shall document the deviation within the user manual and within the manufacturer declaration.

Publisher:

IO-Link Community

Haid-und-Neu-Str. 7

76131 Karlsruhe

Germany

Phone: +49 721 / 98 61 97 0

Fax: +49 721 / 98 61 97 11

E-mail: info@io-link.com

Web site: www.io-link.com

© No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

CONTENTS

0	Introduction	12
0.1	General.....	12
0.2	Patent declaration	12
1	Scope	13
2	Normative references	13
3	Terms, definitions, symbols, abbreviated terms and conventions	13
3.1	Common terms and definitions	13
3.2	Smart sensor profile: Additional terms and definitions	14
3.3	Symbols and abbreviated terms	16
3.4	Conventions.....	17
3.4.1	Behavioral descriptions.....	17
3.4.2	Memory and transmission octet order	18
4	Overview of sensor devices	18
4.1	Smart Sensors	18
4.2	Sensors migrating to SDCI.....	18
4.3	Smart Sensor profile structure	19
5	Smart Sensor profile.....	19
5.1	Objectives for the Smart Sensor profile	19
5.2	Measurement categories for Smart Sensors	20
5.3	Smart Sensor object model	20
5.4	Abstract sensor model	21
6	Fixed switching sensors (FSS).....	22
6.1	Overview	22
6.2	Mapping to SDCI communication	23
6.3	Extension of SSP 1	23
7	Adjustable switching sensors (AdSS).....	23
7.1	Overview	23
7.2	Mapping to SDCI communication	24
7.3	Extension of SSP 2.1 to SSP 2.3	24
7.4	Extension of SSP 2.7	25
7.5	Possible combinations of switching sensor profile characteristics	25
7.6	Proxy Function Block (FB) for Adjustable Switching Sensors	25
8	Digital measuring sensors (DMS).....	26
8.1	Overview	26
8.2	Extension of SSP 3	27
8.3	Proxy function call for measuring sensors	27
9	Digital Measuring and Switching Sensors (DMSS)	28
9.1	Overview	28
9.2	Associated SDCI communication for SSP 4.....	29
9.3	Extension of SSP 4	30
9.4	Proxy function call for Digital Measuring and Switching Sensors	30

Annex A (normative) General switching and teach approaches	31
A.1 Overview	31
A.2 Switching behavior.....	31
A.2.1 Overview on switchpoint modes	31
A.2.2 Switchpoint logic.....	31
A.2.3 Single Point Mode	31
A.2.4 Window Mode	32
A.2.5 Two Point Mode (without hysteresis)	32
A.2.6 Deactivated	33
A.3 Teach behavior	33
A.3.1 Concepts for Smart Sensors	33
Annex B (normative) FunctionClasses.....	36
B.1 Overview	36
B.1.1 Basic parameter rules	36
B.2 Fixed Switching Signal Channel – [0x8005].....	37
B.2.1 General	37
B.2.2 Switching signal behavior	37
B.3 Adjustable Switching Signal Channel – [0x8006].....	37
B.3.1 General	37
B.3.2 Switching signal behavior	37
B.3.3 Multiple physical sensing elements	37
B.3.4 Function Block Proxy	37
B.4 Multiple Adjustable Switching Signal Channel – [0x800D]	37
B.4.1 General	37
B.4.2 Configuration and parameterization of the SSC	37
B.4.3 Switchpoint Logic	37
B.4.4 Switchpoint Hysteresis.....	38
B.4.5 Switchpoint Modes.....	38
B.4.6 Setpoint parameters (SP1, SP2)	38
B.4.7 Multiple physical sensing elements	38
B.4.8 Function Block Proxy	38
B.5 Teach FunctionClasses – [0x8007] to [0x8009] and [0x8010] to [0x8012]	38
B.5.1 Overview	38
B.5.2 Restrictions and differences between the Teach FunctionClasses	38
B.5.3 Parameter TeachResult	39
B.5.4 Teach behavior of the Teach FunctionClasses	39
B.5.5 Proxy Function Block	43
B.6 Measurement Data Channel – [0x800A, 0x800B, 0x800E].....	43
B.6.1 General	43
B.6.2 Value range definitions	43
B.6.3 Substitute values	44
B.6.4 Process Data value scale [0x800A, 0x800B]	45
B.6.5 Validity rule definitions	45
B.6.6 Example	46
B.6.7 Units.....	46
B.6.8 Multiple physical sensing elements	47
B.6.9 Proxy Function Block	47
B.7 Sensor Control, Sensor Control Wide – [0x800C, 0x800F]	47

B.7.1	General	47
B.7.2	Validity considerations	48
B.7.3	Multiple physical sensing elements	48
B.8	Switching schemes – [0x8013, 0x8014]	48
B.8.1	Overview	48
B.8.2	Object detection	49
B.8.3	Quantity detection	50
Annex C (normative)	Process Data (PD) structures	52
C.1	Overview	52
C.2	PDI8.BOOL1	52
C.3	PDI8.BOOL2	53
C.4	MDC specific process data records	53
C.4.1	PDI32.INT16_INT8	53
C.4.2	PDI48.INT32_INT8	54
C.5	CSC specific process data records	55
C.5.1	PDO8.BOOL1	55
C.5.2	PDO8.BOOL2	56
C.5.3	PDO8.BOOL3	56
C.5.4	PDO8.BOOL4	57
C.5.5	PDO16.BOOL1	58
C.5.6	PDO16.BOOL2	58
C.5.7	PDO16.BOOL3	59
C.5.8	PDO16.BOOL4	60
C.6	MSDC specific process data records	60
C.6.1	MSDC32 general layout	60
C.6.2	MSDC48 general layout	64
C.6.3	MSDC Float general layout	67
Annex D (normative)	Device parameters of the Smart Sensor Profile	71
D.1	Overview	71
D.2	Device parameters of the Smart Sensor Profile	71
D.3	Definition of profile specific SystemCommands	72
D.3.1	Overview	72
D.3.2	SystemCommand	72
D.4	Single channel SSC parameter	73
D.4.1	Overview	73
D.4.2	SSCConfig	73
D.4.3	SSCParam	73
D.4.4	TeachResult – single point mode	73
D.5	Multiple channel SSC parameter	74
D.5.1	Overview	74
D.5.2	TeachSelect	74
D.5.3	TeachResult – multiple switchpoint modes	75
D.5.4	SSCxParam – multiple switchpoint modes and channels	76
D.5.5	SSCxConfig – multiple switchpoint modes and channels	77
D.6	Additional Device parameters for digital measuring sensors	78
D.6.1	MDCxDescr	78
Annex E (normative)	Function Block definitions	79
E.1	Overview	79

E.2	Proxy Function Block for Adjustable Switching Sensors	79
E.3	Proxy Function Block for multi channel Adjustable Switching Sensors	86
E.4	Proxy Function Block for Measurement Data Channel (MDC)	95
Annex F	(normative) IODD definitions and rules	98
F.1	Overview	98
F.2	Constraints and rules	98
F.3	Name definitions	98
F.3.1	Profile type characteristic names	98
F.3.2	Parameter set for Fixed or Adjustable Switching Signal profile	98
F.3.3	Parameter set for Adjustable Switching Signal profile	98
F.3.4	Parameter set for MAdSS & DMSS & MSDC	100
F.3.5	Parameter set for Digital Measuring Sensor profile	102
F.4	IODD Menu definitions	102
F.4.1	Overview	102
F.4.2	Common rules for building profile menu entries	102
F.4.3	Menu structure of the Fixed Switching Signal Channel	103
F.4.4	Menu structure of an Adjustable Switching Signal Channel	103
F.4.5	Menu structure of Teach single value	104
F.4.6	Menu structure Teach two value	104
F.4.7	Menu structure Teach dynamic	104
F.4.8	Menu structure Multiple adjustable Switching Signal Channel	105
F.4.9	Menu structure of Multi channel Teach single value	105
F.4.10	Menu structure Multi channel Teach two value	105
F.4.11	Menu structure Multi channel Teach dynamic	106
F.4.12	Menu structure of a Digital Measuring Sensor	106
Annex G	(normative) Profile testing and conformity	108
G.1	General	108
G.1.1	Overview	108
G.1.2	Test extension for profile Devices	108
G.2	IODD test	108
G.2.1	Extended business rule set for Smart Sensor Profiles	108
G.3	Specific unit test	109
G.3.1	FSS hidden FunctionClasses	109
G.3.2	AdSS hidden FunctionClasses	110
G.3.3	DMS hidden FunctionClasses	111
G.3.4	DMSS hidden FunctionClasses	112
G.3.5	FSS / AdSS config parameter validation	113
G.3.6	MAdSS Config parameter validation	114
G.3.7	AdSS Teach compliance	115
G.3.8	MAdSS Teach compliance	116
G.3.9	MAdSS Teach channel selection	117
G.3.10	Sensor Control reactivity on MDC	118
G.3.11	MDC Scale consistency	119
G.3.12	MDC Measurement range correctness	120
Annex H	(informative) Information on conformity testing of profile Devices	121
Bibliography	122

Figure 2 – Memory and transmission octet order	18
Figure 3 – Abstract sensor model switching sensor	21
Figure 4 – Abstract sensor model measuring sensor	22
Figure A.1 – Example of a Single Point Mode for object detection	32
Figure A.2 – Example of a Single Point Mode for quantity detection	32
Figure A.3 – Example for the Window Mode	32
Figure A.4 – Example for the Two Point Mode of object detection	33
Figure A.5 – Example for the Two Point Mode of quantity detection	33
Figure A.6 – Single value teach (Single Point Mode)	34
Figure A.7 – Single value teach (Window Mode)	34
Figure A.8 – Two values teach (Single Point Mode)	34
Figure A.9 – Two values teach (Two Point Mode)	34
Figure A.10 – Dynamic teach (Single Point Mode)	35
Figure A.11 – Dynamic teach (Window Mode)	35
Figure B.1– Common state machine for all three teach subsets	41
Figure B.2 – Basic Process Data ranges and limits	43
Figure B.3 – Definition of ranges for the process data	44
Figure B.4 – Example of a distance measurement Device	46
Figure B.5 – Object detection in Single Point Mode	49
Figure B.6 – Object detection in Window Mode	49
Figure B.7 – Object detection in Two Point Mode	50
Figure B.8 – Quantity detection in Single Point Mode	50
Figure B.9 – Quantity detection in Window Mode	50
Figure B.10 – Quantity detection in Two Point Mode	51
Figure C.1 – 8 bit Process Data input structure with SSC	52
Figure C.2 – 8 bit Process Data input structure with dual SSC	53
Figure C.3 – 32 bit Process Data input structure	53
Figure C.4 – 48 bit Process Data input structure	54
Figure C.5 – 8 bit Process Data output structure with CSC	55
Figure C.6 – 8 bit Process Data output structure with dual CSC	56
Figure C.7 – 8 bit Process Data output structure with triple CSC	56
Figure C.8 – 8 bit Process Data output structure with quad CSC	57
Figure C.9 – 16 bit Process Data output structure with CSC	58
Figure C.10 – 16 bit Process Data output structure with dual CSC	58
Figure C.11 – 16 bit Process Data output structure with triple CSC	59
Figure C.12 – 16 bit Process Data output structure with quad CSC	60
Figure C.13 – 32 bit process data MSDC32	61
Figure C.14 – 32 bit Process Data structure with single MSDC32	61
Figure C.15 – 64 bit Process Data input structure with dual MSDC32	62
Figure C.16 – 96 bit Process Data input structure with triple MSDC32	63
Figure C.17 – 128 bit Process Data input structure with quad MSDC32	63
Figure C.18 – 48 bit process data MSDC48	64
Figure C.19 – 48 bit Process Data input structure with single MSDC48	65

Figure C.20 – 96 bit Process Data input structure with dual MSDC48	65
Figure C.21 – 144 bit Process Data input structure with triple MSDC48	66
Figure C.22 – 192 bit Process Data input structure with quad MSDC48	67
Figure C.23 – 48 bit Process Data input structure with single MSDCF	67
Figure C.24 – 80 bit Process Data input structure with double MSDCF	68
Figure C.25 – 112 bit Process Data input structure with triple MSDCF	69
Figure C.26 – 144 bit Process Data input structure with quad MSDCF	70
Figure D.1 – Structure of TeachFlags and TeachState	73
Figure D.2 – Structure of TeachFlags and TeachState	75
Figure E.1 – Proxy FB for AdSS	79
Figure E.2 – State machine of the AdSS proxy FB	84
Figure E.3 – Proxy FB for multi channel AdSS	87
Figure E.4 – State machine of the multi channel AdSS proxy FB	91
Figure E.5 – Function Block for Measurement Data Channel	95
Figure E.6 – Determination of measurement value or substitute values	96
Figure F.1 – IODD object layout description	103
Figure F.2 – Menu FSS	103
Figure F.3 – Menu AdSS	104
Figure F.4 – Menu Teach single value	104
Figure F.5 – Menu Teach two value	104
Figure F.6 – Menu teach dynamic	105
Figure F.7 – Menu Multiple Adjustable Switching Signal	105
Figure F.8 – Menu Teach single value	105
Figure F.9 – Menu Teach two value	106
Figure F.10 – Menu teach dynamic	106
Figure F.11 – Menu DMS	107
Table 1 – Typical physical and chemical measurement quantities	20
Table 2 – Prefixes for IODD ID elements	20
Table 3 – Smart Sensor Profile types	20
Table 4 – Switching sensor profile types 1	22
Table 5 – Associated SDCI artifacts for SSP 1	23
Table 6 – Extensions for SSP 1	23
Table 7 – Switching sensor profile types 2	24
Table 8 – Associated SDCI artifacts for SSP 2	24
Table 9 – Extensions for SSP 2.1 to SSP 2.3	24
Table 10 – Extensions for SSP 2.7	25
Table 11 – Possible switching sensor profile combinations	25
Table 12 – Measuring Device profile types 3	26
Table 13 – Associated SDCI artifacts for SSP 3	26
Table 14 – Extensions for SSP 3.1 to SSP 3.2	27
Table 15 – Measuring Device profile types 4	28

Table 16 – Associated SDCI artifacts for SSP 4	29
Table 17 – Extensions for SSP 4	30
Table A.1 – Conversion table from switching state to SSC value	31
Table B.1 – Overview of FunctionClasses	36
Table B.2 – Supported functionalities by FunctionClasses [0x8007] to [0x8009]	39
Table B.3 – Supported functionalities by FunctionClasses [0x8010] to [0x8012]	39
Table B.4 – ISDU response constraints on teach parameter	40
Table B.5 – State transition tables for all three teach subsets	41
Table B.6 – Basic Process Data definitions	43
Table B.7 – Range definitions	44
Table B.8 – Permissible values for the detection range	44
Table B.9 – Fixed special values (substitutes)	45
Table B.10 – Physical units and preferred data types	46
Table B.11 – Conversion table from control signal to disable state	48
Table B.12 – Assignment of SP1 and SP2	49
Table B.13 – Assignment of SP1 and SP2	50
Table B.14 – Assignment of SP1 and SP2	51
Table B.15 – Assignment of SP1 and SP2	51
Table C.1 – Coding of Process Data input (PDI8.BOOL1)	52
Table C.2 – PVinD for PDI8.BOOL1 process data	52
Table C.3 – Coding of Process Data input (PDI8.BOOL2)	53
Table C.4 – PVinD for PDI8.BOOL2 process data	53
Table C.5 – Coding of Process Data input (PDI32.INT16_INT8)	54
Table C.6 – DataType coding of MSDC32 process data structures	54
Table C.7 – PVinD for PDI32.INT16_INT8 process data	54
Table C.8 – Coding of Process Data input (PDI48.INT32_INT8)	54
Table C.9 – DataType coding of MSDC32 process data structures	55
Table C.10 – PVinD for PDI48.INT32_INT8 process data	55
Table C.11 – Coding of Process Data output (PDO8.BOOL1)	55
Table C.12 – PVoutD for PDO8.BOOL1 process data	55
Table C.13 – Coding of Process Data output (PDO8.BOOL2)	56
Table C.14 – PVoutD for PDO8.BOOL2 process data	56
Table C.15 – Coding of Process Data output (PDO8.BOOL3)	57
Table C.16 – PVoutD for PDO8.BOOL3 process data	57
Table C.17 – Coding of Process Data output (PDO8.BOOL4)	57
Table C.18 – PVoutD for PDO8.BOOL4 process data	58
Table C.19 – Coding of Process Data output (PDO16.BOOL1)	58
Table C.20 – PVoutD for PDO16.BOOL1 process data	58
Table C.21 – Coding of Process Data output (PDO16.BOOL2)	59
Table C.22 – PVoutD for PDO16.BOOL2 process data	59
Table C.23 – Coding of Process Data output (PDO16.BOOL3)	59
Table C.24 – PVoutD for PDO16.BOOL3 process data	59
Table C.25 – Coding of Process Data output (PDO16.BOOL4)	60

Table C.26 – PVoutD for PDO16.BOOL4 process data	60
Table C.27 – Coding of Process Data input (MSDC32)	61
Table C.28 – DataType coding of MSDC32 process data structures	61
Table C.29 – Coding of Process Data input (PDI32.MSDC32_1)	62
Table C.30 – PVinD for PDI32.MSDC32_1 process data	62
Table C.31 – Coding of Process Data input (PDI32.MSDC32_2)	62
Table C.32 – PVinD for PDI32.MSDC32_2 process data	62
Table C.33 – Coding of Process Data input (PDI96.MSDC32_3)	63
Table C.34 – PVinD for PDI96.MSDC32_3 process data	63
Table C.35 – Coding of Process Data input (PDI128.MSDC32_4)	63
Table C.36 – PVinD for PDI128.MSDC32_4 process data	64
Table C.37 – Coding of Process Data input (MSDC48)	64
Table C.38 – DataType coding of MSDC process data structures	64
Table C.39 – Coding of Process Data input (PDI48.MSDC48_1)	65
Table C.40 – PVinD for PDI48.MSDC48_1 process data	65
Table C.41 – Coding of Process Data input (PDI96.MSDC48_2)	65
Table C.42 – PVinD for PDI96.MSDC48_2 process data	66
Table C.43 – Coding of Process Data input (PDI144.MSDC48_3)	66
Table C.44 – PVinD for PDI144.MSDC48_3 process data	66
Table C.45 – Coding of Process Data input (PDI192.MSDC48_4)	67
Table C.46 – PVinD for PDI192.MSDC48_4 process data	67
Table C.47 – Coding of Process Data input (PDI48.MSDCF_1)	68
Table C.48 – PVinD for PDI48.MSDCF_1 process data	68
Table C.49 – Coding of Process Data input (PDI80.MSDCF_2)	68
Table C.50 – PVinD for PDI80.MSDCF_2 process data	69
Table C.51 – Coding of Process Data input (PDI112.MSDCF_3)	69
Table C.52 – PVinD for PDI112.MSDCF_3 process data	69
Table C.53 – Coding of Process Data input (PDI144.MSDCF_4)	70
Table C.54 – PVinD for PDI144.MSDCF_4 process data	70
Table D.1 – Smart Sensor Profile parameters	71
Table D.2 – Command parameter for teach	72
Table D.3 – Teach command coding	72
Table D.4 – Configuration parameter	73
Table D.5 – Setpoint parameter	73
Table D.6 – Result parameter for teach	74
Table D.7 – TeachState coding	74
Table D.8 – Selection for teach channel	74
Table D.9 – TeachSelect coding	75
Table D.10 – Result parameter for teach	75
Table D.11 – TeachState coding	76
Table D.12 – Setpoint parameter	76
Table D.13 – Configuration parameter	77
Table D.14 – MDCxDescr parameter	78

Table E.1 – Variables of the AdSS proxy FB	81
Table E.2 – Extension of FB Status.....	83
Table E.3 – State and transition table for AdSS proxy FB	84
Table E.4 – Variables of the multi channel AdSS proxy FB.....	88
Table E.5 – Elements of the STRUCT C.....	90
Table E.6 – Elements of the STRUCT P	90
Table E.7 – Extension of FB Status.....	90
Table E.8 – State and transition table for AdSS proxy FB	91
Table E.9 – Parameter assigned to TeachChannel.....	93
Table E.10 – SystemCommand assigned to TeachFunction	94
Table E.11 – Variables of the Measurement Data Channel Function Block	95
Table E.12 – State and transition table for Measurement Data FB	97
Table F.1 – SSCConfig.Logic predefinitions	98
Table F.2 – SSCParam.SP predefinitions.....	98
Table F.3 – TeachResult predefinitions	100
Table F.4 – Teach command predefinition	100
Table F.5 – SSCConfig predefinitions	100
Table F.6 – SSCParam predefinition	101
Table F.7 – TeachSelect predefinition.....	101
Table F.8 – Teach command predefinition	101
Table F.9 – TeachResult predefinition.....	102
Table F.10 – MDC descriptor predefinition	102
Table G.1 – FSS-hidden FunctionClasses.....	109
Table G.2 – AdSS-hidden FunctionClasses.....	110
Table G.3 – DMS-hidden FunctionClasses.....	111
Table G.4 – DMSS-hidden FunctionClasses.....	112
Table G.5 – FSS/AdSS-SSCConfig validation	113
Table G.6 – MAdSS-SSCConfig validation	114
Table G.7 – AdSS Teach compliant to FunctionBlock.....	115
Table G.8 – MAdSS Teach compliant to FunctionBlock	116
Table G.9 – MAdSS Teach channel selection.....	117
Table G.10 – Sensor Control reactivity.....	118
Table G.11 – MDC Scale consistency	119
Table G.12 – MDC Measurement range correctness	120

0 Introduction

0.1 General

The Single-drop Digital Communication Interface (SDCI) and system technology (IO-Link™¹) for sensors and actuators is standardized within IEC 61131-9 [1]. The technology is an answer to the need of these digital/analog sensors and actuators to exchange process data, diagnosis information and parameters with a controller (PC or PLC) using a low-cost, digital communication technology while maintaining backward compatibility with the current DI/DO signals as defined in IEC 61131-2.

Any SDCI compliant Device can be attached to any available interface port of an SDCI Master. SDCI compliant devices perform physical to digital conversion in the device, and then communicate the result directly in a standard 24 V I/O digital format, thus removing the need for different DI, DO, AI, AO modules and a variety of cables.

Physical topology is point-to-point from each Device to the Master using 3 wires over distances up to 20 m. The SDCI physical interface is backward compatible with the usual 24 V I/O signaling specified in IEC 61131-2. Transmission rates of 4,8 kbit/s, 38,4 kbit/s and 230,4 kbit/s are supported.

Tools allow the association of Devices with their corresponding electronic I/O device descriptions (IODD) and their subsequent configuration to match the application requirements [2].

This document describes more specific parts for so-called Smart Sensors.

This document follows the IEC 62390 [3] to a certain extent.

Terms of general use are defined in IEC 61131-1 or in [4]. Specific SDCI terms are defined in this part.

0.2 Patent declaration

There are no known patents related to the content of this document.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. The IO-Link Community shall not be held responsible for identifying any or all such patent rights.

¹ IO-Link™ is a trade name of the "IO-Link Community". This information is given for the convenience of users of this specification. Compliance to this specification does not require use of the registered logos for IO-Link™. Use of the registered logos for IO-Link™ requires permission of the "IO-Link Community".

PROGRAMMABLE CONTROLLERS —

Profile for Smart Sensor Devices according IEC 61131-9 (Single-drop Digital Communication Interface – SDCI)

1 Scope

The single-drop digital communication interface (SDCI) technology described in part 9 of the IEC 61131 series focuses on simple sensors and actuators in factory automation, which are nowadays using small and cost-effective microcontrollers. With the help of the SDCI technology, the existing limitations of traditional signal connection technologies such as switching 0/24 V, analog 0 to 10 V, etc. can be turned into a smooth migration. Classic sensors and actuators are usually connected to a fieldbus system via input/output modules in so-called remote I/O peripherals. The (SDCI) Master function enables these peripherals to map SDCI Devices onto a fieldbus system or build up direct gateways. Thus, parameter data can be transferred from the PLC level down to the sensor/actuator level and diagnosis data transferred back in turn by means of the SDCI communication. This is a contribution to consistent parameter storage and maintenance support within a distributed automation system. SDCI is compatible to classic signal switching technology according to part 2 of the IEC 61131 series.

This document defines the model of a so-called Smart Sensor. This model comprises process data structures, binary switching Setpoints and hysteresis, best practice handling of quantity measurements with or without associated units and teaching commonalities.

Base requirements for IO-Link Profiles Devices are defined in the IO-Link Common Profile [7].

This document contains statements on conformity testing for Smart Sensor Devices including specific IODD features.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61131-3, *Programmable controllers – Part 2: Programming languages*

IEC 61131-9, *Programmable controllers – Part 9: Single-drop digital communication interface for small sensors and actuators (SDCI)*

3 Terms, definitions, symbols, abbreviated terms and conventions

3.1 Common terms and definitions

For the purposes of this document, the following terms and definitions in addition to those given in IEC 61131-1, IEC 61131-2, and IEC 61131-9 apply.

3.1.1

Function Block

FB

contains the inputs, outputs, processes, requirements, and constraints of a given function used in PLC systems

[SOURCE: [1],[7]]

3.1.2

Programmable Logic Controller

PLC

Microcomputer embedded in or attached to a device to perform switching, timing, or machine or process control tasks

[SOURCE: IEC 61131-3, [7]]

3.1.3

unit code

attribute with standardized codes for physical units

[SOURCE: [2]]

3.2 Smart sensor profile: Additional terms and definitions

3.2.1

active

a target is detected or a threshold level has been exceeded

3.2.2

Control Signal Channel

CSC

Binary process data content which controls the behavior of the IO-Link Device

3.2.3

dynamic teach start

teach command to start continuous capturing of teach values

3.2.4

detection value

DV

strictly monotonic, uncalibrated representation of a *technological value* without physical unit

Note to entry: in case of proximity or distance sensors, the detection value represents the distance of a target toward the sensor

3.2.5

dynamic teach stop

teach command to terminate a dynamic teach and to evaluate the teach values

3.2.6

FunctionClass

FC

particular function within a Device profile identified by a 16 bit code within the range of 0x8000 to 0xBFFF

Note 1 to entry: A profile Device can use one or several FunctionClasses one or several times.

3.2.7

inactive

no target is detected or a threshold level has not been exceeded

3.2.8

measurement value

MV

strictly monotonic, calibrated representation of a *technological value* with physical unit

3.2.9

Measuring Data Channel

MDC

FunctionClass for measurement values with a fixed set of attributes defining the measurement and exact description of the values within the Process Data

3.2.10

measuring sensor

Device comprising a sensing element for continuously capturing physical quantities and a communication unit for the transmission of corresponding digital values

3.2.11**not applicable**

n/a

this entry cannot be applied within this context

3.2.12**Scale**

exponent (n) of a multiplier (with a base of 10) for measurement values

EXAMPLE The multiplier for a scale of 3 is 10^3 **3.2.13****Setpoint**

SP

measurement or detection value defining one *Switchpoint* within a *Switching Signal Channel***3.2.14****single point mode**evaluation method with one single *Setpoint* where the binary output signal changes whenever the *Switchpoint* is passed**3.2.15****single value teach**teach procedure capturing the *Teachpoint* to determinate the *Setpoint***3.2.16****switching sensors***Devices* measuring physical quantities or detecting presence of an object and providing switching signals with ON/OFF states depending on one or two *Setpoint* values**3.2.17****Switching Signal Channel**

SSC

Binary process data content which signals a specific state of an evaluation signal

3.2.18**Switchpoint**

measurement or detection value of a sensor where the switching signal changes its value

3.2.19**Switchpoint Hysteresis**attribute of the configuration defining the difference between active and inactive transitions of the *Switchpoints* for a *Switching Signal Channel***3.2.20****Switchpoint Logic**attribute of the configuration defining the activity state of the *switching signal* for a *Switching Signal Channel***3.2.21****Switchpoint Mode**

attribute of the configuration of a switching signal based on a measurement that can be only one out of a set of possible operational modes for binary signals such as "Deactivated", "Single Point", "Window", or "Two Point "

Note 1 to entry: Vendor specific modes are possible

3.2.22**Teach apply**teach command, applied only in context with two value teach, to trigger the evaluation of two *Teachpoints* and to calculate a derived *Setpoint*

- 171 **3.2.23**
172 **teach cancel**
173 teach command to cancel the current teach procedure without calculation of the *Setpoints* and
174 to restore previous values
- 175 **3.2.24**
176 **TeachFlag**
177 indication for the successful determination of a *Teachpoint*
- 178 **3.2.25**
179 **teach**
180 procedure within a Device to determine *Teachpoints* and to derive *Setpoint* values for a partic-
181 ular switching function
- 182 **3.2.26**
183 **TeachSelect**
184 parameter selecting a *Switching Signal Channel* for the application of *Teach commands*
- 185 **3.2.27**
186 **Teach command**
187 systemcommand to trigger or control a technology specific teach procedure
- 188 **3.2.28**
189 **TeachResult**
190 parameter providing the indications for *TeachFlags* and *TeachState*
- 191 **3.2.29**
192 **Teachpoint**
193 TPn
194 value determined during a *teach* procedure and serving as input for a *Setpoint* calculation
- 195 **3.2.30**
196 **TeachState**
197 indication of the current state of the *teach* procedure
- 198 **3.2.31**
199 **technological value**
200 via transducer captured value representing the physical measurement
- 201 **3.2.32**
202 **two point mode**
203 evaluation method defined by two *Setpoints* where the *switching signal* only changes if the
204 sensor measurement or detection value decreases from above the highest *Setpoint* and passes
205 the lowest *Setpoint* or if it increases from below the lowest *Setpoint* and passes the highest
206 *Setpoint*
- 207 **3.2.33**
208 **two value teach**
209 teach procedure requiring two *Teachpoints* to determine one *Setpoint*
- 210 **3.2.34**
211 **window mode**
212 evaluation method using two *Setpoints* defining a window area, inside the switching signal is
213 active
- 214 **3.3 Symbols and abbreviated terms**
- | | |
|-----|------------------------|
| CSC | Control Signal Channel |
| DI | Digital input |
| DO | Digital output |
| DV | Detection value |

FC	FunctionClass
MDC	Measurement Data Channel
MSDC	Measurement Switching Data Channel
MV	Measurement value
PLC	Programmable logic controller
SDCI	Single-drop digital communication interface
SP	Setpoint
SP1	Setpoint 1
SP2	Setpoint 2
SSC	Switching signal channel
TP1	Teachpoint 1
TP2	Teachpoint 2
TV	Technological value

3.4 Conventions

3.4.1 Behavioral descriptions

For the behavioral descriptions, the notations of UML 2 [4] are used, mainly state diagrams. The layout of the associated state-transition tables is following IEC 62390 [3].

Triggers are for example external requests ("calls") or internal changes such as timeouts; [guard] are Boolean conditions for exits of states; numbered transitions describe actions in addition to the triggers within separate state-transition tables.

In this document, the concept of "nested states" with superstates and substates is used as shown in the example of Figure 1.

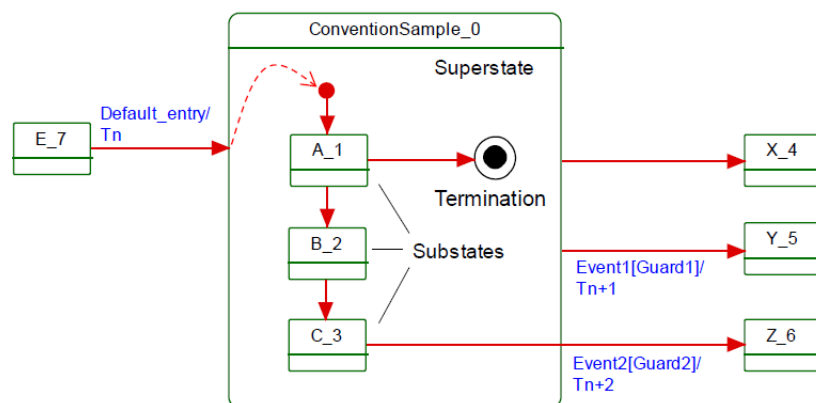


Figure 1 – Example of a nested state

UML 2 allows hierarchies of states with superstates and substates. The highest superstate represents the entire state machine. This concept allows for simplified modelling since the content of superstates can be moved to a separate drawing. An eyeglasses icon usually represents this content. Compared to "flat" state machines, a particular set of rules shall be observed for "nested states":

a) A transition to the edge of a superstate (e.g. Default_entry) implies transition to the initial substate (e.g. A_1).

b) Transition to a termination state inside a superstate implies a transition without event and guard to a state outside (e.g. X_4). The superstate will become inactive.

c) A transition from any of the substates (e.g. A_1, B_2, or C_3) to a state outside (Y_5) can take place whenever Event1 occurs and Guard1 is true. This is helpful in case of common errors within the substates. The superstate will become inactive.

d) A transition from a particular substate (e.g. C_3) to a state outside (Z_6) can take place whenever Event2 occurs and Guard2 is true. The superstate will become inactive.

The state diagrams shown in this document are entirely abstract descriptions. They do not represent a complete specification for implementation.

3.4.2 Memory and transmission octet order

Figure 2 demonstrates the order that shall be used when transferring WORD based data types from memory to transmission and vice versa (Figure 2).

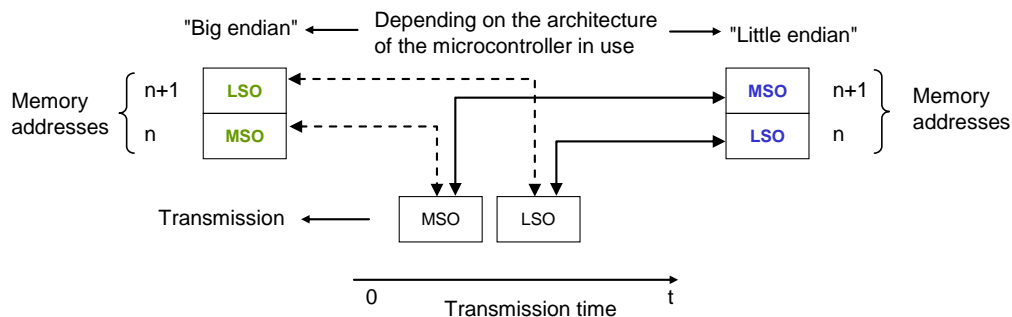


Figure 2 – Memory and transmission octet order

4 Overview of sensor devices

4.1 Smart Sensors

In factory automation, sensors nowadays are using a broad spectrum of sensing elements based on many different physical or chemical effects. They are converting one or more physical or chemical quantities (for example position, pressure, temperature, substance, etc.) and propagate them in an appropriate form to data processing units such as for example PLCs.

Due to the built-in microcontrollers these sensors are able to not only provide the conversion of the quantities but also to provide some preprocessing. Most of these sensors are "switching sensors". With the help of an individual parameterization or teaching process ("teach"), the sensors receive information on their "switching mode" and the Setpoint values. This can result in one or more binary information about the measured quantity. Depending on functionality, those sensors may provide the following PLC inputs

- Analog information to transfer measurement values such as pressure or temperature
- Binary information to transfer a switching state

or consume PLC outputs

- Binary information transferring the control state

This widespread sensor type is called "Smart Sensor". It has been somewhat constrained so far by the conventional digital and analog interfaces defined in IEC 61131-2.

4.2 Sensors migrating to SDCI

It is the purpose of SDCI to overcome the limitations of the classic sensor interfaces DI, DO, AI, and AO via a point-to-point digital communication that allows transmitting not only binary and/or analog information but additional information also. Very often, the changes to the core sensor application ("sensor technology") are very little during the migration to SDCI. However, the user realizes a dramatic increase in comfort and flexibility through the identification, parameterization, and diagnosis features.

4.3 Smart Sensor profile structure

Clause 5 contains the base explanations on how any Smart Sensor is defined within this standard. Clause 6 and 7 specify the switching sensors without any analogue-like transmission. In clause 8 the digital measuring sensor is specified which does not support switching information. The measuring and switching sensor is specified in clause 9.

In Annex A the base switching and associated teach functionalities are specified. The mapping of the previous defined profiles is specified in Annex B (function classes), Annex C (process data layout), Annex D (parameter), Annex E (PLC function blocks), and Annex F (IODD layout). Annex G contains the test extension to perform the Device conformance test.

5 Smart Sensor profile

5.1 Objectives for the Smart Sensor profile

The user expects a common "view" on a profile Device as defined in [7] and therefore requires standardized functions. On the other hand, room for innovations is expected and the possibility of customer specific adaptations to a certain extent. With this background, Device profiles are always a challenge and they are striving for good compromises.

Objective for this Edition 2 is the definition of supplementary profiles defining a more stringent behavior for the associated complementary ProfileIDs. PLC programs shall remain unchanged when moving between different Devices supporting one particular complementary ProfileID. In case of Device replacement, only the Device identification within the port configuration needs to be changed.

While the discontinued Edition 1 specifies a set of FunctionClasses from which a sensor designer can choose any combination, Edition 2 specifies a number of fixed combinations providing fixed functionality identified by an individual ProfileID.

In detail, the following requirements and objectives for the profile have been compiled:

- Manufacturer/vendor specific extensions (functions) shall always be possible.
- The profile specifies a set of standardized functions (FunctionClasses). If a manufacturer/vendor indicates particular FunctionClasses they shall be implemented and behave in the specified manner.
- Each Smart Sensor shall provide its manufacturer/vendor specific Device description file (IODD). It shall comply with the specified IODD profile template of a particular ProfileID.
- The Smart Sensor Profile does not focus on particular measurement technologies such as pressure, temperature, and alike. It focuses on common technology-independent features.
- The Device model shall describe the behavior of the Smart Sensor ("Function model").
- The Smart Sensor Profile specifies detailed Process Data layouts per ProfileID with accurate and substitute values to reduce the integration effort in a PLC program.
- Generic proxy function blocks for PLC programs are provided to illustrate the programming approach and to facilitate the deployment in PLC systems.
- Representation and transmission of the measurement information shall be based on Process Data Variables (PDV) and Switching Signal Channels (SSC).
- Necessary parameters for the profile shall be defined, for example setpoints, switching modes, etc.
- Uniform profile identification shall be specified (mandatory parameter objects).
- Uniform diagnosis information shall be defined.
- If appropriate a model of a PLC functionality is provided to give an example how to use the defined profile functionality from customer view.

- The support of the Profile "Identification and Diagnosis" or appropriate profiles shall be supported by all profile Devices, see [7].

The version V1.1 of Edition 2 extends the profiles by combinations of switching signals and measurement channels as well as the support of more than one sensor channel. Furthermore the test cases for the conformance check and IODD Checker are specified.

5.2 Measurement categories for Smart Sensors

The Smart Sensor Profile definitions are independent from the physical or chemical quantities to be measured. Table 1 contains a list of typical physical and chemical measurement quantities for Smart Sensors. The list is far from being complete.

Table 1 – Typical physical and chemical measurement quantities

Geometry	Movement	Force	Heat	Optic	Chemistry
Position Distance Angle Direction Strain Level	Travel Speed Rotation Displacement Acceleration Vibration	Force Pressure Tension Torque Acceleration	Temperature Heat Heat conductivity Specific heat	Refractivity Irradiance Light density Luminance Chrominance	Substances Volume fraction Mass fraction Humidity Conductivity pH value

Smart Sensors represent the measurement results in a uniform manner

- as switching information as Switching Signal Channels (SSC) or
- as measurement data information as Measurement Data Channel (MDC) or
- as Process Data Variables (PDV)

5.3 Smart Sensor object model

The Smart Sensor object model is based on the FunctionClass and ProfileID concepts defined in [7].

The profile specific abbreviation for all artefacts associated with the Smart Sensor Profile is defined in Table 2.

Table 2 – Prefixes for IODD ID elements

Profile name	Context identifier
SmartSensorProfile	SSP

Each ProfileID specifies which FunctionClasses are mandatory or optional.

Devices conform to the Smart Sensor Profile shall provide a list of the extended FunctionClasses in the parameter Profile Characteristic according [7].

The different types of smart sensor profiles are named with a description and can be identified by their type definition which is defined in Table 3. Subclasses are identified by an enumerator as postfix.

Table 3 – Smart Sensor Profile types

SSP types	Abbreviation	Description	Remark
SSP 1	FSS	Fixed Switching Sensor	See 6
SSP 2	AdSS	Adjustable Switching Sensor	See 7
SSP 3	DMS	Digital Measuring Sensor	See 08
SSP 4	DMSS	Digital Measuring Switching Sensor	See 09

To distinguish the different profile sub types of the SSP types, these are numbered and a profile characteristic name is defined which shall be referenced within the Device documentation and the IODD.

5.4 Abstract sensor model

As explanation of the switching sensor model in mind, in Figure 3 an abstract model of an adjustable switching sensor is shown. The sensor application provides the internal sensor value, the IO-Link data handling generates the switching information which is transmitted via IO-Link process data. Optionally the sensing element itself can be controlled by process data content. Not shown are the acyclic communication paths to adapt the data handling by changing SSC Config and SSC Param.

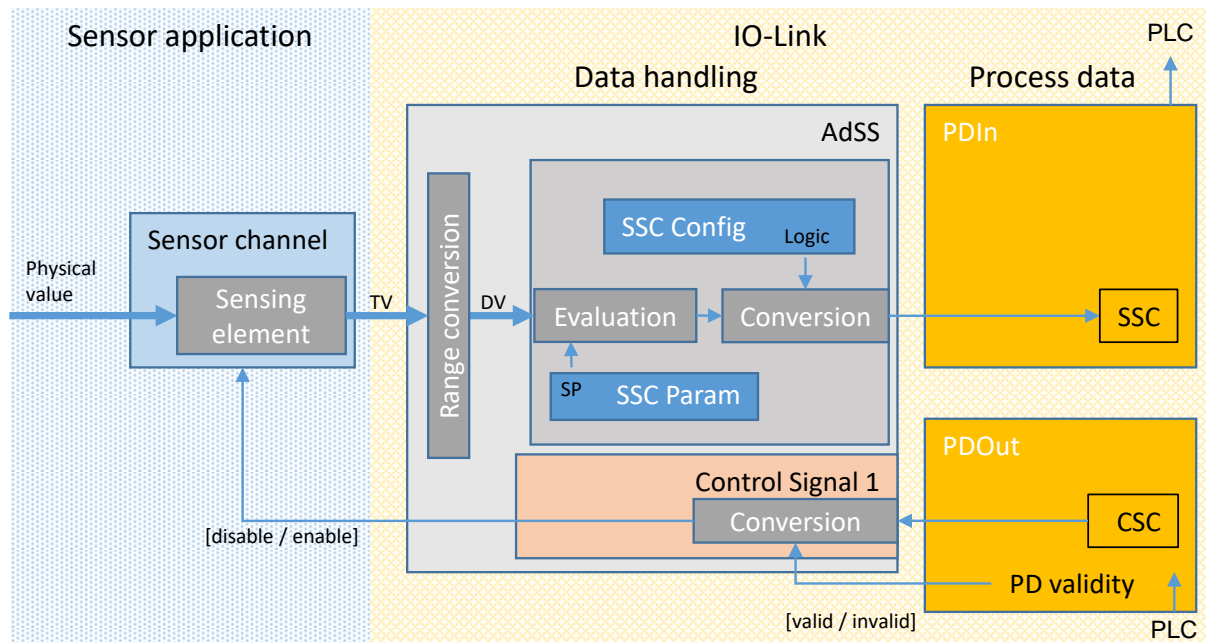


Figure 3 – Abstract sensor model switching sensor

A further more functional model of a measuring and switching sensor is shown in Figure 4. Up to four sensor channels can be covered, together with the transmission of each sensor value in physical units.

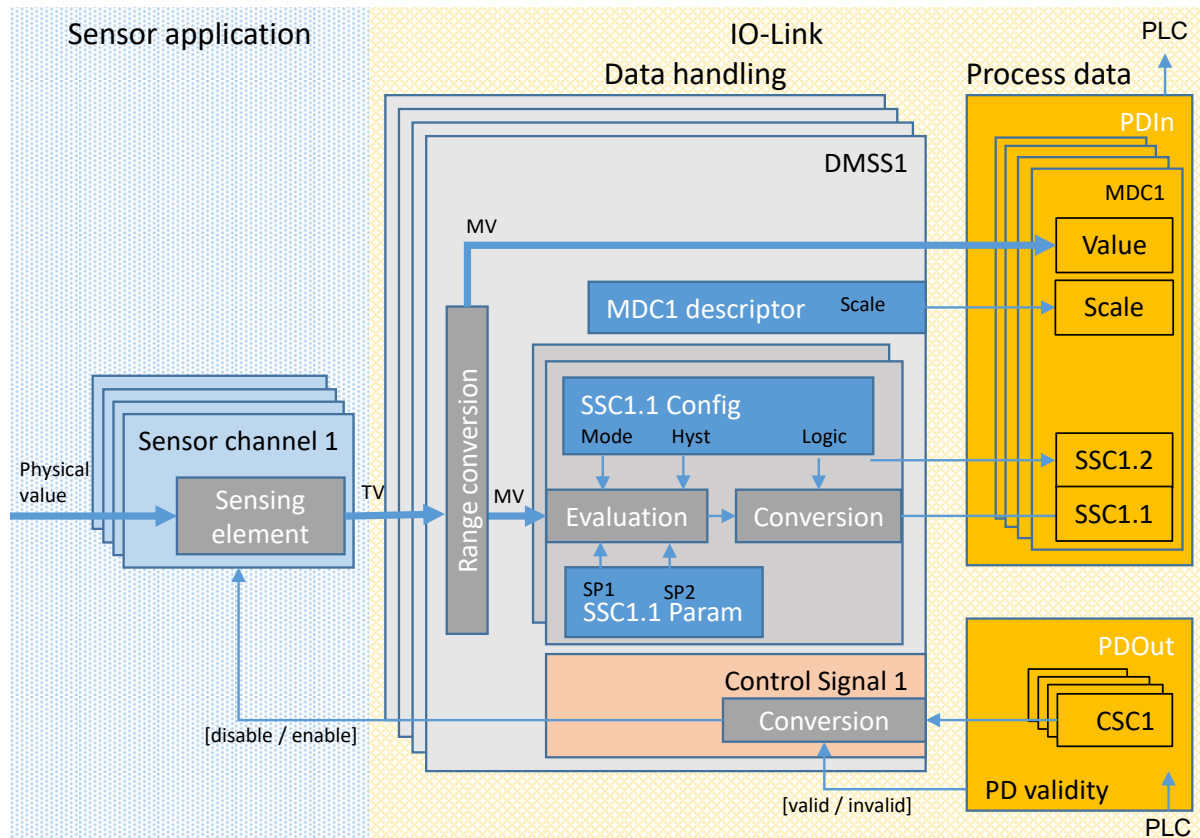


Figure 4 – Abstract sensor model measuring sensor

6 Fixed switching sensors (FSS)

6.1 Overview

Fixed switching sensors (FSS) within the Smart Sensor Profile are Devices offering exactly one binary switching signal. The Setpoint of this switching signal is predefined during the manufacturing process and is therefore fix for the application.

The FunctionClass Sensor Control allows for switching off/on the sensing element of a sensor, for example a laser.

In addition, the Switchpoint Logic (High-active / Low-active) can be defined by the application.

Table 4 provides an overview of the FunctionClasses and the process data structures for Fixed Switching Sensors.

Table 4 – Switching sensor profile types 1

Profile type	ProfileID	Profile characteristic name	FunctionClasses	Process data structure
SSP 1.1	0x0002	Fixed Switching Sensor	0x8005 a)	PD18.BOOL1 b)
Key a) See Annex B.2 b) See Annex C				

6.2 Mapping to SDCI communication

The mapping in the process data channel and associated parameters of Profile type SSP 1 are defined in Table 5.

Table 5 – Associated SDCI artifacts for SSP 1

Profile type SSP ...	PDV assignment	Associated parameter	Teach Channel	Functional description
1.1	SSC	SSCConfig.Logic	n/a	See D.4.2

6.3 Extension of SSP 1

The functionality of profile type SSP 1 may be extended by additional FunctionClasses. To ensure proper functionality, the allowed extensions and resulting process data assignments are defined in Table 6.

Table 6 – Extensions for SSP 1

SSP types	Possible extensions	Process data structure	PDV assignment
1.1	Sensor Control (0x800C) a)	PDO8.BOOL1	CSC
	Sensor Control Wide (0x800F) b)	PDO16.BOOL1	CSC
	Object detection (0x8013) c)	n/a	n/a
	Quantity detection (0x8014) d)		
Key	a) Shall not be combined with Sensor Control Wide b) Shall not be combined with Sensor Control c) Shall not be combined with Quantity detection d) Shall not be combined with Object detection		

7 Adjustable switching sensors (AdSS)

7.1 Overview

Adjustable switching sensors (AdSS) within the Smart Sensor Profile are Devices offering exactly one binary switching signal. The Setpoint of this switching signal can be defined by the application either by entering a dedicated Setpoint value during configuration or with the help of a teach procedure.

In addition, different teach procedures such as single value teach, two value teach, or dynamic teach are possible thus easing the commissioning of the application. Individual combinations of these teach methods are permitted depending on the type of sensor.

The Switchpoint Logic (High-active / Low-active) can be defined by the application.

The SSP 2.1 to SSP 2.3 profiles support only one switching signal channel with a reduced configuration set and teach abilities. The profile SSP 2.7 offers two switching signal channels with a full configuration set and at least single value teach abilities.

The FunctionClass Sensor Control allows for switching off/on the sensing element of a sensor, for example a laser.

Table 7 provides an overview of the FunctionClasses and the process data structures for "Adjustable Switching Sensors".

Table 7 – Switching sensor profile types 2

Profile type	ProfileID	Profile characteristic name	FunctionClasses		Process Data structure c)
SSP 2.1	0x0004	Adjustable Switching Sensor, single value teach	0x8006 a)	0x8007 b)	PDI8.BOOL1
SSP 2.2	0x0005	Adjustable Switching Sensor, two value teach		0x8008 b)	
SSP 2.3	0x0006	Adjustable Switching Sensor, dynamic teach		0x8009 b)	
SSP 2.7	0x000E	Adjustable Switching Sensor, 2 channel	0x800D a)	0x8010 b)	PDI8.BOOL2
Key a) See Annex B.3 b) See Annex B.5 c) See Annex C					

7.2 Mapping to SDCI communication

The mapping in the process data channel and associated parameters of Profile types SSP 2 are defined in Table 8.

Table 8 – Associated SDCI artifacts for SSP 2

Profil type SSP ...	PDV assignment	Associated parameter	Teach Channel	Functional description
2.1 2.2 2.3	n/a	SystemCommand	n/a	See D.3.2
		TeachResult		See D.4.4
	SSC	SSCConfig.Logic		See D.4.2
		SSCParam.SP		See D.4.3
2.7	n/a	SystemCommand		See D.3.2
		TeachSelect		See D.5.1
		TeachResult		See D.5.3
	SSC1	SSC1Config	1	See D.5.5
		SSC1Param		See D.5.1
	SSC2	SSC2Config	2	See D.5.5
		SSC2Param		See D.5.1

7.3 Extension of SSP 2.1 to SSP 2.3

The functionality of profile types SSP 2.1 to 2.3 may be extended by additional Function-Classes. To ensure proper functionality, the allowed extensions and resulting process data assignments are defined in Table 9.

Table 9 – Extensions for SSP 2.1 to SSP 2.3

SSP types	Possible extensions	Process data structure	PDV assignment
2.1 2.2 2.3	Sensor Control (0x800C) a)	PDO8.BOOL1	CSC
	Sensor Control Wide (0x800F) b)	PDO16.BOOL1	CSC
	Object detection (0x8013) d)	n/a	n/a
	Quantity detection (0x8014) e)		

SSP types	Possible extensions	Process data structure	PDV assignment
Key	a) Shall not be combined with Sensor Control Wide b) Shall not be combined with Sensor Control c) Shall not be combined with Quantity detection d) Shall not be combined with Object detection		

7.4 Extension of SSP 2.7

The functionality of profile type SSP 2.7 may be extended by additional Function-Classes. To ensure proper functionality, the allowed extensions and resulting process data assignments are defined in Table 10.

Table 10 – Extensions for SSP 2.7

SSP type	Possible extensions	Process data structure	PDV assignment
2.7	Sensor Control (0x800C) ^{a)}	PDO8.BOOL1	CSC
	Sensor Control Wide (0x800F) ^{b)}	PDO16.BOOL1	CSC
	Teach two value (0x8011)	n/a	n/a
	Teach dynamic (0x8012)		
	Object detection (0x8013) ^{c)}		
	Quantity detection (0x8014) ^{d)}		
Key	a) Shall not be combined with Sensor Control Wide b) Shall not be combined with Sensor Control c) Shall not be combined with Quantity detection d) Shall not be combined with Object detection		

7.5 Possible combinations of switching sensor profile characteristics

Table 11 shows all permitted combinations of profiles within one Device.

Table 11 – Possible switching sensor profile combinations

SSP types	ProfileIDs
SSP 2.1 + SSP 2.2	0x0004 + 0x0005
SSP 2.1 + SSP 2.3	0x0004 + 0x0006
SSP 2.2 + SSP 2.3	0x0005 + 0x0006
SSP 2.1 + SSP 2.2 + SSP 2.3	0x0004 + 0x0005 + 0x0006

7.6 Proxy Function Block (FB) for Adjustable Switching Sensors

To ease the integration in Run-Time systems like PLCs, appropriate FunctionBlocks are specified in E.2 and E.3. By using this an operator can perform the teach actions based only on the teach principle without knowledge of the used parameters or data. Also all failure reactions and specific actions were performed and the operator gets simple results. The behavior and functionality is mapped in the view and system level of the operator.

The FunctionBlock defined in E.2 supports the Profile types SSP 2.1 to SSP 2.3 only; the FunctionBlock defined in E.3 supports the Profile types SSP 2 in general and offers the selection between different Switching Signal Channels and their associated parameters.

8 Digital measuring sensors (DMS)

8.1 Overview

In principle, SDCI communication allows any data representation of measured values. As a consequence many different data structures with different data types can occur, which may lead to higher engineering costs at commissioning, maintenance (exchange of Devices) and porting of user programs from one PLC to another.

Thus, it is the purpose of this profile to standardize also the data structures for measuring sensors.

At first the number of data structures for any measuring sensor is limited. The data structures are defined without considering unit variants. This implies also some rules for the permitted value ranges and a definition of limit/substitute values for specific data types. Together with a fixed-point value an applicable scale (factor equals to 10^{scale}) is provided to allow for automatic handling of the data type in function blocks. This allows small footprint sensor applications, simple usage of the fixed point value, and also a convenient calculation by a function call within a PLC.

The data structures will be assigned to specific parameters defining the physical quantities in SI units and measuring limits of the specific Device, see D.6.

The highly recommended combinations of data structures and SI units are defined to reduce different interpretations of physical measurements.

In Table 12, the possible combinations of FunctionClasses for the measuring Device profile are defined. Each ProfileID represents one single combination comprising the mandatory FunctionClasses.

Support of the Profiles Identification and Diagnosis is mandatory when supporting these Profiles.

A particular FunctionClass Sensor Control allows for switching off/on the sensing element of the measuring Device.

Table 12 – Measuring Device profile types 3

Profile type	ProfileID	Profile characteristic name	FunctionClasses	Process Data structure b)
SSP 3.1	0x000A	Measuring Sensor	0x800A a)	PDI32.INT16_INT8
SSP 3.2	0x000B	Measuring Sensor, high resolution	0x800B a)	PDI48.INT32_INT8
Key a) See Annex B.6 b) See Annex C				

The mapping in the process data channel and associated parameters of Profile type SSP 3 are defined in Table 13.

Table 13 – Associated SDCI artifacts for SSP 3

Profile type SSP ...	PDV assignment	Associated parameter	Functional description
3.1	MDC	MDCDescr	See D.6.1
3.2			

8.2 Extension of SSP 3

The functionality of profile type SSP 3 may be extended by additional FunctionClasses. To ensure proper functionality, the possible extensions and resulting process data assignments are defined in Table 14.

Table 14 – Extensions for SSP 3.1 to SSP 3.2

SSP type	Possible extensions	Process data structure	PDV assignment
3.1 3.2	Sensor Control (0x800C) ^{a)}	PDO8.BOOL1	CSC
	Sensor Control Wide (0x800F) ^{b)}	PDO16.BOOL1	CSC
	Object detection (0x8013) ^{c)}	n/a	n/a
	Quantity detection (0x8014) ^{d)}		
Key	a) Shall not be combined with Sensor Control Wide b) Shall not be combined with Sensor Control c) Shall not be combined with Quantity detection d) Shall not be combined with Object detection		

8.3 Proxy function call for measuring sensors

To ease the integration in Run-Time systems like PLCs, an appropriate FunctionCall is specified in E.4. The FunctionCall decodes the process data from the device and provides the information in a way an operator can use directly in any PLC program. All specific decoding action is taken without any required specific knowledge of the data structure.

9 Digital Measuring and Switching Sensors (DMSS)

9.1 Overview

The FunctionClass Measurement Data Channel (see B.6) defines the transmission of measurement values; the FunctionClass Multiple Adjustable Switching Signal Channel (see B.4) defines independent Switching Signal Channels. The Profile type SSP 4 combines these two definitions to build a new class of sensors – Digital Measuring and Switching Sensors.

In addition, this class allows 1 to 4 instances of Measurement and Switching Data Channels, thus, allowing up to four measurement values with two switching signals for each channel.

Support of the Profile Identification and Diagnosis [0x4000] is mandatory when supporting these Profiles.

All SSP 4 Profile types contain the FunctionClasses Multiple Adjustable Switching Signal Channel [0x800D] and Multi Teach Single Point [0x8010] as a functional base.

In Table 15, the possible combinations of FunctionClasses for the Digital Measuring and Switching Sensor profile are defined. Each ProfileID represents one single combination comprising the specific FunctionClasses and associated process data structure.

Table 15 – Measuring Device profile types 4

Profile type	Profile-ID	Profile characteristic name	FunctionClasses		Process Data structure b)	
SSP 4.1.1	0x0010	Measuring and Switching Sensor, 1 channel	0x800D 0x8010	0x800A a)	PDI32.MSDC32_1	
SSP 4.1.2	0x0011	Measuring and Switching Sensor, 2 channel			PDI64.MSDC32_2	
SSP 4.1.3	0x0012	Measuring and Switching Sensor, 3 channel			PDI96.MSDC32_3	
SSP 4.1.4	0x0013	Measuring and Switching Sensor, 4 channel			PDI128.MSDC32_4	
SSP 4.2.1	0x0014	Measuring and Switching Sensor, high resolution, 1 channel		0x800B a)	PDI48.MSDC48_1	
SSP 4.2.2	0x0015	Measuring and Switching Sensor, high resolution, 2 channel			PDI96.MSDC48_2	
SSP 4.2.3	0x0016	Measuring and Switching Sensor, high resolution, 3 channel			PDI144.MSDC48_3	
SSP 4.2.4	0x0017	Measuring and Switching Sensor, high resolution, 4 channel			PDI192.MSDC48_4	
SSP 4.3.1	0x0018	Measuring and Switching Sensor, floating point, 1 channel		0x800E a)	PDI48.MSDCF_1	
SSP 4.3.2	0x0019	Measuring and Switching Sensor, floating point, 2 channel			PDI80.MSDCF_2	
SSP 4.3.3	0x001A	Measuring and Switching Sensor, floating point, 3 channel			PDI112.MSDCF_3	
SSP 4.3.4	0x001B	Measuring and Switching Sensor, floating point, 4 channel			PDI144.MSDCF_4	
NOTE	a) See Annex B.6 b) See Annex C					

9.2 Associated SDCI communication for SSP 4

The mapping in the process data channel and associated parameters of Profile types SSP 4 is defined in Table 16.

Table 16 – Associated SDCI artifacts for SSP 4

Profile type SSP ... a)				PDV assign- ment	Associated parameter	Teach Channel b)	Functional description	PSC c)
4.1.1 to 4.3.4					SystemCommand	n/a	See D.3.2	All
					TeachSelect		See D.5.2	
					TeachResult		See D.5.3	
			4.n.1	MDC1	MDC1Descr	n/a	See D.6.1 d)	1
				SSC1.1	SSC1.1Config SSC1.1Param	1	See D.5.5 and D.5.1 d)	
				SSC1.2	SSC1.2Config SSC1.2Param	2		
			4.n.2	MDC2	MDC2Descr	n/a	See D.6.1 d)	2
				SSC2.1	SSC2.1Config SSC2.1Param	11	See D.5.5 and D.5.4 d)	
				SSC2.2	SSC2.2Config SSC2.2Param	12		
			4.n.3	MDC3	MDC3Descr	n/a	See D.6.1 d)	3
				SSC3.1	SSC3.1Config SSC3.1Param	21	See D.5.5 and D.5.1 d)	
				SSC3.2	SSC3.2Config SSC3.2Param	22		
			4.n.4	MDC4	MDC4Descr	n/a	See D.6.1 d)	4
				SSC4.1	SSC4.1Config SSC4.1Param	31	See D.5.5 and D.5.4 d)	
				SSC4.2	SSC4.2Config SSC4.2Param	32		
NOTE a) n = 1, 2, 3 b) see D.5.2, gaps between the physical sensor channels allow vendor specific extensions c) PSC is equivalent to Physical Sensor Channel d) SSP 4.1.x and SSP 4.2.x are Integer32T based, SSP 4.3.x is Float32T based								

9.3 Extension of SSP 4

The functionality of profile type SSP 4 may be extended by additional FunctionClasses. To ensure proper functionality, the possible extensions and resulting process data assignments are defined in Table 17

Table 17 – Extensions for SSP 4

SSP type a)	Possible extensions	Process data structure	PDV assignment
4.n.1	Sensor Control (0x800C) ^{b)}	PDO8.BOOL1	CSC1 for PSC 1
4.n.2		PDO8.BOOL2	CSC1 for PSC 1 CSC2 for PSC 2
4.n.3		PDO8.BOOL3	CSC1 for PSC 1 CSC2 for PSC 2 CSC3 for PSC 3
4.n.4		PDO8.BOOL4	CSC1 for PSC 1 CSC2 for PSC 2 CSC3 for PSC 3 CSC4 for PSC 4
4.n.1	Sensor Control Wide (0x800F) ^{c)}	PDO16.BOOL1	CSC1 for PSC 1
4.n.2		PDO16.BOOL2	CSC1 for PSC 1 CSC2 for PSC 2
4.n.3		PDO16.BOOL3	CSC1 for PSC 1 CSC2 for PSC 2 CSC3 for PSC 3
4.n.4		PDO16.BOOL4	CSC1 for PSC 1 CSC2 for PSC 2 CSC3 for PSC 3 CSC4 for PSC 4
4.n.1 to 4.n.4	Teach two value (0x8011)	n/a	n/a
	Teach dynamic (0x8012)		
	Object detection (0x8013) ^{d)}		
	Quantity detection (0x8014) ^{e)}		
Key a) n = 1 to 3 b) Shall not be combined with Sensor Control Wide c) Shall not be combined with Sensor Control d) Shall not be combined with Quantity detection e) Shall not be combined with Object detection			

9.4 Proxy function call for Digital Measuring and Switching Sensors

As the Measurement Data Channel according 0x800A and 0x800B provide fixed-point process value, for these FunctionClasses an appropriate FunctionCall is specified in E.4 which eases the integration in Run-Time systems like PLCs.

The FunctionCall decodes the process data from the device and provides the information in a way an operator can use directly in any PLC program. All specific decoding action is taken without any required specific knowledge of the data structure.

Annex A (normative)

General switching and teach approaches

A.1 Overview

This annex contains the general approaches for switching sensors in which the setpoints can be adapted by means of a teach.

The following clauses define the base functionalities which can be used in all FunctionClasses which are using switching signals or teach procedures.

In order to achieve stable switching behavior a configurable hysteresis is available.

A.2 Switching behavior

A.2.1 Overview on switchpoint modes

The switchpoint modes define the behavior of the switching signal depending on setpoint parameters and the current detection or measurement value.

The specified functions comprises of 4 different modes:

- Deactivated
- Single Point Mode
- Window Mode
- Two Point Mode

The precise switching behavior is not predefined in this clauses. All figures are just examples and show one possible reaction of the SSC. Additionally the reaction in Single or Two Point Mode is different between quantity or object detection. The exact behavior of the SSC shall be described in the user manual or by adding one of the extension FunctionClasses according B.8.

A.2.2 Switchpoint logic

The target detection or passing a threshold results in a switching state. The logic functionality provides means to convert the switching state into a switching signal channel value following the logic in Table A.1.

Table A.1 – Conversion table from switching state to SSC value

Switchpoint logic	Switching state	
	active	inactive
High-active	TRUE	FALSE
Low-active	FALSE	TRUE

Note: TRUE is commonly known as High, FALSE is commonly known as Low

A.2.3 Single Point Mode

The examples shown in Figure A.1 and Figure A.2 demonstrate the switching behavior in Single Point Mode. The switching state changes, when the current value reaches the Setpoint SP1. This change occurs with rising or falling values. The Setpoint SP2 is not relevant in this mode.

The behavior shown in Figure A.1 is typical for object detection.

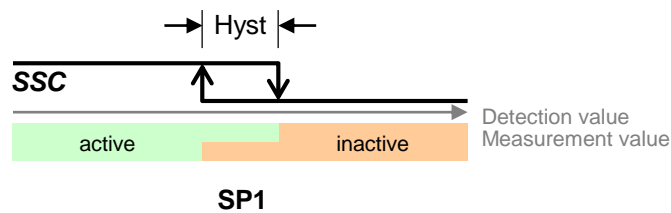


Figure A.1 – Example of a Single Point Mode for object detection

The behavior shown in Figure A.2 is typical for quantity (level) detection of materials (liquids).

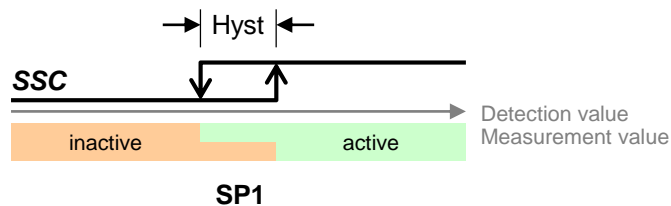


Figure A.2 – Example of a Single Point Mode for quantity detection

A.2.4 Window Mode

Figure A.3 demonstrates the switching behavior in Window Mode. The switching state changes, when the current value reaches either Setpoint SP1 or Setpoint SP2. This change occurs with rising or falling values.

This example shows symmetrical hysteresis in respect to SP1 and SP2.

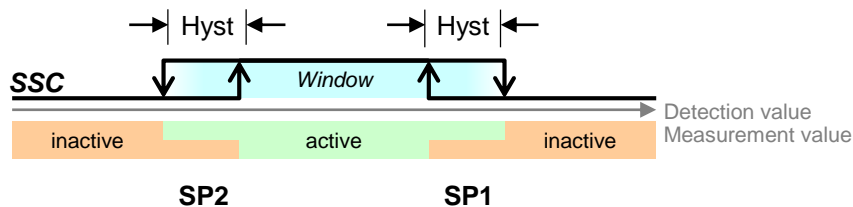


Figure A.3 – Example for the Window Mode

A.2.5 Two Point Mode (without hysteresis)

Figure A.4 demonstrates the switching behavior in Two Point Mode. The switching state changes, when the current value reaches the Setpoint SP1. This change occurs only with rising measurement values. The switching state changes also, when the current value reaches the Setpoint SP2. This change occurs only with falling measurement values. Hysteresis shall be ignored in this case.

If the detection value is inbetween SP1 and SP2 at power-on of the Smart Sensor, the behavior depends on the manufacturer/vendor specific design of the Device.

The behavior shown in Figure A.4 is typical for object detection of objects in respect to SP1 and SP2.

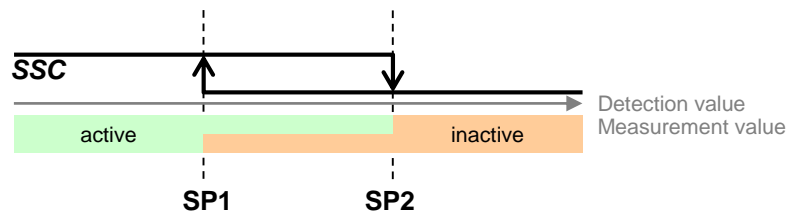


Figure A.4 – Example for the Two Point Mode of object detection

The behavior shown in Figure A.5 is typical for quantity (level) detection of materials (liquids) in respect to SP1 and SP2.

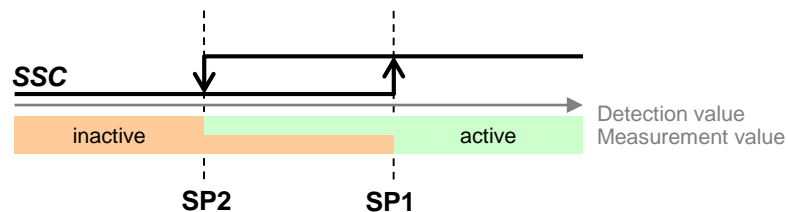


Figure A.5 – Example for the Two Point Mode of quantity detection

A.2.6 Deactivated

The switching state in the deactivated mode shall be "inactive".

A.3 Teach behavior

A.3.1 Concepts for Smart Sensors

The functionality teach defines an interface for remote teach functions via SDCI communication and standardized commands for the most common basic teach mechanisms. Thus, the Smart Sensor profile provides a uniform and flexible interface for several teach methods. Instead of defining all kinds of teach methods, this functionality defines a set of universal commands that can be used in various sequences to realize many individual methods. This includes the calculation algorithms for the associated parameters such as the setpoints.

Two parameters are used to control the teach procedure. SystemCommands are defined to trigger the requested actions. Each individual command enables the user to start one out of several standardized teach procedures. If more than one switching signal channel is available, a selection parameter allows the selecting of the channel to be accessed.

The status and result of the requested teach commands are provided in a feedback parameter containing states of the internal state machine and flags indicating success of specific actions.

A.3.1.1 Single value teach

A setpoint is set-up via a single command which triggers the acquisition of the current value, range checking, calculation, and activation of the setpoint. During the teach procedure the measurement value should be constant in order to guarantee a consistent determination of the teach value.

Figure A.6 illustrates an example for single value teach in Single Point Mode.

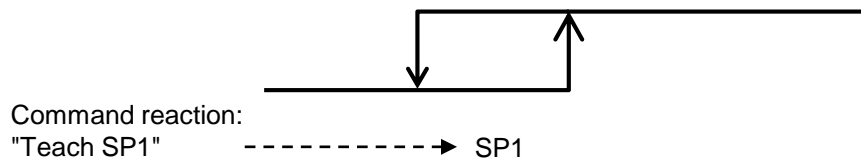


Figure A.6 – Single value teach (Single Point Mode)

Figure A.7 illustrates an example for single value Teach in Window Mode.

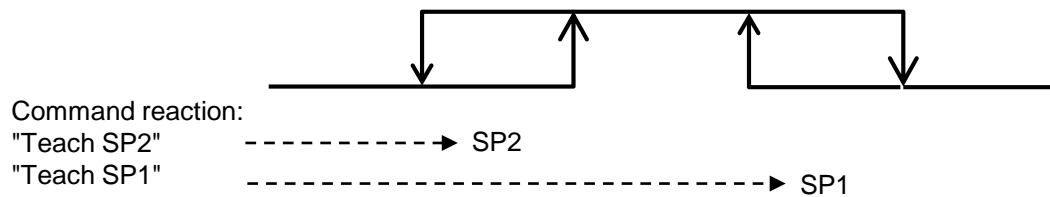


Figure A.7 – Single value teach (Window Mode)

A.3.1.2 Two value teach

A setpoint is defined by two Teachpoints (TP).

The teach commands "Teach SPn TPm" may be issued more than once without changing the actual teach settings. The command "Teach Apply" triggers the range check and calculation of the corresponding setpoint and activates the new setpoint.

Figure A.8 illustrates an example for two value teach in Single Point Mode.

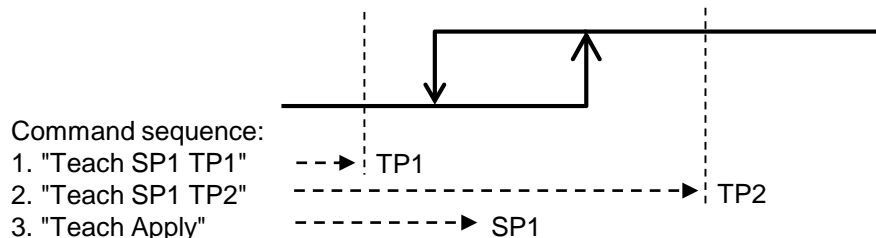


Figure A.8 – Two values teach (Single Point Mode)

Figure A.9 illustrates an example for two value teach in Two Point Mode.

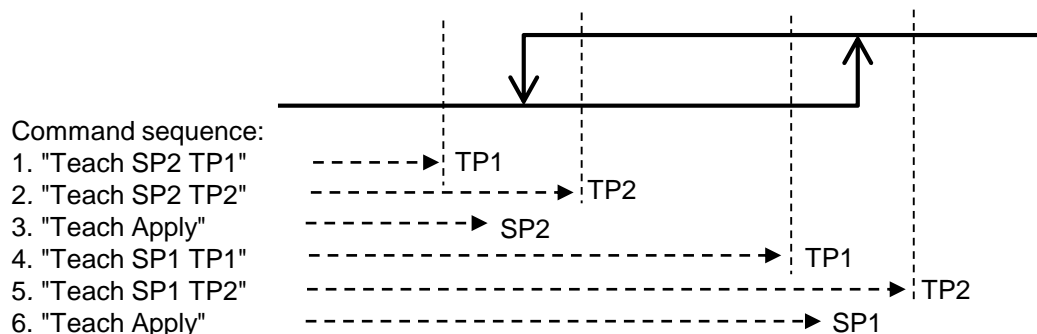


Figure A.9 – Two values teach (Two Point Mode)

A.3.1.3 Dynamic teach (within a time period)

One single setpoint or both setpoints are set-up via captured measurement values during the time between Teach SPx Start and Teach SPn Stop. The teach procedure is used for dynamic environments, which means, the measurement value is not constant during the teach procedure. Usually, the minimum and maximum values within this time frame are taken to define the setpoints. The command "Teach SPn Stop" triggers the range check, calculation, and activation of the corresponding setpoint.

Figure A.10 illustrates an example for dynamic teach in Single Point Mode.

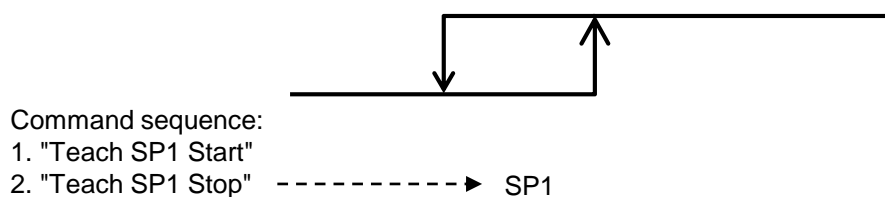


Figure A.10 – Dynamic teach (Single Point Mode)

Figure A.11 illustrates an example for dynamic teach in Window Mode.

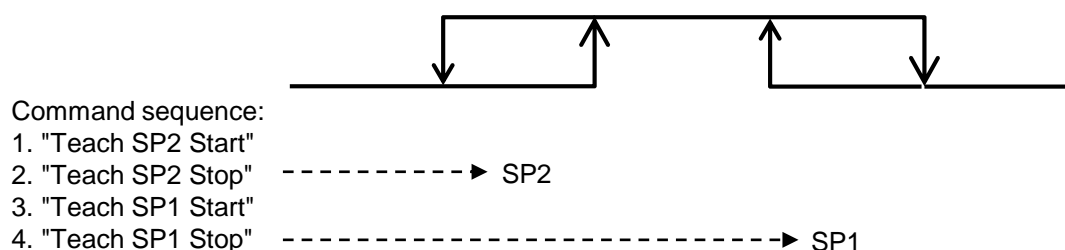


Figure A.11 – Dynamic teach (Window Mode)

A.3.1.4 Teach Cancel

The command "Teach Cancel" can be used to cancel the teach procedures two value teach or dynamic teach without calculation of the setpoints. In this case, the previously taught setpoints will be kept unchanged.

Annex B (normative) FunctionClasses

B.1 Overview

Table B.1 provides an overview of the defined or referenced FunctionClasses together with references to the Common Profile specification [7] and clauses within this document.

Table B.1 – Overview of FunctionClasses

Function-Class	Name	Reference / Clause
[0x8005]	Fixed Switching Signal Channel	6, B.2,
[0x8006]	Adjustable Switching Signal Channel	7, B.3
[0x8007]	Teach single value	7, B.5
[0x8008]	Teach two value	
[0x8009]	Teach dynamic	
[0x800A]	Measurement Data Channel, (standard resolution)	8, B.6
[0x800B]	Measurement Data Channel, (high resolution)	
[0x800C]	Sensor Control	B.7
[0x800D]	Multiple Adjustable Switching Signal Channel	B.4
[0x800E]	Measurement Data Channel, (floating point)	8, B.6
[0x800F]	Sensor Control Wide	B.7
[0x8010]	Multi Teach Single Value	7, B.5
[0x8011]	Multi Teach Two Value Extension	
[0x8012]	Multi Teach Dynamic Extension	
[0x8013]	Object detection	B.8.2
[0x8014]	Quantity detection	B.8.3

As defined in [7] the listed FunctionClasses shall only be used in context of a DeviceProfile or as allowed extension accompanying a DeviceProfile.

B.1.1 Basic parameter rules

The parameters defined in this Annex shall be accessible as defined in the corresponding parameter definitions. In general, the rules of [1] apply, in detail the following rules shall be observed

- Any parameter shall follow the accessibility rule for this parameter
- Optional or conditional Subindices shall always be readable and return at least the defined default value
- Parameters, especially Subindices, which are marked as “not relevant” for specific configurations, shall be checked for access and structure compliance in these cases, see Table 97 in [1]. Checks for consistency shall not lead to a rejection of the setting.

B.2 Fixed Switching Signal Channel – [0x8005]

B.2.1 General

The FunctionClass Fixed Switching Signal Channel provides a Single Point Mode functionality with one predefined Setpoint, which cannot be altered by the user application. Therefore, this FunctionClass cannot be combined with Teach FunctionClasses. The switchpoint of the switching signal is directly derived from the fixed Setpoint.

B.2.2 Switching signal behavior

The switching signal behavior is according Single Point Mode, see A.2.3, with configurable switchpoint logic conform to A.2.2 with the parameter defined in D.4.2.

B.3 Adjustable Switching Signal Channel – [0x8006]

B.3.1 General

The FunctionClass Adjustable Switching Signal Channel provides settings for adjustment of Setpoint and Switchpoint Logic. The switchpoint of the switching signal is directly derived from the Setpoint. It can be combined with any of the Teach FunctionClasses Teach single value [0x8007], Teach two value [0x8008], or Teach dynamic [0x8009].

B.3.2 Switching signal behavior

The switching signal behavior is according Single Point Mode, see A.2.3, with configurable switchpoint logic conform to A.2.2 and adjustable Setpoints according D.4.3.

B.3.3 Multiple physical sensing elements

This FunctionClass does not support multiple sensor functionality.

B.3.4 Function Block Proxy

A corresponding Proxy Function Block is specified in E.2.

B.4 Multiple Adjustable Switching Signal Channel – [0x800D]

B.4.1 General

The Multiple Adjustable Switching Signal Channel offers a multi-channel FunctionClass with a complete functionality set as defined in Annex A.

This FunctionClass is one of the key building blocks for the profiles Digital Measuring and Switching Sensor. As well it allows defining a profile for an Adjustable Switching Sensor with two signal channels.

B.4.2 Configuration and parameterization of the SSC

The following 4 parameters define the switching behavior of an SSC:

- Logic
- Hysteresis
- Mode
- SP1 and SP2

These parameters are defined in A.2 for functionality and in D.5.4, D.5.5 for structure.

This profile specification defines several best-practices SSCs. Manufacturer/vendor specific linear extensions are always possible.

B.4.3 Switchpoint Logic

The parameter Logic, see D.5.5, defines whether the switching information is transmitted as High-active or Low-active signals, see A.2.2 for functionality.

B.4.4 Switchpoint Hysteresis

The parameter Hyst, see D.5.5, defines whether a hysteresis is associated with the Setpoints SP1 and SP2. The layout of the hysteresis in respect to SP1 and SP2, for example symmetrical, right-aligned, or left-aligned, etc. is manufacturer/vendor specific. It cannot be defined in the FunctionClass.

The interpretation of the hysteresis values (relative or absolute) is also manufacturer/vendor specific.

B.4.5 Switchpoint Modes

B.4.5.1 Overview

The parameter Mode, see D.5.5, defines how the binary state information of the switching signal is created depending on Setpoint parameters (SP1, SP2) and the current measurement value.

The parameter Mode does not define the switching function itself. The different sensor types are using different switching functions depending on the various manufacturer/vendor specific technologies.

The FunctionClass supports the modes Deactivated, Single Point Mode, Window Mode, and Two Point Mode. All Modes shall be implemented, additional manufacturer/vendor specific modes are possible.

B.4.6 Setpoint parameters (SP1, SP2)

A Smart Sensor deploys Setpoints SP1 and SP2 per SSC. That means, even if the Smart Sensor does not use SP2 in its actual switching mode, it shall support read and write access to both parameters.

The interpretation of the Setpoints SP1 and SP2 depends on the particular implementation of the manufacturer/vendor. However, if the measurement value for the definition of switching state information (SSC) is also provided as a ProcessDataVariable (PDV), the Setpoints shall be represented in the same manner, this means that the same Gradient and Offset shall be used. In any case the data type for SP1 and SP2 is IntegerT32 which also supports IntegerT16 profiles by sign extension, see D.5.4.

B.4.7 Multiple physical sensing elements

The switching signal channel can be used for multiple physical sensor channels. The mapping to the SDCI communication channels or process data content is defined in the specific profile description, see Table 16.

B.4.8 Function Block Proxy

A corresponding Proxy Function Block is specified in E.3.

B.5 Teach FunctionClasses – [0x8007] to [0x8009] and [0x8010] to [0x8012]

B.5.1 Overview

The base teach functionality is specified in A.3, simplified for one channel. The support of multiple channels is realized by providing a TeachSelect parameter, see D.5.1. The parameter selects one of the available switching signal channels according to the associated SDCI artifacts of the specific profile type. In this clause the dynamic behavior triggered by SystemCommands is specified.

B.5.2 Restrictions and differences between the Teach FunctionClasses

The Table B.2 and Table B.3 define the supported features and parameters provided by the different Teach FunctionClasses. The corresponding parameter coding is defined in Table D.3.

Table B.2 – Supported functionalities by FunctionClasses [0x8007] to [0x8009]

Teach function	FunctionClasses		
	0x8007	0x8008	0x8009
Teach Apply	–	M	–
Teach SP	M	–	–
Teach SP TP1	–	M	–
Teach SP TP2	–	M	–
Teach SP Start	–	–	M
Teach SP Stop	–	–	M
Teach Cancel	–	M	M
Parameter TeachResult	See D.4.4		
Key M Mandatory - not supported			

Table B.3 – Supported functionalities by FunctionClasses [0x8010] to [0x8012]

Teach function	FunctionClasses		
	0x8010	0x8011	0x8012
Teach Apply	–	M	–
Teach SP1	M	–	–
Teach SP2	M	–	–
Teach SP1 TP1	–	M	–
Teach SP1 TP2	–	M	–
Teach SP2 TP1	–	M	–
Teach SP2 TP2	–	M	–
Teach SP1 Start	–	–	M
Teach SP1 Stop	–	–	M
Teach SP2 Start	–	–	M
Teach SP2 Stop	–	–	M
Teach Cancel	–	M	M
Parameter TeachSelect	M	M	M
Parameter TeachResult	See D.5.3		
Key M Mandatory - not supported			

B.5.3 Parameter TeachResult

The parameter TeachResult provides feedback on the status and the results of the teach activities. The parameter mapping and coding is described in Figure D.1.

B.5.4 Teach behavior of the Teach FunctionClasses

B.5.4.1 General

All teach procedures require a sequential interaction between user program (PLC) and Device. The sequence is described herein via a Device state machine. The Device signals the current state using the parameter TeachResult; the user program (PLC) sends teach commands by means of the Master.

The state machine shall be in Teach_Idle_0 in order to start a new teach procedure.

Upon communication restart, the teach state machine shall be reset to Teach_Idle_0. Pending actions shall be aborted in this case.

The parameter DeviceStatus (see B.2.20 in [1]) shall not indicate the state Functional-Check during the teach process.

B.5.4.2 Common rules for teach parameters

In Table B.4 the response constraints of the associated teach parameters are defined to standardize the reaction of the Device even in incorrect usage.

Table B.4 – ISDU response constraints on teach parameter

Request	Priority	ISDU response	Condition
SystemCommand	1	ErrorType 0x8035 Function not available	Teach Command is not supported by the Device, regardless of the Device state
	2	ErrorType 0x8036 Function temporarily not available	Teach Command is supported but the current state of the Device does not allow the triggered command or the triggered command cannot be executed due to an ongoing teach process.
	3	Write response (+)	Teach Command is supported and accepted in the current state of the Device.
TeachSelect	1	ErrorType 0x8011 Index not available	Access to TeachSelect is generally not supported
	2	ErrorType 0x8030 Parameter value out of range	Access to TeachSelect is generally supported but the requested channel is not supported by the Device
	3	Write response (+)	Access to TeachSelect is generally supported, teach state machine is forced into Idle_0, and the channel is selected for the next Teach commands.

The response indicates the acceptance of the action and shall return one of the responses of Table B.4. After reception of the positive response, the current state of the teach process is represented in the parameter TeachResult.

The teach process supports exactly one Setpoint teach at a time. Selection of a different Switching Signal Channel will cancel an ongoing process, attempts to start simultaneous Setpoint teaches will be rejected.


As these reactions are common for all states of the teach state machine, the error handling regarding the Teach commands or TeachSelect is not represented by transitions or state descriptions.

In case of a positive response the resulting action of the accessed parameter is described in the state machine or the transition table.

B.5.4.3 Common state machine for all teach FunctionClasses (Device)

Figure B.1 shows the common Device state machine for all teach function class subsets.

794

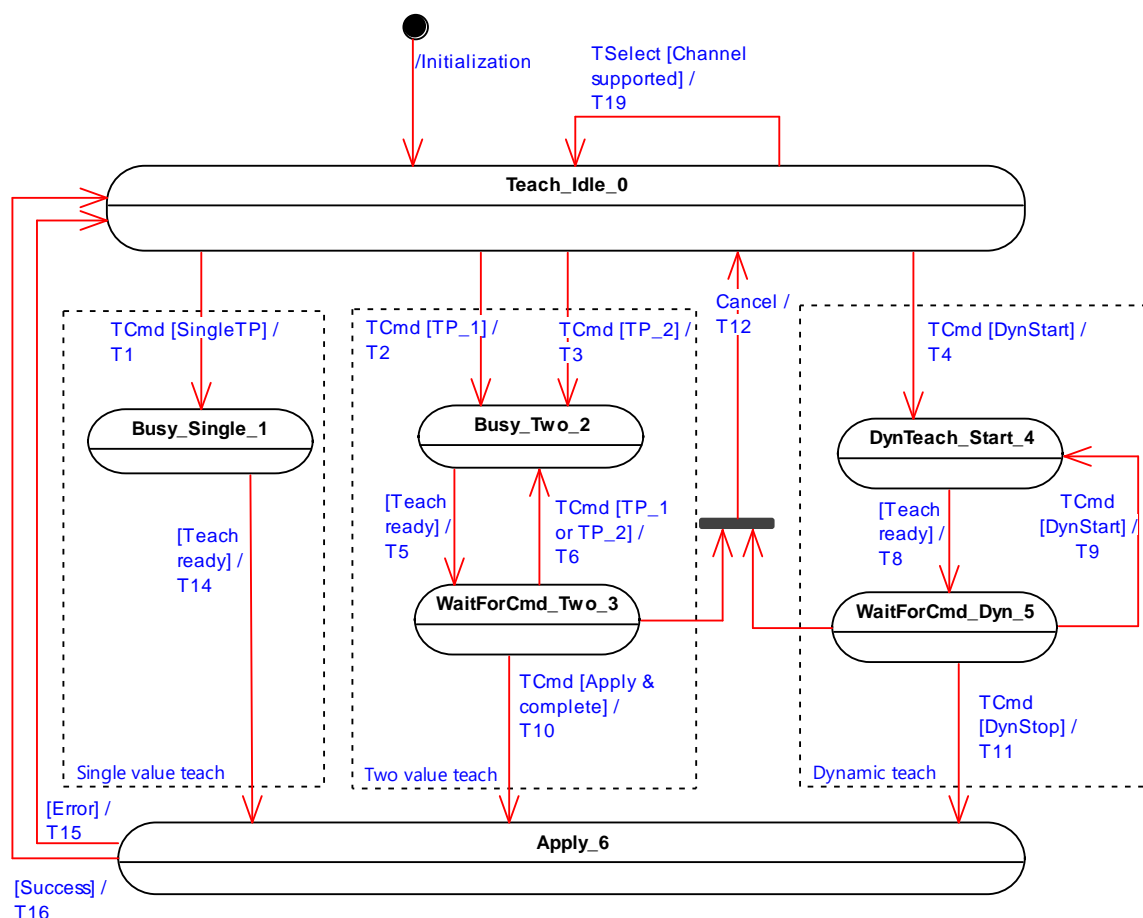

795

796

Figure B.1– Common state machine for all three teach subsets

797

Table B.5 shows the state transition tables for the three teach subsets.

798

Table B.5 – State transition tables for all three teach subsets

STATE NAME	STATE DESCRIPTION
Teach_Idle_0	In this state the Device is waiting for a teach command ("TCmd") or selection of a new teach channel. The Device operates with the last valid Setpoint settings.
Busy_Single_1	In this state the acquisition of internal values takes place. The Device leaves this state via transition T14 when the teach procedure has been accomplished. The reported TeachState is "BUSY".
Busy_Two_2	In this state the acquisition of internal values for Two Value teach actions take place according to the requested Teachpoint (as example see Figure A.9). The Device leaves this state via transition T5 when the teach procedure has been accomplished and the Device is ready to accept a new command. The reported TeachState is "BUSY".
WaitForCmd_Two_3	In this state the Device is waiting for a new two point value Teach command. Any SystemCommand not targeting the current Teach- or Setpoint shall be rejected, see B.5.4.2. The reported TeachState is "WAIT FOR COMMAND".
DynTeach_Start_4	In this state the continuous acquisition of internal values is started. The Device leaves this state via transition T8 when the teach procedure has been successfully started. The reported TeachState is "BUSY".

STATE NAME		STATE DESCRIPTION	
WaitForCmd_Dyn_5		In this state the Device is acquiring the dynamic internal values until reception of the Teach Stop command. Any SystemCommand not targeting the current Teach- or Setpoint shall be rejected, see B.5.4.2. The reported TeachState is "WAIT FOR COMMAND".	
Apply_6		In this state the setpoint values are calculated and validated according to the performed teach function. The reported TeachState is "BUSY".	
TRANSITION	SOURCE STATE	TARGET STATE	ACTION
Initialization	–	0	Reset the TeachFlags and set TeachState to IDLE.
T1	0	1	Set SP_Select to requested SP and reset TeachFlags of the requested SP.
T2	0	2	Set SP_Select to requested SP and reset TeachFlags of the requested SP.
T3	0	2	Set SP_Select to requested SP and reset TeachFlags of the requested SP.
T4	0	4	Set SP_Select to requested SP and reset TeachFlags of the requested SP.
T5	2	3	Update the TeachFlags for the acquired combination of Teachpoint and SP_Select.
T6	3	2	No action
T8	4	5	No action
T9	5	4	Discard already acquired dynamic teach results.
T10	3	6	No action
T11	5	6	No action
T12	3, 5	0	Reset the TeachFlags of the requested SP. Set TeachState according to the performed successful teaches since Power-Up or channel switch, indicating SP1_SUCCESS, SP2_SUCCESS, or SP12_SUCCESS, see Table D.11.
T14	1	6	No action
T15	6	0	Set SP_Select to none and TeachState to "ERROR".
T16	6	0	The calculated setpoint value is stored in non-volatile memory. Set SP_Select to none. Set TeachState according to the performed successful teaches since Power-Up or channel switch, indicating SP1_SUCCESS, SP2_SUCCESS, or SP12_SUCCESS, see Table D.11.
T19	0	0	Select Channel to perform following actions on requested channel. Reset the TeachFlags, set SP_Select to none, and TeachState to IDLE.
INTERNAL ITEMS		TYPE	DEFINITION
TCmd		Service	Reception of ISDU with SystemCommand containing one of the Teach commands defined in Table D.3
TSelect		Service	Reception of ISDU accessing the index TeachSelect
Teach ready		Label	Requested teach action has been completed
SP_Select		Variable	Selected SetPoint
SingleTP		Label	Teach command "Teach SPn" if supported
TP_1		Label	Teach command "Teach SPn TP1"
TP_2		Label	Teach command "Teach SPn TP2"
complete		Bool	TeachFlags TP1 and TP2 of selected Setpoint are both set
DynStart		Label	Teach command "Teach SPn Start"
DynStop		Label	Teach command "Teach SPn Stop"
Cancel		Label	Reception of Teach Command "Teach Cancel" or TeachSelect with valid channel number

B.5.5 Proxy Function Block

A corresponding Proxy Function Block is specified in E.2 and E.3.


B.6 Measurement Data Channel – [0x800A, 0x800B, 0x800E]**B.6.1 General**

The FunctionClass Measurement Data Channel provides a standardized Process data structure and some additional information how to interpret the transmitted data like physical unit or measurement limits.

B.6.2 Value range definitions

The value range of the defined data structures is split into several areas and substitute values such that PLC programmer can easily detect any specific fault or warning state. This allows reusing the special handling for these states within a PLC program. For measuring sensors the areas and value ranges are fix for the defined data types. Three substitute values are defined for each of the existing data types. The substitute values shall be assigned to the Process Data once the according condition occurs.

Figure B.2 shows the basic Process Data range including limit/substitute values and out-of-range areas which are defined in Table B.8 and Table B.9.

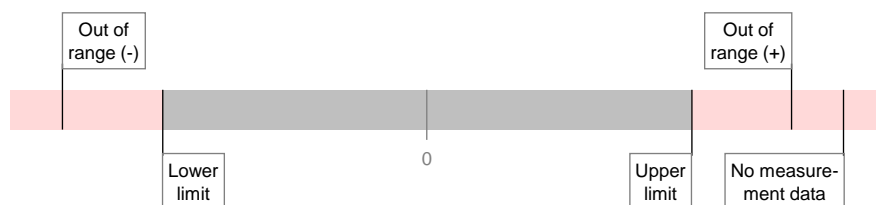

Key: ■ Permitted Process Data (PD) values, ■ Not permitted values, □ Substitute values


Figure B.2 – Basic Process Data ranges and limits

Table B.6 provides the definitions of the items in Figure B.2.

Table B.6 – Basic Process Data definitions

Item	Definition	Remark
Out of Range (-)	Substitute PD value reserved to indicate that the observed measurement is outside of the detection range in the lower direction.	See Figure B.3
Out of Range (+)	Substitute PD value reserved to indicate that the observed measurement is outside of the detection range in the upper direction.	See Figure B.3
No measurement data	Substitute PD value reserved to indicate that there is no measurement data for any unspecified reason.	
Permitted PD values	The Process Data can take any value between the Lower and Upper limit including these limit values. However, it is within the responsibility of the vendors to define the detection range within the lower and upper limits. Additionally, the Process Data can provide any of the substitute values if required as specified before.	See Table B.7
Not permitted PD values	The Process Data cannot provide any value lower than the lower limit or higher than the upper limit with the exception of the substitute values.	See Table B.7

Figure B.3 shows the definition of ranges for the possible process data values including measurement range, not permitted areas, and substitute values.

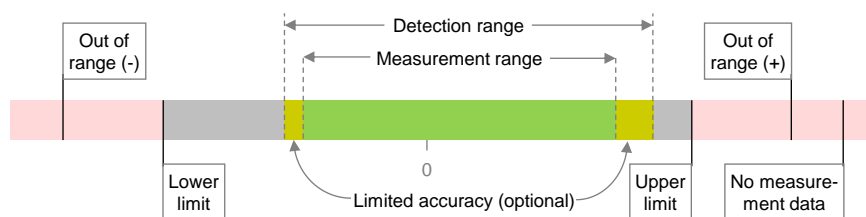

Key: ■ Permitted Process Data (PD) values, ■ Not permitted values, □ Substitute values

Figure B.3 – Definition of ranges for the process data

Table B.7 provides the definitions of the items in Figure B.3.

Table B.7 – Range definitions

Item	Definition
Detection range	The detection range defines the values in which the sensor can provide a measurement value as an output in the Process Data. This range consists of the measurement range, and optionally the limited accuracy range. The detection range shall be determined by the vendors. In any case, it is limited by the Lower and Upper limits.
Measurement range	The vendors of measuring Devices shall define the measurement range. This is that part of the detection range of the sensor, where accuracy is guaranteed.
Limited accuracy range	The vendors of measuring Devices may optionally define limited accuracy ranges. These are parts of the detection range of the sensor, where the stated accuracy cannot be achieved. These ranges can be defined and used in case the vendor considers it useful to nevertheless provide a measurement value under this condition.

The permissible range of Process Data (PD) values for the detection range is shown in Table B.8.

Table B.8 – Permissible values for the detection range

Item	FunctionClass		
	0x800A	0x800B	0x800E
Data type	IntegerT(16)	IntegerT(32)	Float32T
Lower limit	-32000	-2147482880	-1.7014118E38
	0x8300	0x80000300	0xFF000000
Upper limit	32000	2147482880	1.7014118E38
	0x7D00	0x7FFFFD00	0x7F000000

B.6.3 Substitute values

Special values – so-called substitute values – are fixed in the Process Data of the measuring sensors profile for each specified data structure. These are:

- Out of Range (-)
- Out of Range (+)
- No measurement data

The corresponding values are shown in Table B.9.

Table B.9 – Fixed special values (substitutes)

Item	FunctionClass				
	0x800A	0x800B	0x800E		
Data type	IntegerT(16)	IntegerT(32)	Float32T a)	Float32T b)	
Out of Range (-)	-32760	-2147483640	-2.65E38	-2.764794E38	-2.5521178E38
	0x8008	0x80000008	–	0xFF4FFFFFFF	0xFF400000
Out of Range (+)	32760	2147483640	2.65E38	2.5521178E38	2.764794E38
	0x7FF8	0x7FFFFFFF8	–	0x7F400000	0x7F4FFFFFFF
No measurement data	32764	2147483644	3.3E38	3.1901472E38	3.4028235E38
	0x7FFC	0x7FFFFFFFC	–	0x7F700000	0x7F7FFFFFFF
Notes: The float values NaN, -Infinity, and +Infinity are not allowed as values in the process data channel. a) Recommended values for transmission b) Value range for testing limit/substitute values					

B.6.4 Process Data value scale [0x800A, 0x800B]

The function block has no links to the IODD. Thus, the information about the necessary gradient is not available. To enable an automated conversion of the fixed-point value into floating values by a function block, a scale information is provided accompanying the fixed-point value.

This scale number is fixed for a particular Device but may vary if several different Devices are measuring the same physical quantity. In any case, the process data value scale defined in C.4 and C.6 shall contain the same content as provided by MDC.Scale defined in D.6.1.

This scale information shall not be referenced in ProcessDataRefCollection to suppress the visibility of the static value.

For tools using the IODD the described gradient and offset shall be used as usual. The intended use for Scale is in context with function blocks defined in E.4 or user specific programs.

B.6.5 Validity rule definitions

For each of the ranges, areas, and substitute values shown in Figure B.2 the following rules apply:

- The Process Data (PD) in the measuring Devices profile is generally used to directly transmit the measurement of the sensor or to signalize exceptionally "out of range" or "no measurement data".
- Whenever the measurement is within the detection range, the Process Data represents the corresponding value, the Scale information can be used for calculating the floating point representation of the process value when needed.
- Whenever the measurement is outside the detection range, the value of the Process Data will be either the substitute value "Out of Range (+)" or "Out of Range (-)" respectively.
- Whenever the measurement cannot be performed for any reason, the Process Data will provide the substitute value of "No measurement data".
- PDInvalid shall only be set when the Device is no longer able to detect even the "No measurement data" state, for example when detecting an internal fault, see [7].

B.6.6 Example

Figure B.4 shows the example of a distance measurement Device and its detailed ranges.

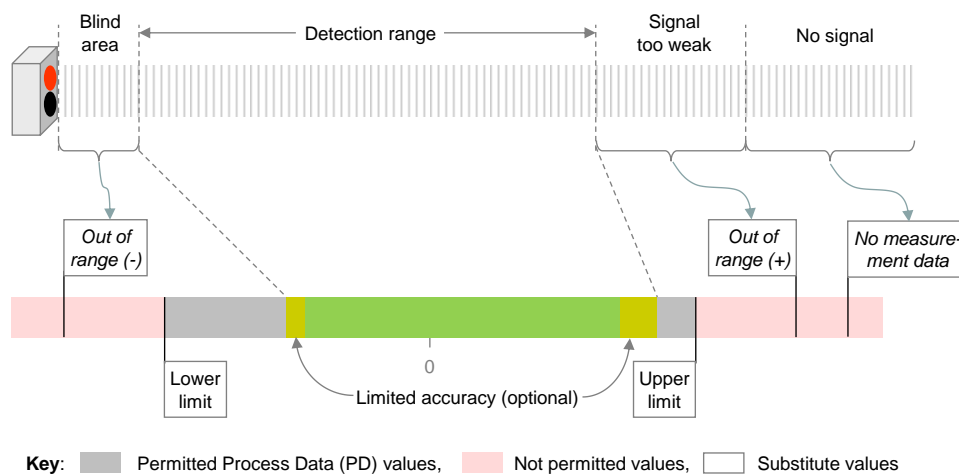


Figure B.4 – Example of a distance measurement Device

B.6.7 Units

The measuring Device profile uses a subset of the definitions in [2]. The focus is on using the same physical units for the same physical quantity measured by different sensors. Table B.10 shows the current physical unit definitions for some physical quantities.

The unit is fixed for a particular measurement data channel of a Device.

As new developments require the representation of additional physical quantities which are not covered by Table B.10, the manufacturer shall consider the existence of an updated table available at www.io-link.com. If the table does not cover the required physical quantity, the manufacturer shall issue a change request to the community to achieve the required physical unit definition.

Table B.10 – Physical units and preferred data types

Quantity	Unit (SI)	Unit Code	Preferred data type
Temperature ^{a)}	°C	1001	IntegerT(16)
Inclination / angle ^{b)}	°	1005	IntegerT(16)
Distance	m	1010	–
Volume	m ³	1034	IntegerT(32)
Velocity	m/s	1061	–
Acceleration	m/s ²	1076	–
Frequency	Hz	1077	–
Rotation	rpm	1085	–
Weight	kg	1088	IntegerT(16)
Force	N	1120	IntegerT(16)
Torque	N·m	1126	IntegerT(16)
Pressure	Pa	1130	IntegerT(16)
Viscosity	cSt	1164	IntegerT(16)
Power	W	1186	IntegerT(16)
Current	A	1209	IntegerT(16)

Quantity	Unit (SI)	Unit Code	Preferred data type
Voltage	V	1240	IntegerT(16)
Conductivity	S/m	1299	–
Mass flow	kg/s	1322	IntegerT(16)
Percentage	%	1342	IntegerT(16)
Volume flow	m ³ /h	1349	IntegerT(16)
Attenuation	dB	1383	IntegerT(16)
Acidity	pH	1422	IntegerT(16)
Mass fraction	ppm	1423	IntegerT(16)
Byte rate	B/s	1675	–
Bit rate	bit/s	1684	–
decibel	dBm	1689	IntegerT(16)
Turn rate	°/s	1691	IntegerT(16)
Turn acceleration	°/s ²	1692	IntegerT(16)
Data quantity	bit	1694	IntegerT(16)
n/a	"none"	1997	–
Further combinations will be defined in the future			
NOTE a) °C is accepted as SI unit instead of Kelvin b) ° is accepted as SI unit instead of rad			

The units "none" and percentage are preferably used only when no other unit is applicable. "None" and percentage do not allow to use different sensors like when they refer to physical quantities. An appropriate hint shall be maintained to the customer.

B.6.8 Multiple physical sensing elements

The measuring data channel can be used for multiple physical sensor channels.

The mapping to the SDCI parameters and the mapping of the process data content are defined in the associated SDCI artifacts of the specific profile type, see Table 16.

Using multiple sensor channels, the preferred data types according Table B.10 cannot be applied when combining quantities with different preferred data types.

B.6.9 Proxy Function Block

A corresponding Proxy Function Block for the FunctionClasses 0x800A and 0x800B is specified in E.4.

B.7 Sensor Control, Sensor Control Wide – [0x800C, 0x800F]

B.7.1 General

The Control Signal Channel can be used to turn off the sensor channel. Several use cases can be covered with this functionality like :

- Avoidance of mutual interference of neighbouring sensors
- Eye protection by turning off laser beams of e.g. photo electrical sensors
- Power savings (general purpose)
- Extension of life time

As this specification does not cover safety aspects, this functionality also does not cover safety aspects.

The distinction between the FunctionClasses Sensor Control and Sensor Control Wide lies in the process data width, not in the functionality. The FunctionClasses Sensor Control and Sensor Control Wide shall not be combined.

B.7.2 Validity considerations

By default, the sensor channel is always enabled. By setting the corresponding CSC to TRUE the sensor element can be disabled.

As long as the Process Data output validity is not set to the valid state by the Master sending the MasterCommand ProcessDataOutputOperate, the sensor channel cannot be disabled.

The resulting behavior of the control state based on the process data validity and control signal is defined in Table B.11.

Table B.11 – Conversion table from control signal to disable state

PD Validity	Control signal	
	"1"	"0"
Valid	Disable	Enable
Invalid	Enable	Enable

If the sensor channel is turned off, the ProcessData shall provide "No measurement data" and an inactive switching state while the ProcessData is marked as valid.

B.7.3 Multiple physical sensing elements

The control signal channels can be used for multiple physical sensor channels.

The mapping to the process data content is defined in the associated SDCI artifacts of the specific profile type as defined in Table 5, Table 6, Table 8, Table 13, Table 16 and their associated extensions.

B.8 Switching schemes – [0x8013, 0x8014]

B.8.1 Overview

The following clauses define switching rules which are compatible to the Switching Signal Channel and may be used as an extension of the switching FunctionClasses Fixed Switching Signal Channel 0x8005, Adjustable Switching Signal Channel 0x8006, or Multiple Adjustable Switching Signal Channel 0x800D.

The FunctionClasses shall not be used without any FunctionClass containing a Switching Signal Channel. The FunctionClasses Object detection and Quantity detection shall not be combined.

Without one of the extensions, the switching scheme is not predefined and shall be defined by the manufacturer.

The guiding rules for the extensions are defined below

- The numerical relation between SP1 and SP2 is not specified, although the behavior is defined
- The correlation between SP1 or SP2 shall never lead to a rejection of the parameters as long as the allowed range, respecting the hysteresis at the limits, is not violated
- The switching behavior is strictly defined and reproduced by any Device following this extension
- The switch occurs always at the configured or taught setpoint
- The hysteresis is always in the inactive area of the measurement or detection range

- The power-up behavior with a detection or measurement value within the hysteresis range results in an inactive state
- The behavior defined by the extension applies to all Switching Signal Channels of the Device

B.8.2 Object detection

The quiescent state of sensors for object detection (e.g. optical proximity sensors or ultrasonic sensors) is a measurement value of "infinite". An approaching object will cause the switching state of the sensor to change at the setpoint (detection value). The departing object will cause the switching state of the sensor to switch back at a larger detection value than the setpoint.

B.8.2.1 Single Point Mode

The behavior of the SSC for object detection in Single Point mode is shown in Figure B.5.

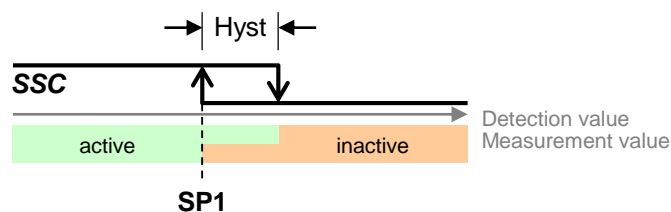


Figure B.5 – Object detection in Single Point Mode

The Setpoint SP2 is not relevant in this mode.

B.8.2.2 Window Mode

The behavior of the SSC for object detection in Window mode is shown in Figure B.6.

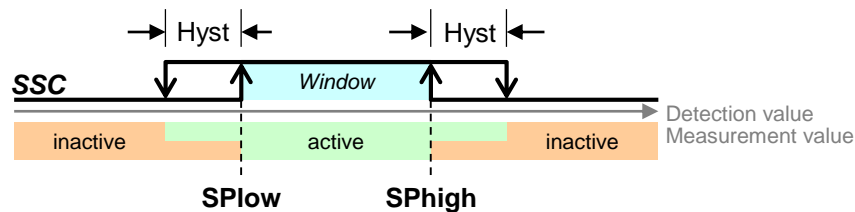


Figure B.6 – Object detection in Window Mode

The assignment of the setpoint SPlow and SPhigh to the setpoint parameters SP1 and SP2 are defined in Table B.12.

Table B.12 – Assignment of SP1 and SP2

Setpoints	Parameter values
SPlow	Smaller of [SP1, SP2]
SPhigh	Greater of [SP1, SP2]

B.8.2.3 Two Point Mode

The behavior of the SSC for object detection in Two Point mode is shown in Figure B.7.

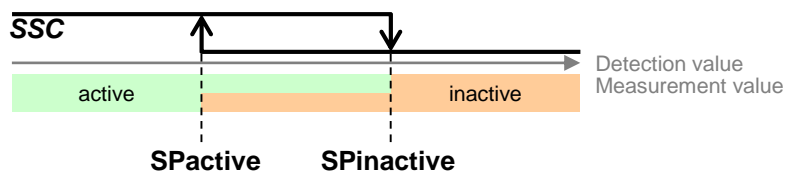


Figure B.7 – Object detection in Two Point Mode

The parameter Hyst is not relevant in this mode.

The assignment of the setpoint SPactive and SPinactive to the setpoint parameters SP1 and SP2 are defined in Table B.13.

Table B.13 – Assignment of SP1 and SP2

Setpoints	Parameter values
SPactive	Smaller of [SP1, SP2]
SPinactive	Greater of [SP1, SP2]

B.8.3 Quantity detection

The quiescent state of sensors for quantity detection (e.g. pressure or temperature sensors) is a measurement value of "zero". An increasing measurement value will cause the switching state of the sensor to change at the setpoint value. A decreasing measurement value will cause the switching state of the sensor to switch back at a smaller measurement value than the setpoint value.

B.8.3.1 Single Point Mode

The behavior of the SSC for quantity detection in Single Point mode is shown in Figure B.8.

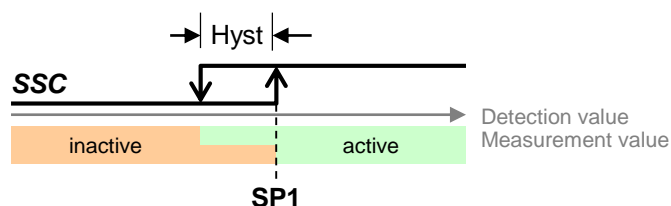


Figure B.8 – Quantity detection in Single Point Mode

The Setpoint SP2 is not relevant in this mode.

B.8.3.2 Window Mode

The behavior of the SSC for quantity detection in Window mode is shown in Figure B.9.

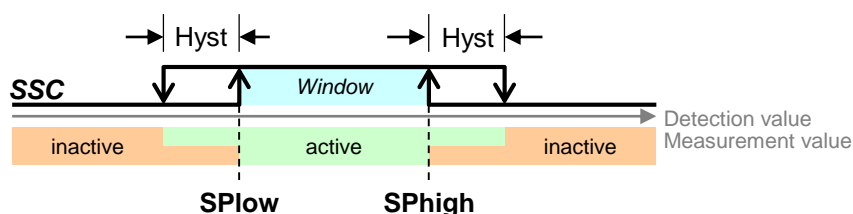


Figure B.9 – Quantity detection in Window Mode

The assignment of the setpoint SP_{low} and SP_{high} to the setpoint parameters SP1 and SP2 are defined in Table B.14.

Table B.14 – Assignment of SP1 and SP2

Setpoints	Parameter values
SP _{low}	Smaller of [SP1, SP2]
SP _{high}	Greater of [SP1, SP2]

B.8.3.3 Two Point Mode

The behavior of the SSC for quantity detection in Two Point mode is shown in Figure B.10.

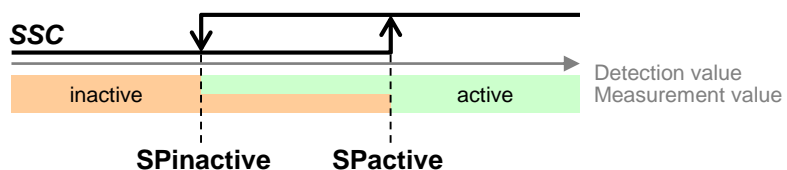


Figure B.10 – Quantity detection in Two Point Mode

The parameter Hyst is not relevant in this mode.

The assignment of the setpoint SP_{active} and SP_{inactive} to the setpoint parameters SP1 and SP2 are defined in Table B.15.

Table B.15 – Assignment of SP1 and SP2

Setpoints	Parameter values
SP _{active}	Greater of [SP1, SP2]
SP _{inactive}	Smaller of [SP1, SP2]

Annex C (normative)

Process Data (PD) structures

C.1 Overview

The Smart Sensor Profile defines standardized Process Data structures to ease the use of the Devices following this profile.

The ProfileID specification defines the structure which shall be used in conjunction with the profile type, see Table 4, Table 7, Table 12, Table 15 and their associated extensions.

Some parts of the predefined process data structure allows the vendor to insert specific data without violating the required process data layout. This vendor specific data is not part of this specification and may consist of several items but shall be compliant to the defined length, Subindex, and offset definitions.

To reduce the description complexity of combined process data in PDInputDescriptor or PDOOutputDescriptor the layouts are identified by their own DataType coding according A.3 in [7]. The related DataType codings are defined for each process data layout and it is mandatory to use them in the PDInput- or PDOOutputDescriptor. The vendor specific parts of the process data may be used by any data described by the vendor.

C.2 PDI8.BOOL1

Figure C.1 shows the Process Data input structure for Switching Signal Channels. This structure can be filled by vendor specific data at a maximum length of 8 bits.

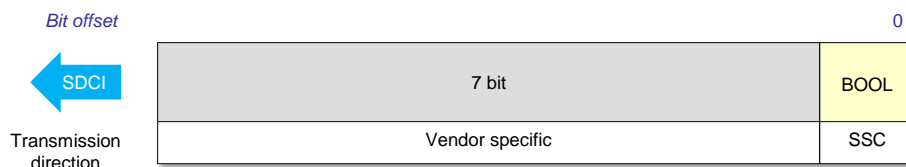


Figure C.1 – 8 bit Process Data input structure with SSC

The coding is defined in Annex F.2.2 ("packed form") in [1] and in Table C.1.

Table C.1 – Coding of Process Data input (PDI8.BOOL1)

Item	Subindex	Offset	Function	Type
Vendor specific	> 1	> 0	Vendor specific	
SSC	1	0	Switching signal	BooleanT

NOTE : While the Device is used in SIO the physical output on C/Q may represent the activity state of the switching signal SSC. The behavior of the sensor in SIO mode is not scope of this standard.

Table C.2 defines the profiled content of the PDInputDescriptor for PDI8.BOOL1

Table C.2 – PVI8D for PDI8.BOOL1 process data

DataType	TypeLength	Offset
SetOfBool : 1	1	0
Note: see B.5 in [7] for ordering rules		

C.3 PDI8.BOOL2

Figure C.1 shows the Process Data input structure with dual Switching Signal Channels. This structure can be filled by vendor specific data at a maximum length of 8 bits.

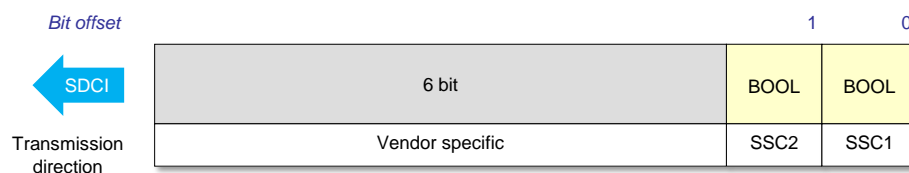


Figure C.2 – 8 bit Process Data input structure with dual SSC

The coding is defined in Annex F.2.2 ("packed form") in [1] and in Table C.3.

Table C.3 – Coding of Process Data input (PDI8.BOOL2)

Item	Subindex	Offset	Function	Type
Vendor specific	> 2	> 1	Vendor specific	
SSC2	2	1	Switching Signal	BooleanT
SSC1	1	0	Switching Signal	BooleanT

NOTE : While the Device is used in SIO the physical output on C/Q may represent the activity state of the switching signal SSC1. The behavior of the sensor in SIO mode is not scope of this standard.

Table C.4 defines the profiled content of the PDInputDescriptor for PDI8.BOOL2

Table C.4 – PVinD for PDI8.BOOL2 process data

DataType	TypeLength	Offset
SetOfBool : 1	2	0
Note: see B.5 in [7] for ordering rules		

C.4 MDC specific process data records

This clause defines the process data layouts for the Measurement Data Channel.

C.4.1 PDI32.INT16_INT8

Figure C.3 shows the Process Data input structure for Digital Measuring Sensors. This structure contains the measurement value, a scale information and additional information, which can be filled by vendor specific data or defined in a later profile description.

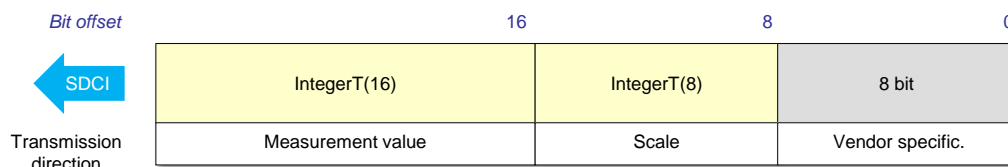


Figure C.3 – 32 bit Process Data input structure

The coding is defined in Table C.5.

Table C.5 – Coding of Process Data input (PDI32.INT16_INT8)

Item		Sub-index	Offset	Function	Type	Definition
MDC32	Measurement value	1	16	Process Data	IntegerT(16)	See B.6.2
	Scale	2	8	Range shifting (10 ^{scale})	IntegerT(8)	–
Vendor specific		> 2	0 to 7	Vendor specific		

According to the general profile rules in A.3 in [7], the process data structure shall be described in the parameter PDInputDescriptor. To avoid complex descriptions of each structure element the coding for the MDC32 based process data structures is defined as shown in Table C.6.

Table C.6 – DataType coding of MSDC32 process data structures

PD Structure	DataType coding	TypeLength
MDC32	128	32 Bit

Table C.7 defines the profiled content of the PDInputDescriptor for PDI8.BOOL2

Table C.7 – PVinD for PDI32.INT16_INT8 process data

DataType	TypeLength	Offset
MDC32 : 128	32	0
Note: see B.5 in [7] for ordering rules		

C.4.2 PDI48.INT32_INT8

Figure C.4 shows the Process Data input structure for Digital Measuring Sensors with high resolution. This structure contains the measurement value, a scale information and additional information, which can be filled by vendor specific data or defined in a later profile description.

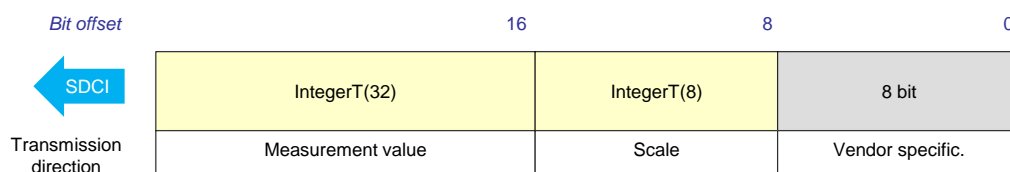


Figure C.4 – 48 bit Process Data input structure

The coding is defined in Table C.8.

Table C.8 – Coding of Process Data input (PDI48.INT32_INT8)

Item		Sub-index	Offset	Function	Type	Definition
MDC	Measurement value	1	16	Process Data	IntegerT(32)	See B.6.2
	Scale	2	8	Range shifting (10 ^{scale})	IntegerT(8)	–
Vendor specific		> 2	0 to 7	Vendor specific		

According to the general profile rules in A.3 in [7], the process data structure shall be described in the parameter PDInputDescriptor. To avoid complex descriptions of each structure element the coding for the MDC48 based process data structures is defined as shown in Table C.6.

Table C.9 – DataType coding of MSDC32 process data structures

PD Structure	DataType coding	TypeLength
MDC48	129	48 Bit

Table C.10 defines the profiled content of the PDInputDescriptor for PDI48.INT32_INT8

Table C.10 – PVinD for PDI48.INT32_INT8 process data

DataType	TypeLength	Offset
MDC48 : 129	48	0
Note: see B.5 in [7] for ordering rules		

C.5 CSC specific process data records

This clause defines the process data layout for different variations of Control Signal Channel.

C.5.1 PDO8.BOOL1

Figure C.5 shows the Process Data output structure with one Control Signal Channel. This structure can be filled by vendor specific data at a maximum length of 8 bits.

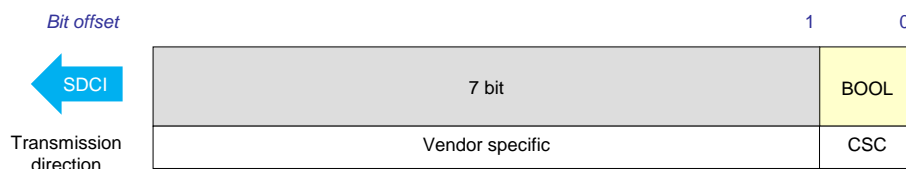


Figure C.5 – 8 bit Process Data output structure with CSC

The coding is defined in Table C.11.

Table C.11 – Coding of Process Data output (PDO8.BOOL1)

Item	Subindex	Offset	Function	Type
Vendor specific	> 1	> 0	Vendor specific	
CSC	1	0	Control signal	BooleanT

Table C.12 defines the profiled content of the PDOOutputDescriptor for PDO8.BOOL1

Table C.12 – PVoutD for PDO8.BOOL1 process data

DataType	TypeLength	Offset
SetOfBool : 1	1	0
Note: see B.5 in [7] for ordering rules		

C.5.2 PDO8.BOOL2

Figure C.6 shows the Process Data output structure with two Control Signal Channels. This structure can be filled by vendor specific data at a maximum length of 8 bits.

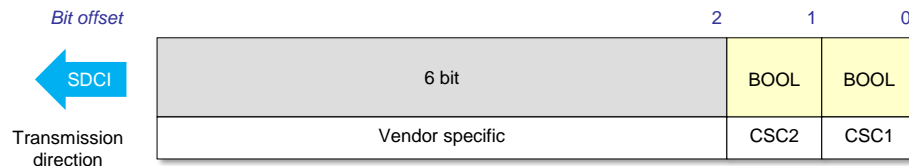


Figure C.6 – 8 bit Process Data output structure with dual CSC

The coding is defined in Table C.13.

Table C.13 – Coding of Process Data output (PDO8.BOOL2)

Item	Subindex	Offset	Function	Type
Vendor specific	> 2	> 1	Vendor specific	
CSC2	2	1	Control signal	BooleanT
CSC1	1	0	Control signal	BooleanT

Table C.14 defines the profiled content of the PDOOutputDescriptor for PDO8.BOOL2

Table C.14 – PVoutD for PDO8.BOOL2 process data

DataType	TypeLength	Offset
SetOfBool : 1	2	0
Note: see B.5 in [7] for ordering rules		

C.5.3 PDO8.BOOL3

Figure C.7 shows the Process Data output structure with three Control Signal Channels. This structure can be filled by vendor specific data at a maximum length of 8 bits.

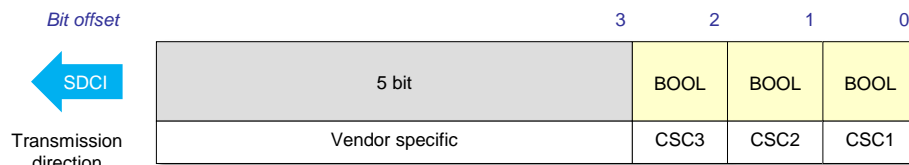


Figure C.7 – 8 bit Process Data output structure with triple CSC

The coding is defined in Table C.15.

Table C.15 – Coding of Process Data output (PDO8.BOOL3)

Item	Subindex	Offset	Function	Type
Vendor specific	> 3	> 2	Vendor specific	
CSC3	3	2	Control signal	BooleanT
CSC2	2	1	Control signal	BooleanT
CSC1	1	0	Control signal	BooleanT

Table C.16 defines the profiled content of the PDOOutputDescriptor for PDI8.BOOL3

Table C.16 – PVoutD for PDO8.BOOL3 process data

DataType	TypeLength	Offset
SetOfBool : 1	3	0
Note: see B.5 in [7] for ordering rules		

C.5.4 PDO8.BOOL4

Figure C.8 shows the Process Data output structure with four Control Signal Channels. This structure can be filled by vendor specific data at a maximum length of 8 bits.

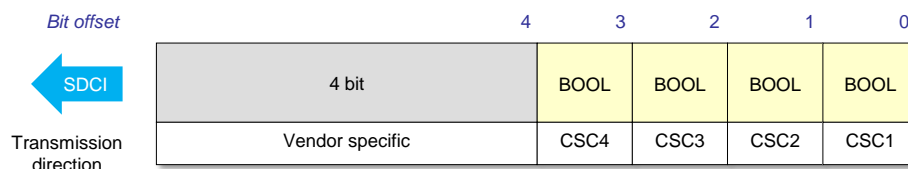


Figure C.8 – 8 bit Process Data output structure with quad CSC

The coding is defined in Table C.17.

Table C.17 – Coding of Process Data output (PDO8.BOOL4)

Item	Subindex	Offset	Function	Type
Vendor specific	> 4	> 3	Vendor specific	
CSC4	4	3	Control signal	BooleanT
CSC3	3	2	Control signal	BooleanT
CSC2	2	1	Control signal	BooleanT
CSC1	1	0	Control signal	BooleanT

Table C.18 defines the profiled content of the PDOOutputDescriptor for PDO8.BOOL4

Table C.18 – PVoutD for PDO8.BOOL4 process data

DataType	TypeLength	Offset
SetOfBool : 1	4	0
Note: see B.5 in [7] for ordering rules		

C.5.5 PDO16.BOOL1

Figure C.9 shows the Process Data output structure with one Control Signal Channel. This structure can be filled by vendor specific data at a maximum length of 16 bits.

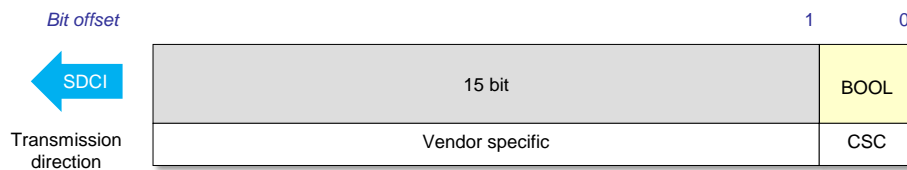


Figure C.9 – 16 bit Process Data output structure with CSC

The coding is defined in Table C.19.

Table C.19 – Coding of Process Data output (PDO16.BOOL1)

Item	Subindex	Offset	Function	Type
Vendor specific	> 1	> 0	Vendor specific	
CSC	1	0	Control signal	BooleanT

Table C.20 defines the profiled content of the PDOOutputDescriptor for PDO16.BOOL1

Table C.20 – PVoutD for PDO16.BOOL1 process data

DataType	TypeLength	Offset
SetOfBool : 1	1	0
Note: see B.5 in [7] for ordering rules		

C.5.6 PDO16.BOOL2

Figure C.10 shows the Process Data output structure with two Control Signal Channels. This structure can be filled by vendor specific data at a maximum length of 16 bits.

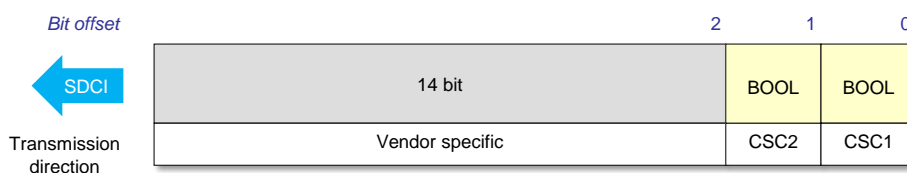


Figure C.10 – 16 bit Process Data output structure with dual CSC

The coding is defined in Table C.21.

Table C.21 – Coding of Process Data output (PDO16.BOOL2)

Item	Subindex	Offset	Function	Type
Vendor specific	> 2	> 1	Vendor specific	
CSC2	2	1	Control signal	BooleanT
CSC1	1	0	Control signal	BooleanT

Table C.22 defines the profiled content of the PDOOutputDescriptor for PDO16.BOOL2

Table C.22 – PVoutD for PDO16.BOOL2 process data

DataType	TypeLength	Offset
SetOfBool : 1	2	0
Note: see B.5 in [7] for ordering rules		

C.5.7 PDO16.BOOL3

Figure C.11 shows the Process Data output structure with three Control Signal Channels. This structure can be filled by vendor specific data at a maximum length of 16 bits.

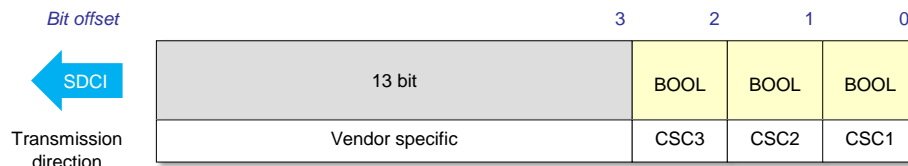


Figure C.11 – 16 bit Process Data output structure with triple CSC

The coding is defined in Table C.23.

Table C.23 – Coding of Process Data output (PDO16.BOOL3)

Item	Subindex	Offset	Function	Type
Vendor specific	> 3	> 2	Vendor specific	
CSC3	3	2	Control signal	BooleanT
CSC2	2	1	Control signal	BooleanT
CSC1	1	0	Control signal	BooleanT

Table C.24 defines the profiled content of the PDOOutputDescriptor for PDI16.BOOL3

Table C.24 – PVoutD for PDO16.BOOL3 process data

DataType	TypeLength	Offset
SetOfBool : 1	3	0

Note: see B.5 in [7] for ordering rules

C.5.8 PDO16.BOOL4

Figure C.12 shows the Process Data output structure with four Control Signal Channels. This structure can be filled by vendor specific data at a maximum length of 16 bits.

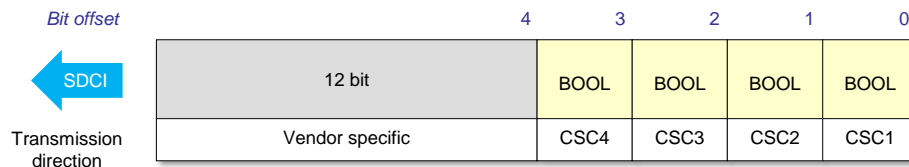


Figure C.12 – 16 bit Process Data output structure with quad CSC

The coding is defined in Table C.25.

Table C.25 – Coding of Process Data output (PDO16.BOOL4)

Item	Subindex	Offset	Function	Type
Vendor specific	> 4	> 3	Vendor specific	
CSC4	4	3	Control signal	BooleanT
CSC3	3	2	Control signal	BooleanT
CSC2	2	1	Control signal	BooleanT
CSC1	1	0	Control signal	BooleanT

Table C.26 defines the profiled content of the PDOOutputDescriptor for PDO16.BOOL4

Table C.26 – PVoutD for PDO16.BOOL4 process data

DataType	TypeLength	Offset
SetOfBool : 1	4	0
Note: see B.5 in [7] for ordering rules		

C.6 MSDC specific process data records

This clause defines the process data layout for the Measurement and Switching Data Channel based on the core definition for one sensor channel. The concatenation of the process data structure allows to support multiple sensor channels, the assignment of the base Subindex and offset is defined for each concatenation.

C.6.1 MSDC32 general layout

Figure C.13 shows the base Process Data input structure for Digital Measuring and Adjustable Switching Sensors. This base structure is used for the following combinations for one or more physical sensor channels.

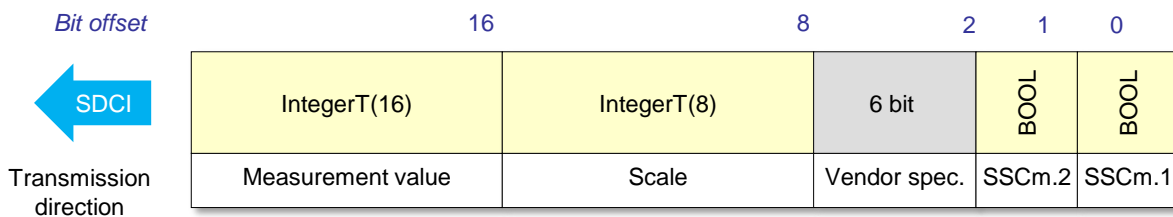


Figure C.13 – 32 bit process data MSDC32

The coding is defined in Table C.27 and contains vendor specific data. As this is the base definition, only the base offsets for Subindex and offset are defined. For each sensor channel the bases for Subindex and offset are defined in the following descriptions. The enumeration "m" at the items MDCm and SSCm reflects the number of the corresponding sensor channel.

Table C.27 – Coding of Process Data input (MSDC32)

Item		Subindex	Offset	Function	Type	Definition
MDCm	Measurement value	+ 1	+ 16	Fix point value	IntegerT(16)	See B.6.2
	Scale	+ 2	+ 8	Range shifting (10 ^{scale})	IntegerT(8)	See B.6.4
Vendor specific		+ (5 to 10)	+ (2 to 7)	Vendor specific		
SSCm.2		+ 4	+ 1	Switching Signal	BooleanT	
SSCm.1		+ 3	+ 0	Switching Signal	BooleanT	

According to the general profile rules in A.3 in [7], the process data structure shall be described in the parameter PDInputDescriptor. To avoid complex descriptions of each structure element the coding for the MSDC32 based process data structures is defined as shown in Table C.28

Table C.28 – DataType coding of MSDC32 process data structures

PD Structure	DataType coding	TypeLength
MSDC32	130	32 Bit

C.6.1.1 PDI32.MSDC32_1

Figure C.14 shows the Process Data input structure for a Measurement and Switching Data Channel with one sensor channel. The base structure is specified in C.6.1.

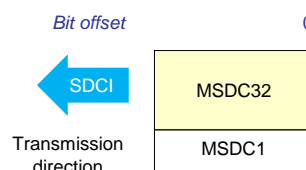


Figure C.14 – 32 bit Process Data structure with single MSDC32

The applicable offsets regarding Table C.27 are defined in Table C.29.

Table C.29 – Coding of Process Data input (PDI32.MSDC32_1)

Item	Subindex Base	Offset Base
MSDC1	0	0

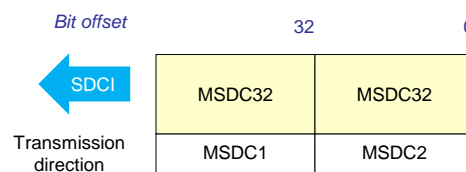
Table C.30 defines the profiled content of the PDInputDescriptor for PDI32.MSDC32_1

Table C.30 – PVIInD for PDI32.MSDC32_1 process data

Data Type	Type Length	Offset
MSDC32 : 130	32	0
Note: see B.5 in [7] for ordering rules		

C.6.1.2 PDI64.MSDC32_2

Figure C.15 shows the Process Data input structure for a Measurement and Switching Data Channel with two sensor channels. The base structure is specified in C.6.1.

**Figure C.15 – 64 bit Process Data input structure with dual MSDC32**

The applicable offsets regarding Table C.27 are defined in Table C.31.

Table C.31 – Coding of Process Data input (PDI32.MSDC32_2)

Item	Subindex Base	Offset Base
MSDC1	0	32
MSDC2	10	0

Table C.32 defines the profiled content of the PDInputDescriptor for PDI32.MSDC32_2

Table C.32 – PVIInD for PDI32.MSDC32_2 process data

Data Type	Type Length	Offset
MSDC32 : 130	32	0
MSDC32 : 130	32	32
Note: see B.5 in [7] for ordering rules		

C.6.1.3 PDI96.MSDC32_3

Figure C.16 shows the Process Data input structure for a Measurement and Switching Data Channel with three sensor channels. The base structure is specified in C.6.1.

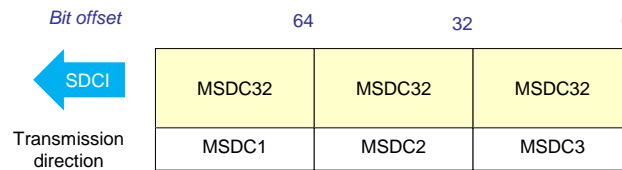


Figure C.16 – 96 bit Process Data input structure with triple MSDC32

The applicable offsets regarding Table C.27 are defined in Table C.33.

Table C.33 – Coding of Process Data input (PDI96.MSDC32_3)

Item	Subindex Base	Offset Base
MSDC1	0	64
MSDC2	10	32
MSDC3	20	0

Table C.34 defines the profiled content of the PDInputDescriptor for PDI96.MSDC32_3

Table C.34 – PVinD for PDI96.MSDC32_3 process data

DataType	TypeLength	Offset
MSDC32 : 130	32	0
MSDC32 : 130	32	32
MSDC32 : 130	32	64
Note: see B.5 in [7] for ordering rules		

C.6.1.4 PDI128.MSDC32_4

Figure C.17 shows the Process Data input structure for a Measurement and Switching Data Channel with four sensor channels. The base structure is specified in C.6.1.

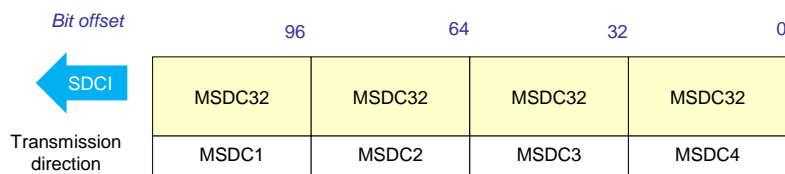


Figure C.17 – 128 bit Process Data input structure with quad MSDC32

The applicable offsets regarding Table C.27 are defined in Table C.35.

Table C.35 – Coding of Process Data input (PDI128.MSDC32_4)

Item	Subindex Base	Offset Base
MSDC1	0	96
MSDC2	10	64
MSDC3	20	32
MSDC4	30	0

Table C.36 defines the profiled content of the PDInputDescriptor for PDI128.MSDC32_4

Table C.36 – PVinD for PDI128.MSDC32_4 process data

Data Type	Type Length	Offset
MSDC32 : 130	32	0
MSDC32 : 130	32	32
MSDC32 : 130	32	64
MSDC32 : 130	32	96
Note: see B.5 in [7] for ordering rules		

C.6.2 MSDC48 general layout

Figure C.18 shows the base Process Data input structure for a Measurement and Switching Data Channel with high resolution. This base structure is used for the following combinations for one or more physical sensor channels.

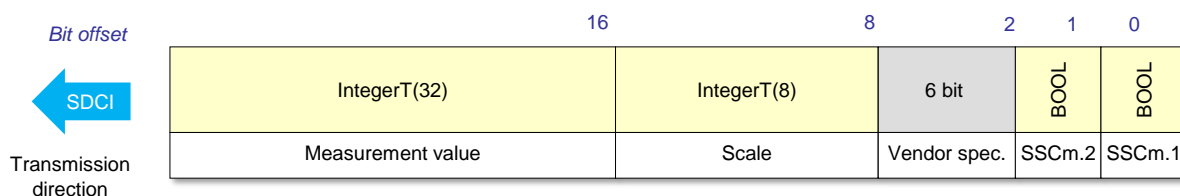


Figure C.18 – 48 bit process data MSDC48

The coding is defined in Table C.37 and contains vendor specific data. As this is the base definition, only the base offsets for Subindex and offset are defined. For each sensor channel the bases for Subindex and offset are defined in the following descriptions. The enumeration "m" at the items MDCm and SSCm defines the number of the corresponding sensor channel.

Table C.37 – Coding of Process Data input (MSDC48)

Item		Subindex	Offset	Function	Type	Definition
MDCm	Measurement value	+ 1	+ 16	Fix point value	IntegerT(32)	See B.6.2
	Scale	+ 2	+ 8	Range shifting (10 ^{scale})	IntegerT(8)	See B.6.4
Vendor specific		+ (5 to 10)	+ (2 to 7)	Vendor specific		
SSCm.2		+ 4	+ 1	Switching Signal	BooleanT	
SSCm.1		+ 3	+ 0	Switching Signal	BooleanT	

C.6.2.1 Associated DataTypes for PD Descriptors

According to the general profile rules in A.3 in [7], the process data structure shall be described in the parameter PDInputDescriptor. To avoid complex descriptions of each structure element the coding for the MSDC related process data structures is defined as shown in Table C.38.

Table C.38 – DataType coding of MSDC process data structures

PD Structure	DataType coding	Type Length
MSDC48	131: MSDC48	48 Bit

C.6.2.2 PDI48.MSDC48_1

Figure C.19 shows the Process Data input structure for a Measurement and Switching Data Channel with one sensor channel. The base structure is specified in C.6.2.

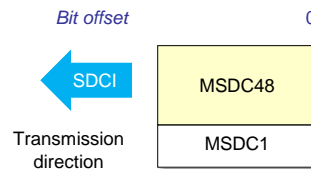


Figure C.19 – 48 bit Process Data input structure with single MSDC48

The applicable offsets regarding Table C.37 are defined in Table C.39.

Table C.39 – Coding of Process Data input (PDI48.MSDC48_1)

Item	Subindex Base	Offset Base
MSDC1	0	0

Table C.40 defines the profiled content of the PDInputDescriptor for PDI48.MSDC48_1

Table C.40 – PVIInD for PDI48.MSDC48_1 process data

Data Type	Type Length	Offset
MSDC48 : 131	48	0
Note: see B.5 in [7] for ordering rules		

C.6.2.3 PDI96.MSDC48_2

Figure C.20 shows the Process Data input structure for a Measurement and Switching Data Channel with two sensor channels. The base structure is specified in C.6.2.

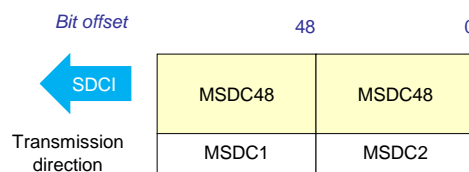


Figure C.20 – 96 bit Process Data input structure with dual MSDC48

The applicable offsets regarding Table C.37 are defined in Table C.41.

Table C.41 – Coding of Process Data input (PDI96.MSDC48_2)

Item	Subindex Base	Offset Base
MSDC1	0	48
MSDC2	10	0

Table C.42 defines the profiled content of the PDInputDescriptor for PDI96.MSDC48_2

Table C.42 – PVIInD for PDI96.MSDC48_2 process data

DataType	TypeLength	Offset
MSDC48 : 131	48	0
MSDC48 : 131	48	48
Note: see B.5 in [7] for ordering rules		

C.6.2.4 PDI144.MSDC48_3

Figure C.21 shows the Process Data input structure for a Measurement and Switching Data Channel with three sensor channels. The base structure is specified in C.6.2.

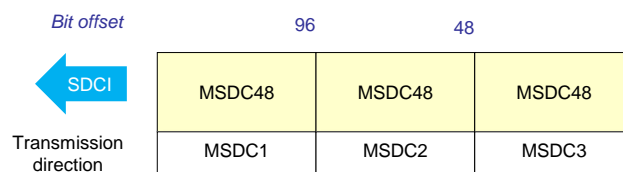


Figure C.21 – 144 bit Process Data input structure with triple MSDC48

The applicable offsets regarding Table C.37 are defined in Table C.43.

Table C.43 – Coding of Process Data input (PDI144.MSDC48_3)

Item	Subindex Base	Offset Base
MSDC1	0	96
MSDC2	10	48
MSDC3	20	0

Table C.44 defines the profiled content of the PDInputDescriptor for PDI144.MSDC48_3

Table C.44 – PVIInD for PDI144.MSDC48_3 process data

DataType	TypeLength	Offset
MSDC48 : 131	48	0
MSDC48 : 131	48	48
MSDC48 : 131	48	96
Note: see B.5 in [7] for ordering rules		

C.6.2.5 PDI192.MSDC48_4

Figure C.22 shows the Process Data input structure for a Measurement and Switching Data Channel with four sensor channels. The base structure is specified in C.6.2.

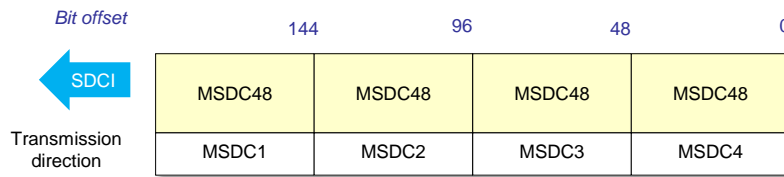


Figure C.22 – 192 bit Process Data input structure with quad MSDC48

The applicable offsets regarding Table C.37 are defined in Table C.45.

Table C.45 – Coding of Process Data input (PDI192.MSDC48_4)

Item	Subindex Base	Offset Base
MSDC1	0	144
MSDC2	10	96
MSDC3	20	48
MSDC4	30	0

Table C.46 defines the profiled content of the PDInputDescriptor for PDI192.MSDC48_4

Table C.46 – PVinD for PDI192.MSDC48_4 process data

DataType	TypeLength	Offset
MSDC48 : 131	48	0
MSDC48 : 131	48	48
MSDC48 : 131	48	96
MSDC48 : 131	48	144
Note: see B.5 in [7] for ordering rules		

C.6.3 MSDC Float general layout

This clause defines the process data layout for the Measurement Data Channel with floating point data types. Up to four sensor channels are supported with each one float value and two switching signal channels.

C.6.3.1 PDI48.MSDCF_1

Figure C.23 shows the Process Data input structure for a Measurement and Switching Data Channel with a single sensor channel.

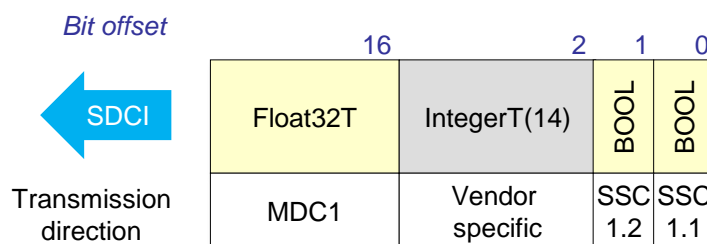


Figure C.23 – 48 bit Process Data input structure with single MSDCF

The coding is defined in Table C.47.

Table C.47 – Coding of Process Data input (PDI48.MSDCF_1)

Item	Subindex	Offset	Function	Type	Definition
MDC1	1	16	Process Data	Float32T	See B.6.2
Vendor specific	2 to 22	2 to 15	Vendor specific		
SSC1.2	23	1	Switching Signal	BooleanT	
SSC1.1	24	0	Switching Signal	BooleanT	

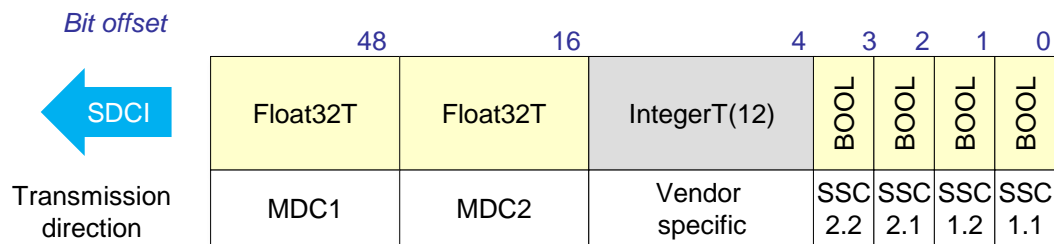
Table C.48 defines the profiled content of the PDInputDescriptor for PDI48.MSDCF_1

Table C.48 – PVinD for PDI48.MSDCF_1 process data

DataType	TypeLength	Offset
SetOfBool: 1	2	0
Float32T : 4	32	16
Note: see B.5 in [7] for ordering rules		

C.6.3.2 PDI80.MSDCF_2

Figure C.24 shows the Process Data input structure for a Measurement and Switching Data Channel with two sensor channels.

**Figure C.24 – 80 bit Process Data input structure with double MSDCF**

The coding is defined in Table C.49.

Table C.49 – Coding of Process Data input (PDI80.MSDCF_2)

Item	Subindex	Offset	Function	Type	Definition
MDC1	1	48	Process Data	Float32T	See B.6.2
MDC2	2	16	Process Data	Float32T	See B.6.2
Vendor specific	3 to 21	4 to 15	Vendor specific		
SSC2.2	21	3	Switching Signal	BooleanT	
SSC2.1	22	2	Switching Signal	BooleanT	
SSC1.2	23	1	Switching Signal	BooleanT	
SSC1.1	24	0	Switching Signal	BooleanT	

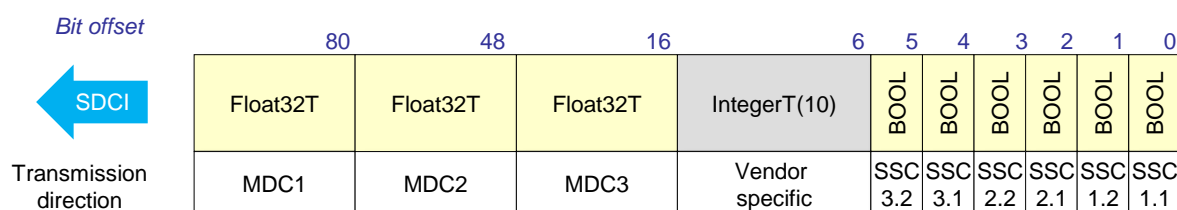
Table C.50 defines the profiled content of the PDInputDescriptor for PDI80.MSDCF_2

Table C.50 – PVIInD for PDI80.MSDCF_2 process data

Data Type	Type Length	Offset
SetOfBool: 1	4	0
Float32T : 4	32	16
Float32T : 4	32	48
Note: see B.5 in [7] for ordering rules		

C.6.3.3 PDI112.MSDCF_3

Figure C.25 shows the Process Data input structure for a Measurement and Switching Data Channel with three sensor channels.

**Figure C.25 – 112 bit Process Data input structure with triple MSDCF**

The coding is defined in Table C.51.

Table C.51 – Coding of Process Data input (PDI112.MSDCF_3)

Item	Subindex	Offset	Function	Type	Definition
MDC1	1	80	Process Data	Float32T	See B.6.2
MDC2	2	48	Process Data	Float32T	See B.6.2
MDC3	3	16	Process Data	Float32T	See B.6.2
Vendor specific	4 to 18	8 to 15	Vendor specific		
SSC3.2	19	5	Switching Signal	BooleanT	
SSC3.1	20	4	Switching Signal	BooleanT	
SSC2.2	21	3	Switching Signal	BooleanT	
SSC2.1	22	2	Switching Signal	BooleanT	
SSC1.2	23	1	Switching Signal	BooleanT	
SSC1.1	24	0	Switching Signal	BooleanT	

Table C.52 defines the profiled content of the PDInputDescriptor for PDI112.MSDCF_3

Table C.52 – PVIInD for PDI112.MSDCF_3 process data

Data Type	Type Length	Offset
SetOfBool: 1	6	0
Float32T : 4	32	16
Float32T : 4	32	48
Float32T : 4	32	80
Note: see B.5 in [7] for ordering rules		

C.6.3.4 PDI144.MSDCF_4

Figure C.26 shows the Process Data input structure for a Measurement and Switching Data Channel with four sensor channels.

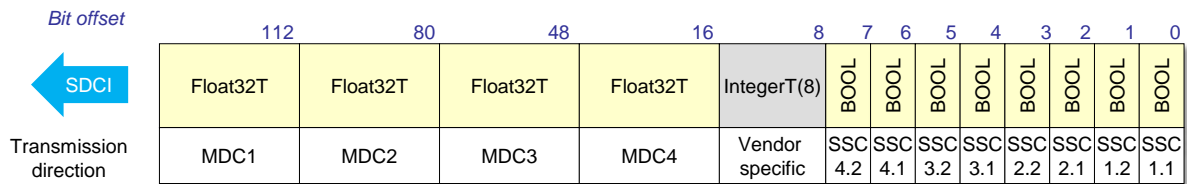


Figure C.26 – 144 bit Process Data input structure with quad MSDCF

The coding is defined in Table C.53.

Table C.53 – Coding of Process Data input (PDI144.MSDCF_4)

Item	Subindex	Offset	Function	Type	Definition
MDC1	1	112	Process Data	Float32T	See B.6.2
MDC2	2	80	Process Data	Float32T	See B.6.2
MDC3	3	48	Process Data	Float32T	See B.6.2
MDC4	4	16	Process Data	Float32T	See B.6.2
Vendor specific	5 to 16	8 to 15	Vendor specific		
SSC4.2	17	7	Switching Signal	BooleanT	
SSC4.1	18	6	Switching Signal	BooleanT	
SSC3.2	19	5	Switching Signal	BooleanT	
SSC3.1	20	4	Switching Signal	BooleanT	
SSC2.2	21	3	Switching Signal	BooleanT	
SSC2.1	22	2	Switching Signal	BooleanT	
SSC1.2	23	1	Switching Signal	BooleanT	
SSC1.1	24	0	Switching Signal	BooleanT	

Table C.54 defines the profiled content of the PDInputDescriptor for PDI144.MSDCF_4

Table C.54 – PVinD for PDI144.MSDCF_4 process data

DataType	TypeLength	Offset
SetOfBool: 1	8	0
Float32T : 4	32	16
Float32T : 4	32	48
Float32T : 4	32	80
Float32T : 4	32	112
Note: see B.5 in [7] for ordering rules		

Annex D (normative)

Device parameters of the Smart Sensor Profile

D.1 Overview

The manufacturer can provide Subindex access to objects with RecordItems, the Smart Sensor Profile specification does not define this behavior. Any overall usable software shall always use the Subindex 0 access instead as this access is granted by any Device.

The persistence or volatility of the objects is stated for each object.

The Device reset option rules defined in clause 10.7.1 in [1] shall be considered and reset all Device parameters to their default value.

D.2 Device parameters of the Smart Sensor Profile

Table D.1 shows an overview of the defined Smart Sensor Profile data objects in the Index range of ISDUs.

Table D.1 – Smart Sensor Profile parameters

Index (dec)	Object name	Access	Length	Data type	Remark
0x0002	SystemCommand	W	1 octet	UIntegerT	Extension of SystemCommands, see [1] and D.3.2
...					
0x0038	SSCParam	R/W	2 octets	IntegerT	See D.4.3
0x0039	SSCConfig	R/W	1 octet	IntegerT	See D.4.2
0x003A	TeachSelect	R/W	1 octet	IntegerT	See D.5.2
0x003B	TeachResult	R	1 octet	IntegerT	See D.4.4 and D.5.3
0x003C	SSC1Param SSC1.1Param	R/W	8 octets	RecordT	See D.5.4 and D.5.5
0x003D	SSC1Config SSC1.1Config	R/W	6 octets	RecordT	
0x003E	SSC2Param SSC1.2Param	R/W	8 octets	RecordT	
0x003F	SSC2Config SSC1.2Config	R/W	6 octets	RecordT	
0x400C	SSC2.1Param	R/W	8 octets	RecordT	
0x400D	SSC2.1Config	R/W	6 octets	RecordT	
0x400E	SSC2.2Param	R/W	8 octets	RecordT	
0x400F	SSC2.2Config	R/W	6 octets	RecordT	
0x401C	SSC3.1Param	R/W	8 octets	RecordT	
0x401D	SSC3.1Config	R/W	6 octets	RecordT	
0x401E	SSC3.2Param	R/W	8 octets	RecordT	
0x401F	SSC3.2Config	R/W	6 octets	RecordT	
0x402C	SSC4.1Param	R/W	8 octets	RecordT	
0x402D	SSC4.1Config	R/W	6 octets	RecordT	
0x402E	SSC4.2Param	R/W	8 octets	RecordT	
0x402F	SSC4.2Config	R/W	6 octets	RecordT	
...					

Index (dec)	Object name	Access	Length	Data type	Remark
0x4080	MDCDescr MDC1Descr	R	11 octets	RecordT	See D.6.1
0x4081	MDC2Descr	R	11 octets	RecordT	
0x4082	MDC3Descr	R	11 octets	RecordT	
0x4083	MDC4Descr	R	11 octets	RecordT	

1382

1383 In case of single physical sensor channel the enumeration SSCn is used to distinguish between
 1384 the switching channels. The enumeration SSCm.n is used to select the physical sensor channel
 1385 by m, and the channel with n.

1386 D.3 Definition of profile specific SystemCommands

1387 D.3.1 Overview

1388 This clause describes the Smart Sensor Profile specific SystemCommands to control the teach
 1389 functionality. The SystemCommand parameter is used as an interface to convey the teach com-
 1390 mands.

1391 D.3.2 SystemCommand

1392 The details are defined in Table D.2, the additional SystemCommands are specified in Table
 1393 D.3. The object is volatile.

1394 **Table D.2 – Command parameter for teach**

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type
0x0002 (2)	0	n/a	W	SystemCommand	See Table D.3	UIntegerT8 (8 bit)

1395

1396 Table D.3 shows the teach command coding for the FunctionClass subsets [0x8007] to
 1397 [0x8009], and [0x8010] to [0x8012]. The availability and dynamic behavior of the teach com-
 1398 mands is specified in B.5.

1399 **Table D.3 – Teach command coding**

Teach command	Value	Comment
Teach Apply	0x40	Calculate and apply setpoint from Teachpoint(s)
Teach SP Teach SP1	0x41	Determine Setpoint1 in a single value teach procedure
Teach SP2	0x42	Determine Setpoint2 in a single value teach procedure
Teach SP TP1 Teach SP1 TP1	0x43	Determine Teachpoint1 for Setpoint1
Teach SP TP2 Teach SP1 TP2	0x44	Determine Teachpoint2 for Setpoint1
Teach SP2 TP1	0x45	Determine Teachpoint1 for Setpoint2
Teach SP2 TP2	0x46	Determine Teachpoint2 for Setpoint2
Teach SP Start Teach SP1 Start	0x47	Start dynamic teach for Setpoint1
Teach SP Stop Teach SP1 Stop	0x48	Stop dynamic teach for Setpoint1
Teach SP2 Start	0x49	Start dynamic teach for Setpoint2

Teach command	Value	Comment
Teach SP2 Stop	0x4A	Stop dynamic teach for Setpoint2
Teach Custom	0x4B to 0x4E	For manufacturer specific use
Teach Cancel	0x4F	Abort teach sequence

D.4 Single channel SSC parameter

D.4.1 Overview

This clause describes the specific parameters and codings for Adjustable Switching Sensors of SSP type 2.1 to SSP 2.3.

The parameters comprise the settings for the switching signal channel and the teach channel.

D.4.2 SSCConfig

The parameter shown in Table D.4 specifies the parameter SSCConfig which defines the logic of the switching signal channel. The object shall be stored persistent and follows the Device reset option rules defined in clause 10.7.1 in [1].

Table D.4 – Configuration parameter

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type
0x0039 (57)	0	n/a	R/W	Logic	"0" = high active "1" = low active	UIntegerT8 (8 bit)

The logic configuration defines the behavior of the switching signal channel as defined in Table A.1.

D.4.3 SSCParam

The parameter shown in Table D.5 specifies the parameter SSCParam which defines the setpoint of the switching signal channel. The object shall be stored persistent and follows the Device reset option rules defined in clause 10.7.1 in [1].

Table D.5 –Setpoint parameter

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type
0x0038 (56)	0	n/a	R/W	SP	Minimum SP ≤ SP ≤ maximum SP Default: Technology specific	IntegerT16 (16 bit)

D.4.4 TeachResult – single point mode

Figure D.1 shows the data structure of the TeachFlags and the TeachState to be used in TeachResult coding in Table D.6.

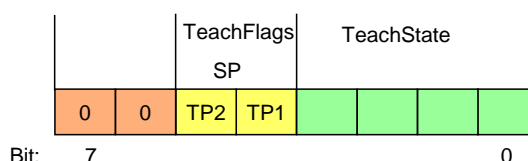


Figure D.1 – Structure of TeachFlags and TeachState

1424 Table D.6 specifies the TeachResult assignment. The table references the individual coding in
 1425 Table D.7. The object is volatile and follows the Device reset option rules defined in clause
 1426 10.7.1 in [1].

1427 **Table D.6 – Result parameter for teach**

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type
0x003B (59)	03	5	R	Flag SP TP2	"0" = Teachpoint not aquired or not successful "1" = Teachpoint successfully aquired	BooleanT (1 bit)
	02	4	R	Flag SP TP1	"0" = Teachpoint not aquired or not successful "1" = Teachpoint successfully aquired	BooleanT (1 bit)
	01	0	R	State	See Table D.7	UIntegerT4 (4 bit)

1428

1429 Table D.7 shows the TeachState coding.

1430 **Table D.7 – TeachState coding**

TeachState	Definition
0	IDLE
1	SUCCESS
2	Reserved
3	Reserved
4	WAIT FOR COMMAND
5	BUSY
6	Reserved
7	ERROR
8 to 11	Reserved
12 to 15	Manufacturer/vendor specific

1431

1432 **D.5 Multiple channel SSC parameter**

1433 **D.5.1 Overview**

1434 This clause describes the specific parameters and codings for Adjustable Switching Sensors of
 1435 SSP type 2.7 and all Digital Measuring Sensors of SSP type 4.

1436 Some parameters already specified in D.4 are extended for this purpose.

1437 **D.5.2 TeachSelect**

1438 Table D.8 specifies the parameter TeachSelect which defines the selected switching signal
 1439 channel for the next teach procedure. The table references individual coding in Table D.9. The
 1440 object is volatile and follows the Device reset option rules defined in clause 10.7.1 in [1].

1441 **Table D.8 – Selection for teach channel**

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type
0x003A (58)	n/a	n/a	R/W	TeachSelect	See Table D.9 Default: "1"	UIntegerT8 (8 bit)

1442

Table D.9 shows the coding of the selectable SSC.

Table D.9 – TeachSelect coding

Teach channel	Definition
0	Address of the manufacturer/vendor specific pre-defined SSC
1 to 128	Address of the SSC a)
129 to 191	Reserved
192-254	Different manufacturer/vendor specific SSC sets
255	Addressing of all implemented SSCs
Key a) the relation between SSC channels and teach channels is defined in Table 8 and Table 16	

The teach channels defined by Table 8 and Table 16 are mandatory when the according ProfileID is supported. The teach channels 0 and 255 are optional, the extension with vendor specific SSC sets is possible via the channels 192 to 254.

D.5.3 TeachResult – multiple switchpoint modes

In conjunction with the FunctionClass Multi Adjustable Switching Signal Channel [0x800D], the TeachResult parameter is specified in Figure D.2, which shows the data structure of TeachFlags and TeachState to be used in TeachResult.

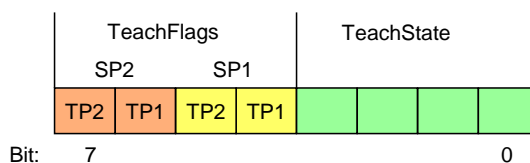


Figure D.2 – Structure of TeachFlags and TeachState

Table D.10 specifies the assignment of the parameter TeachResult according to the Figure D.2 which shows the layout of the parameter. The table references individual coding in Table D.11. The object is volatile and follows the Device reset option rules defined in clause 10.7.1 in [1].

Table D.10 – Result parameter for teach

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type
0x003B (59)	05	7	R	Flag SP2 TP2	"0" = Teachpoint not aquired or not successful "1" = Teachpoint successfully aquired	BooleanT (1 bit)
	04	6	R	Flag SP2 TP1		BooleanT (1 bit)
	03	5	R	Flag SP1 TP2		BooleanT (1 bit)
	02	4	R	Flag SP1 TP1		BooleanT (1 bit)
	01	0	R	State	See Table D.11	UIntegerT4 (4 bit)

Table D.11 shows the TeachState coding.

Table D.11 – TeachState coding

TeachState	Definition
0	IDLE
1	SP1 SUCCESS
2	SP2 SUCCESS
3	SP12 SUCCESS
4	WAIT FOR COMMAND
5	BUSY
6	Reserved
7	ERROR
8 to 11	Reserved
12 to 15	Manufacturer/vendor specific

D.5.4 SSCxParam – multiple switchpoint modes and channels

In conjunction with the FunctionClass Multiple Adjustable Switching Signal Channel [0x800D] the SSCxParam parameter is specified in Table D.12. The object shall be stored persistent and follows the Device reset option rules defined in clause 10.7.1 in [1]. The integer data type is fixed to IntegerT(32) for the FunctionClasses 0x800A and 0x800B, which requires a sign extension to preserve the value's sign if based on IntegerT(16) variables.

Specific rules regarding parameter behavior and parameter checks are defined in the specific FunctionClass description, see B.4.6. Some SSCxParam instances may have names depending on the referring ProfileID, see defined name in tables of associated artefacts for ProfileIDs.

Table D.12 – Setpoint parameter

Index (dec)	Sub- index	Offset	Access	Parameter Name	Coding	Data type per FunctionClass	
						0x800A, 0x800B	0x800E
0x003C (60) or 0x003E (62) or any other ap- plicable address a)	01	32	R/W	SP1	Setpoint 1	IntegerT32 (32 bit)	Float32T
	02	0	R/W	SP2 b)	Setpoint 2	IntegerT32 (32 bit)	Float32T

Key a) any address of SSCxParam parameters defined in Table D.1
 b) SP2 is not relevant according B.1.1 in case of Config.Mode equals Deactivated or Single Point

D.5.5 SSCxConfig – multiple switchpoint modes and channels

In conjunction with the FunctionClass Multiple Adjustable Switching Signal Channel [0x800D] the SSCxConfig parameter is specified in Table D.13. The same enumeration rules as defined for the SSCxParam are applicable here. The object shall be stored persistent and follows the Device reset option rules defined in clause 10.7.1 in [1].

Table D.13 – Configuration parameter

Index (dec)	Sub-index	Offset	Access	Parameter Name	Coding	Data type per FunctionClass	
						0x800A, 0x800B	0x800E
0x003D (61) or 0x003F (63) or any other ap- plicable address a)	01	40	R/W	Logic	0x00 : High active 0x01 : Low active 0x02 ... 0x7F : Reserved 0x80 ... 0xFF : Vendor specific	UIntegerT8 (8 bit)	
	02	32	R/W	Mode	0x00 : Deactivated 0x01 : Single point 0x02 : Window 0x03 : Two point 0x04 to 0x7F : Reserved 0x80 to 0xFF : Vendor specific	UIntegerT8 (8 bit)	
	03	0	R/W	Hyst b)	0 : mandatory, no hysteresis or vendor specific default >0 to maximum positive value: vendor specific definition	IntegerT32 (32 bit)	Float32T

Key a) any address of SSCxConfig parameters defined in Table D.1
 b) Hyst is not relevant according B.1.1 in case of Config.Mode equals Two point

Annex E (normative)

Function Block definitions

E.1 Overview

This annex contains the proxy Function Blocks supporting the specified ProfileIDs.

The specification is based on IEC 61131-3 definitions.

As there are still some differences between the existing systems regarding the PLC system or fieldbus, the system dependent features are marked and have to be defined for each system separately.

The proxy Function Blocks can be categorized into two categories of behavior,

- synchronous, which means, that the functionality is directly called and provides the results after returning from the Function Block, see E.4.
- complex, which means that the proxy Function Block needs interaction between Function Block and caller to perform the desired action, see E.2 or E.3.

E.2 Proxy Function Block for Adjustable Switching Sensors

The objective for a proxy Function Block for Adjustable Switching Sensors is to provide a standardized interface and access method for parameterization of a sensor from a user application program. The FB is not running in a cyclical operation, but only on request if e.g. a setpoint is adjusted or taught.

Figure E.1 demonstrates the layout of a proxy Function Block for a switching sensor (AdSS) with teach.

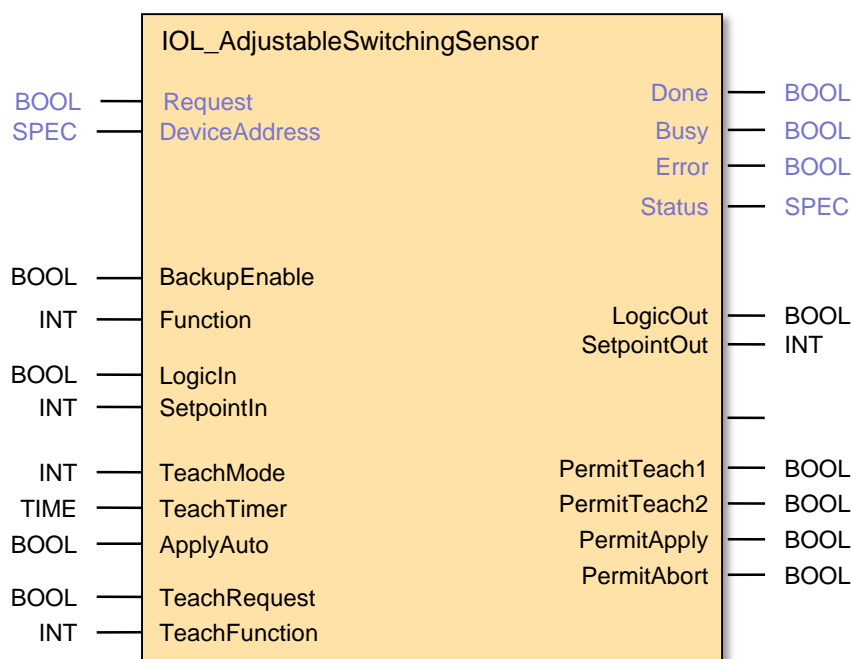


Figure E.1 – Proxy FB for AdSS

1530 The Function Block provides the state machines (sequential function charts) for access to the
1531 profile specific parameters and the procedures for the three teach modes. The shown signals
1532 provide access to functionalities for several use cases and operation modes.

- 1533 • Read switching signal channel parameter
- 1534 • Write switching signal channel parameter
- 1535 • Single value teach
- 1536 • Two value teach
- 1537 • Dynamic teach

1538 The functions of the FB are controlled by the state machine by trigger signals (0→1 transistions)
1539 generated by the user application program and evaluation of the response or status information
1540 provided by the sensor.

1541 A triggered activity of the FB is indicated with a signal Busy. As long as Busy is set all further
1542 trigger events are inhibited.

1543 The current status of operation and all activities of the FB always provide the current values of
1544 switching signal parameters (SetpointOut, LogicOut) at the corresponding outputs. During the
1545 teach process, the FB is cyclically polling the TeachResult of the Device.

1546 Process Data exchange is not handled in the Function Block.

1547 The FB provides configuration and control of the Backup mechanism. Changed parameters in
1548 the device are uploaded to the master via the Data Storage mechanisms if BackupEnable is
1549 activated.

1550 Table E.1 shows the variables of the AdSS proxy Function Block.

1551 **Table E.1 – Variables of the AdSS proxy FB**

Variable	Data type	Description
Inputs		
Request ^a	BOOL	A trigger causes the function selected with variable Function to be executed
DeviceAddress ^a	SPEC ^b	This variable depends on the individual fieldbus address mechanism of an SDCI Device at an SDCI Master port (see SDCI integration specification of a particular fieldbus)
BackupEnable	BOOL	This variable configures the behavior of the FB, if a parameter in the Device has been changed by the FB. "true" = enabled The backup mechanism is triggered by the FB by issuing the SystemCommand ParamDownloadStore after wr_ident. "false" = disabled The backup mechanism is not triggered by the FB
Function	INT	This variable selects the functionality to be triggered by a Request 0 = no_func A Request is neglected, no function is executed 1 = rd_all A Request starts the read back of current Switching Signal Channel parameter values from the sensor. These values are available at LogicOut and SetpointOut 2 = wr_conf A Request causes a previously applied value for LogicIn to be written to the sensor 3 = wr_param A Request causes a previously applied value for SetpointIn to be written to the sensor 4 = teach A Request causes the FB to enter the teach operation.
LogicIn	BOOL	This variable defines the value for a new Switchpoint to be written to the sensor on a Request with Function 'wr_conf', see Table D.4
SetpointIn	INT32	This variable defines the value for a new Setpoint to be written to the sensor on a Request with Function 'wr_param', see Table D.5
TeachMode	INT	This variable defines one of the possible teach procedures: 0 = no_teach - no teach action 1 = single_value - single value teach 2 = two_value – two value teach 3 = dynamic - dynamic teach
TeachTimer	TIME	This variable defines the duration of the dynamic teach time A value of '0' disables the activation of the automatic stop command. The TeachFunction 'teach_2' can always be used for triggering dynamic teach stop and thus, overwrite TeachTimer
ApplyAuto	BOOL	This variable defines the behavior for a two value teach procedure. 'false' = autoapply_disabled The apply function has to be triggered by the user application program in order to evaluate the gathered teachpoints and activate the new Setpoint 'true' = autoapply_enabled If two teachpoints have been successfully taught, the 'apply' function is triggered automatically, no activity from the user application program is required.
TeachRequest	BOOL	A rising edge triggers one step of teach process to be executed according to the selected function at variable TeachFunction.

Variable	Data type	Description
TeachFunction	INT	The value applied to this variable defines the teach functionality to be executed on TeachRequest. 0 = no teach – no function selected 1 = teach 1 – start teach step 1 functionality 2 = teach 2 – start teach step 2 functionality 3 = apply – apply two value teach results 4 = abort – abort actual teach sequence
Outputs		
Done ^a	BOOL	The signal is set, if the FB has completed a requested operation.
Busy ^a	BOOL	The signal is set, if the FB is executing a requested operation
Error ^a	BOOL	The signal is set, if an error occurred during execution of a requested operation.
Status ^a	SPEC ^b	The value represents the current status of the FB operation and executed functions. The content is system specific and contains the status information defined in Table E.2.
SetpointOut	INT[32]	This variable represents the current value of the parameter Setpoint from the sensor. The variable is updated with each termination of a teach process, a write process or on a Request signal with Function rd_all
LogicOut	BOOL	This variable represents the current value of the parameter Logic from the sensor. The variable is updated with each termination of a teach process, a write process or on a Request signal with Function rd_all, see Table D.4
PermitTeach1	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'teach_1' is possible.
PermitTeach2	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'teach_2' is possible.
PermitApply	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'apply' is possible.
PermitAbort	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'abort' is possible.
Key a: This variable name may be adapted to the PLC specific naming guide lines b: SPEC represents the applicable data type for this specific parameter, this may vary over different PLC systems		

1552

1553

1554 Table E.2 defines the extension of the Status parameter additional to the COM status of the
 1555 communication functions including the reference to the TeachState of the Device (see Table
 1556 D.7).

1557 **Table E.2 – Extension of FB Status**

Definition	TeachState
FunctionBlock internal status	
Done, success	
Busy	
Busy reading data	
Busy writing data	
Busy teach process	
Busy teach process, state single value	
Busy teach process, state two value	
Busy teach process, state dynamic	
Busy teach process, apply action	
Busy teach process, abort action	
Done, error	
Additional, concurrent teach states of the Device	
Teach success / idle	Idle or success
Teach wait for command	Wait for command
Teach busy	Busy
Teach error	Error

1558

1559 Figure E.2 shows the state machine of the Adjustable Switching Sensor proxy FB

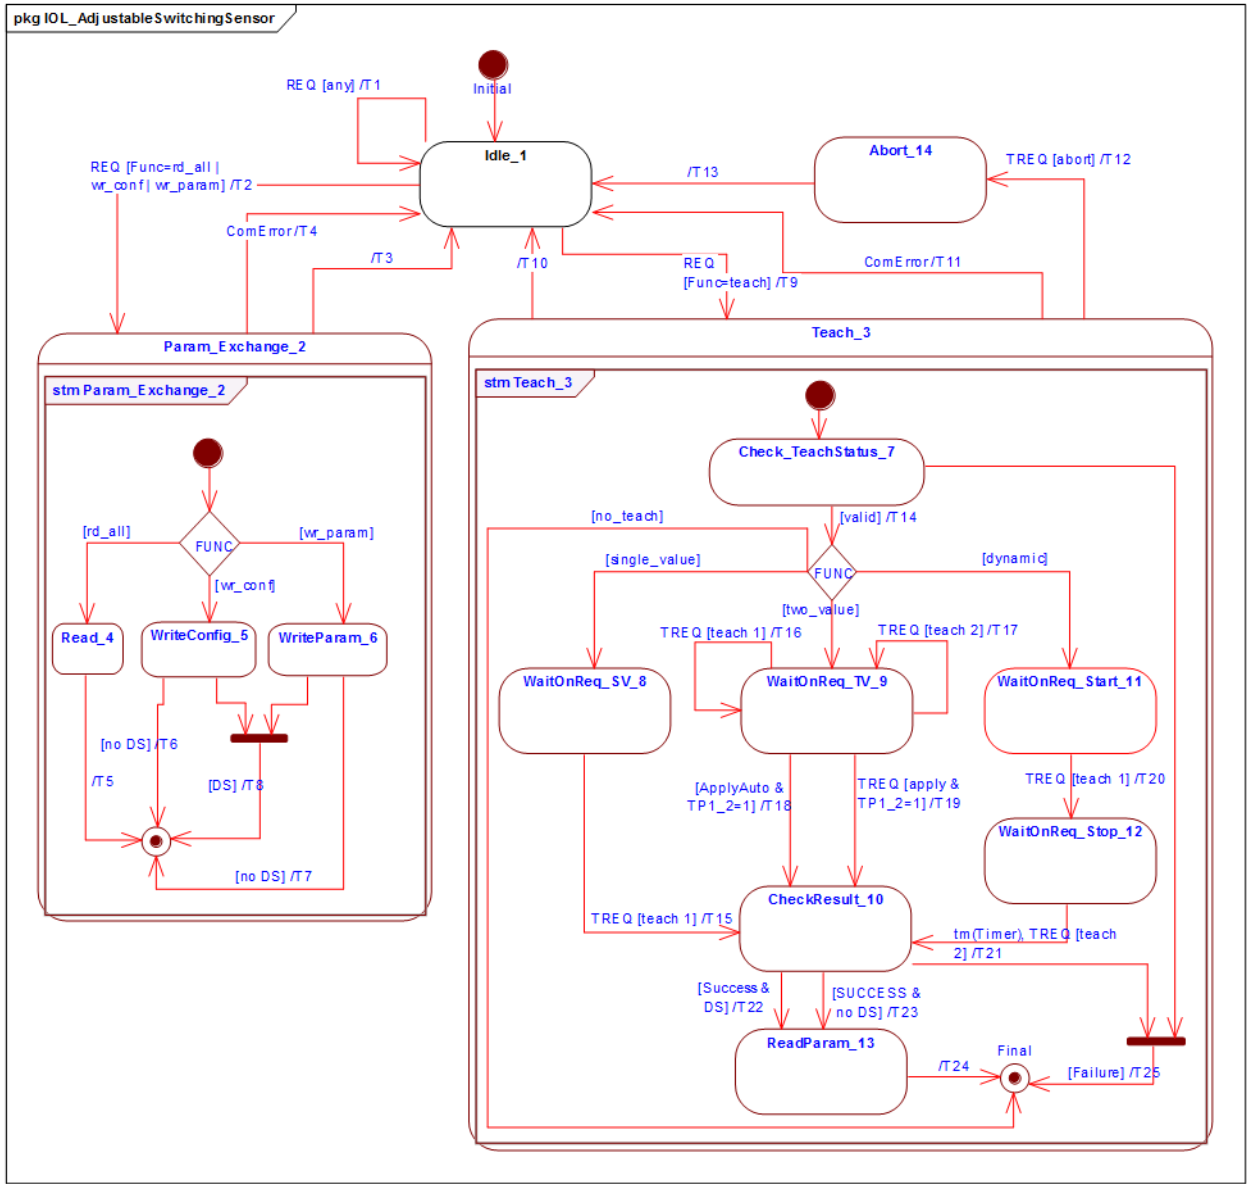


Figure E.2 – State machine of the AdSS proxy FB

Table E.3 shows the state transition tables for the teach state machine of the AdSS proxy FB.

Table E.3 – State and transition table for AdSS proxy FB

STATE NAME	STATE DESCRIPTION
Idle_1	No FunctionBlock activities. Set all Permitxx to inactive. Initial Status is "Done, success", "Teach, success idle"
ParamExchange_2	This superstate allows all states inside to react on communication errors during the activities. Set Status to "Busy".
Teach_3	This superstate allows all states inside to react on – communication errors – abort requests – disabling the FunctionBlock – temporarily unavailable Tach-in function requests Set Status to "Busy teach process"

STATE NAME		STATE DESCRIPTION	
Read_4		Read all configuration and settings parameter of the device, see Table D.4 and Table D.5 Set Status to "Busy reading data".	
WriteConfig_5		Write configuration parameter to the Device, see Table D.4 Set Status to "Busy writing data".	
WriteParam_6		Write settings parameter to the Device, see Table D.5 Set Status to "Busy writing data".	
CheckTeachState_7		At entry wait till TeachState is no longer busy, read TeachState (Table D.6), provide teach status information.	
WaitOnReq_SV_8		At entry wait till TeachState is no longer busy, read TeachState (Table D.6), provide Status information and set Status to "Busy teach process, state single value". Set only PermitTeach1 to active. Wait till next step (teach_1) is requested.	
WaitOnReq_TV_9		At entry wait till TeachState is no longer busy, read TeachState (Table D.6), provide TeachState information and set Status to "Busy Teach process, state two value". Set PermitTeach1, PermitTeach2 and PermitAbort to active. Set PermitApply active if TP1 and TP2 are active. Wait till next step (teach_1, teach_2 or apply) is requested	
CheckResult_10		At entry wait till TeachState is no longer busy, read TeachState (Table D.6), provide TeachStatus and set Status to "Busy Teach process, state apply action".	
WaitOnReq_Start_11		At entry wait till TeachState is no longer busy, read TeachState (Table D.6), provide TeachStatus information and set Status to "Busy Teach process, state single value". Set only PermitTeach1 to active. Wait till next step (teach_1) is requested.	
WaitOnReq_Stop_12		At entry wait till TeachState is no longer busy, read TeachState (Table D.6) and provide Status information. Set PermitTeach2 and PermitAbort to active. Wait till next step (teach_2) is requested.	
ReadParam_13		Read back the Device parameter to update the SetpointOut and LogicOut variables, set Status to "Busy reading data".	
Abort_14		Update Status information and perform garbage collection.	
TRANSITION	SOURCE STATE	TARGET STATE	ACTION
T1	1	1	Set Status to "Done, error"
T2	1	2	Reset output variable Error
T3	2	1	Set Status to "Done, success"
T4	2	1	Set Status to "Done, error", set output variable "Error"
T5	4	1	–
T6	5	1	–
T7	6	1	–
T8	5, 6	1	Invoke SystemCommand ParamDownloadStore, see B.2.2 in [1]
T9	1	3	Set Status to "Teach success/idle" and "Busy teach process". Reset output variable Error
T10	3	1	–
T11	3	1	Set Status to "Done, error" and "Teach error", set output variable Error
T12	3	14	Invoke "Teach Cancel", see Table D.3. Set Status to "Busy Teach abort"
T13	13	1	Set Status to "Done, success" and "Teach success/idle"
T14	7	8, 9, 11	–
T15	8	10	Invoke "Teach SP", see Table D.3
T16	9	9	Invoke "Teach SP TP1", see Table D.3

1565

TRANSITION	SOURCE STATE	TARGET STATE	ACTION
T17	9	9	Invoke "Teach SP TP2", see Table D.3
T18	9	10	Invoke "Teach Apply", see Table D.3
T19	9	10	Invoke "Teach Apply", see Table D.3
T20	11	12	Invoke "Teach SP Start", see Table D.3
T21	12	10	Invoke "Teach SP Stop", see Table D.3
T22	10	13	Invoke SystemCommand ParamDownloadStore, see B.2.2 in [1]
T23	10	13	–
T24	13	1	Set Status to "Done, success" and "Teach success/idle"
T25	7, 10	1	Set Status to "Teach error"
INTERNAL ITEMS		TYPE	DEFINITION
ComError		Boolean	Any detected error during communication to the Device
REQ		Trigger	Rising edge of the FB Request input
FUNC		Integer	Selected function from Function input
DS		Boolean	State of BackupEnable input at FB
TREQ		Trigger	Detected trigger at rising edge of TeachRequest with selected TeachFunction as guard
Failure		Boolean	Result of the previous action indicates failure like teach failed or requested function not available

E.3 Proxy Function Block for multi channel Adjustable Switching Sensors

The objective for a proxy Function Block for Multiple Adjustable Switching Sensors is to provide a standardized interface and access method for parameterization of a sensor from a user application program. The FB is not running in a cyclical operation, but only on request if e.g. a setpoint is adjusted or taught.

Figure E.3 demonstrates the layout of a proxy Function Block for a switching sensor defined in SSP types 2 and 4 with teach. The proxy Function Block covers the reduced functionality of SSP types 2.1 to SSP 2.3 and can be used for all types of teach functionality defines in context with SSC.

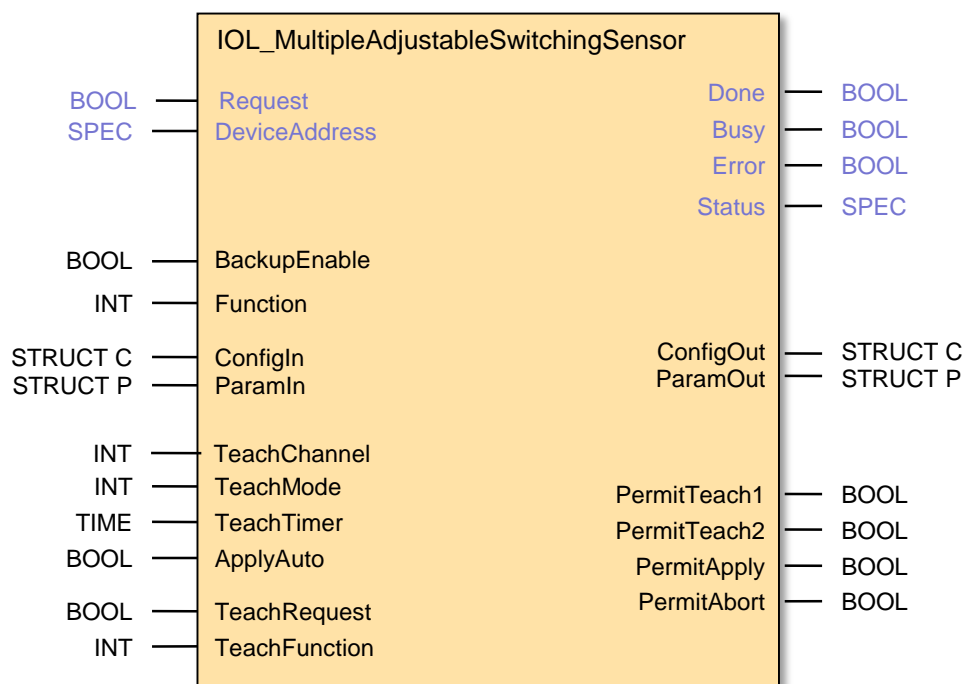


Figure E.3 – Proxy FB for multi channel AdSS

The Function Block provides the state machines (sequential function charts) for access to the profile specific parameters and the procedures for the three teach modes. The shown signals provide access to functionalities for several use cases and operation modes.

- Select the teach channel
- Read switching signal channel parameter
- Write switching signal channel parameter
- Single value teach
- Two value teach
- Dynamic teach

The functions of the FB are controlled with the state machine via trigger signals (0→1 transitions) generated by the user application program and evaluation of the response or status information provided by the sensor.

A triggered activity of the FB is indicated with a signal Busy. As long as Busy is set all further trigger events are inhibited.

The current status of operation and all activities of the FB always provide the current values of switching signal parameters (SetpointOut, LogicOut) at the corresponding outputs. During the teach process, the FB is cyclically polling the teach results of the Device.

Process Data exchange is not handled in the Function Block.

The FB provides configuration and control of the Backup mechanism. Changed parameters in the device are uploaded to the master via the Data Storage mechanisms if BackupEnable is activated.

Table E.4 shows the variables of the multi channel AdSS proxy Function Block.

Table E.4 – Variables of the multi channel AdSS proxy FB

Variable	Data type ^{c)}	Description
Inputs		
Request ^{a)}	BOOL	A trigger causes the function selected with variable Function to be executed
DeviceAddress ^{a)}	SPEC ^{b)}	This variable depends on the individual fieldbus address mechanism of an SDCI Device at an SDCI Master port (see SDCI integration specification of a particular fieldbus)
BackupEnable	BOOL	This variable configures the behavior of the FB, if a parameter in the Device has been changed by the FB. "true" = enabled The backup mechanism is triggered by the FB by issuing the SystemCommand ParamDownloadStore after wr_ident. "false" = disabled The backup mechanism is not triggered by the FB
Function	INT	This variable selects the functionality to be triggered by a Request 0 = no_func A Request is neglected, no function is executed 1 = rd_all A Request starts the read back of current Switching Signal Channel parameter values from the sensor. These values are available at ConfigOut and ParamOut 2 = wr_conf A Request causes a previously applied value for ConfigIn to be written to the sensor 3 = wr_param A Request causes a previously applied value for ParamIn to be written to the sensor 4 = teach A Request causes the FB to enter the teach operation.
ConfigIn	STRUCT C	This structure defines the values for the configuration settings to be written on a Request with Function wr_config.
ParamIn	STRUCT P	This structure defines the values for the setpoint parameters to be written on a Request with Function wr_param.
TeachChannel	INT	This variable defines the selected teach channel for the following teach procedure and variable accesses. A value of -1 indicates the usage for SSP types 2.1 to 2.6. Available values to be used with SSP types 2.7 and 4.x, see Table 8 and Table 16. The content of this variable is sampled before accessing the variables or starting any teach procedure.
TeachMode	INT	This variable defines one of the possible teach procedures: 0 = no_teach - no teach action 1 = single_value - single value teach 2 = two_value - two value teach 3 = dynamic - dynamic teach The following teach procedures are available with SSP types 2.7, and 4.x only 11 = single_value_SP2 – single value teach of SP2 12 = two_value_SP2 – two value teach of SP2 13 = dynamic_SP2 – dynamic teach of SP2 The content of this variable is sampled at TeachRequest only.
TeachTimer	TIME	This variable defines the duration of the dynamic teach time A value of '0' disables the activation of the automatic stop command. The TeachFunction 'teach_2' can always be used for triggering dynamic teach stop and thus, overwrite TeachTimer

Variable	Data type ^{c)}	Description
ApplyAuto	BOOL	This variable defines the behavior for a two value teach procedure. 'false' = autoapply_disabled The apply function has to be triggered by the user application program in order to evaluate the gathered teachpoints and activate the new Setpoint 'true' = autoapply_enabled If two teachpoints have been successfully taught, the 'apply' function is triggered automatically, no activity from the user application program is required.
TeachRequest	BOOL	A rising edge triggers one step of teach process to be executed according to the selected function at variable TeachFunction.
TeachFunction	INT	The value applied to this variable defines the teach functionality to be executed on TeachRequest. 0 = no teach – no function selected 1 = teach 1 – start teach step 1 functionality 2 = teach 2 – start teach step 2 functionality 3 = apply – apply two value teach results 4 = abort – abort actual teach sequence
Outputs		
Done ^a	BOOL	The signal is set, if the FB has completed a requested operation.
Busy ^a	BOOL	The signal is set, if the FB is executing a requested operation
Error ^a	BOOL	The signal is set, if an error occurred during execution of a requested operation.
Status ^a	SPEC ^{b)}	The value represents the current status of the FB operation and executed functions. The content is system specific and contains the status information defined in Table E.7.
ConfigOut	STRUCT C	This structure represents the current values of the configuration settings from the sensor. The variable is updated with each termination of a teach process or Request signals with Function wr_param or rd_all.
ParamOut	STRUCT P	This structure represents the current values of the setpoint parameter settings from the sensor. The variable is updated with each termination of a teach process or Request signals with Function wr_param or rd_all.
PermitTeach1	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'teach_1' is possible.
PermitTeach2	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'teach_2' is possible.
PermitApply	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'apply' is possible.
PermitAbort	BOOL	The signal is set, if according to the current state of the FB a TeachRequest for TeachFunction 'abort' is possible.
Key a) This variable name may be adapted to the PLC specific naming guide lines b) SPEC represents the applicable data type for this specific parameter, this may vary over different PLC systems c) Data types according [5]		

1603

1604

1605 The structured information in the variable ConfigIn and ConfigOut is specified in Table E.5 and
 1606 shows the references to the Device parameters.

1607 **Table E.5 – Elements of the STRUCT C**

Name	Data type ^{a)} per FunctionClass		Remark
	0x800A, 0x800B	0x800E	
Logic	INT		See Table D.13
Mode	INT		
Hyst	DINT	REAL	
Key a) Data types according [5]			

1608

1609 The structured information in the variable ParamIn and ParamOut is specified in Table E.6 and
 1610 shows the references to the Device parameters.

1611 **Table E.6 – Elements of the STRUCT P**

Name	Data type ^{a)} per FunctionClass		Remark
	0x800A, 0x800B	0x800E	
SP1	DINT	REAL	See Table D.12
SP2	DINT	REAL	
Key a) Data types according [5]			

1612

1613 Table E.7 defines the extension of the Status parameters additional to the COM status of the
 1614 communication functions including the reference to the TeachState of the Device (see Table
 1615 D.7).

1616 **Table E.7 – Extension of FB Status**

Definition	TeachState
FunctionBlock internal status	
Done, success	
Busy	
Busy reading data	
Busy writing data	
Busy teach process	
Busy teach process, state single value	
Busy teach process, state two value	
Busy teach process, state dynamic	
Busy teach process, apply action	
Busy teach process, abort action	
Done, error	
Additional, concurrent teach states of the Device	
Teach success / idle	Idle or success
Teach wait for command	Wait for command
Teach busy	Busy
Teach error	Error

1617

Figure E.4 shows the state machine of the multi channel Adjustable Switching Sensor proxy FB

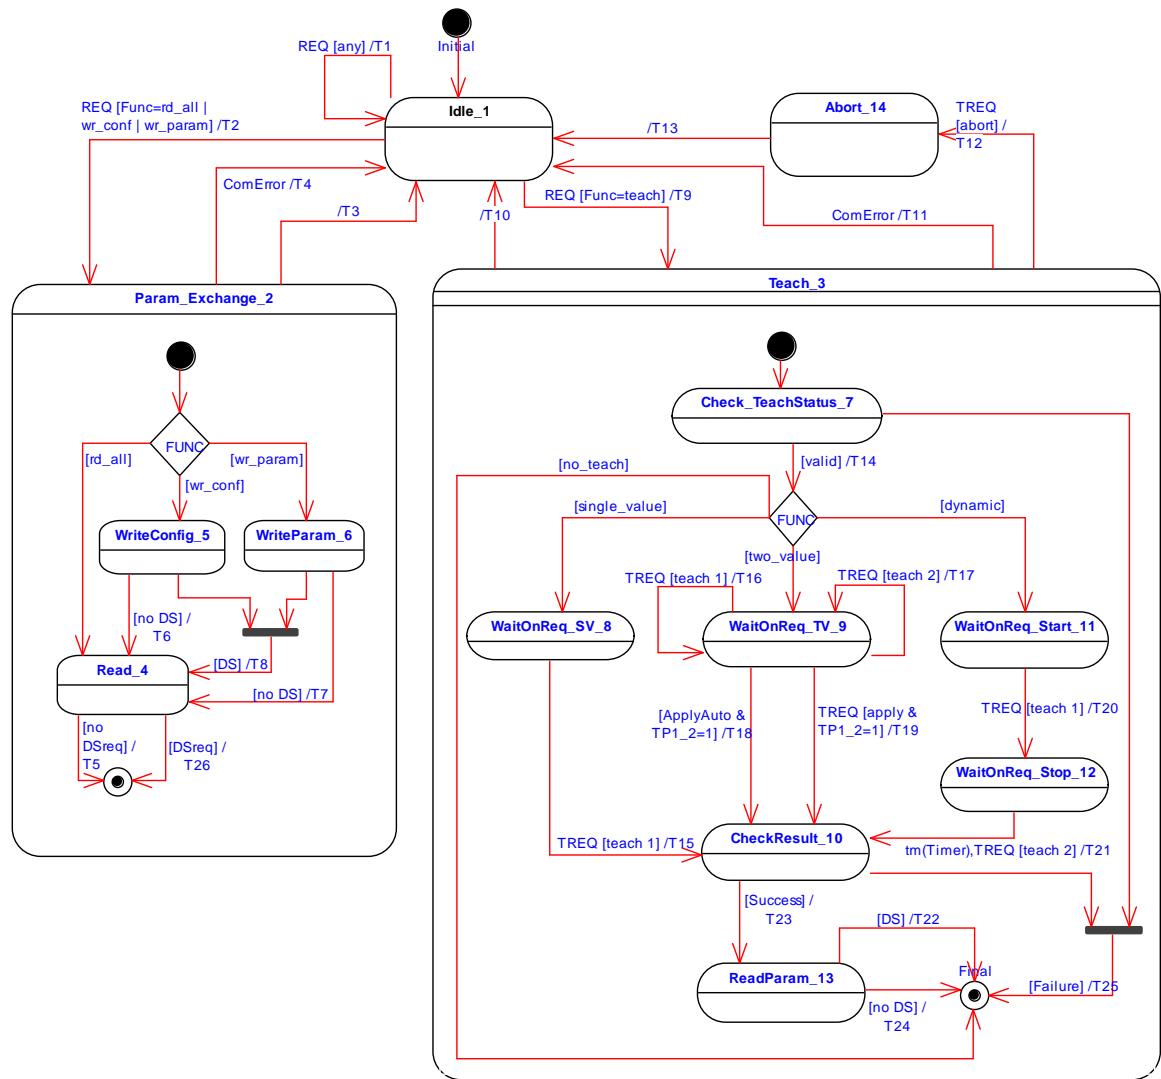


Figure E.4 – State machine of the multi channel AdSS proxy FB

Table E.8 shows the state transition tables for the teach state machine of the multi channel AdSS proxy FB.

Table E.8 – State and transition table for AdSS proxy FB

STATE NAME	STATE DESCRIPTION
Idle_1	No FunctionBlock activities. Set all Permitxx to inactive. Initial Status is "Done, success", "Teach, success idle"
ParamExchange_2	This superstate allows all states inside to react on communication errors during the activities
Teach_3	This superstate allows all states inside to react on <ul style="list-style-type: none">communication errorsabort requestsdisabling the FunctionBlocktemporarily unavailable teach function requests

STATE NAME		STATE DESCRIPTION	
Read_4		Read all configuration and settings parameter of the device and provide result in ConfigOut and ParamOut. See Table E.9 for the relation between TeachChannel and parameter indices. Set Status to "Busy reading data".	
WriteConfig_5		Write configuration parameter ConfigIn to the Device. See Table E.9 for the relation between TeachChannel and parameter indices. Set Status to "Busy writing data".	
WriteParam_6		Write settings parameter ParamIn to the Device. See Table E.9 for the relation between TeachChannel and parameter indices. Set Status to "Busy writing data".	
CheckTeachState_7		At entry wait till TeachState is no longer busy, read TeachResult (Table E.9), provide Teach Status information.	
WaitOnReq_SV_8		At entry wait till TeachState is no longer busy, read TeachResult (Table E.9), provide TeachState information and set Status to "Busy Teach process, state single value". Set only PermitTeach1 to active. Wait till next step (teach_1) is requested.	
WaitOnReq_TV_9		At entry wait till TeachState is no longer busy, read TeachResult (Table E.9), provide TeachState information and set Status to "Busy Teach process, state two value". Set PermitTeach1, PermitTeach2, and PermitAbort to active. Set PermitApply active if TP1 and TP2 are active. Wait till next step (teach_1, teach_2 or apply) is requested	
CheckResult_10		At entry wait till TeachState is no longer busy, read TeachResult (Table E.9), provide TeachState and set Status to "Busy Teach process, state apply action".	
WaitOnReq_Start_11		At entry wait till TeachState is no longer busy, read TeachResult (Table E.9), provide TeachState information and set Status to "Busy Teach process, state dynamic". Set only PermitTeach1 to active. Wait till next step (teach_1) is requested.	
WaitOnReq_Stop_12		At entry wait till TeachState is no longer busy, read TeachResult (Table E.9) and provide Status information. Set PermitTeach2, and PermitAbort to active. Wait till next step (teach_2) is requested.	
ReadParam_13		Read back the Device parameter to update the ParamOut and ConfigOut variables, set Status to "Busy reading data". See Table E.9 for the relation between TeachChannel and parameter indices.	
Abort_14		Update Status information and perform garbage collection.	
TRANSITION	SOURCE STATE	TARGET STATE	ACTION
T1	1	1	Set Status to "Done, error"
T2	1	2	Reset output variable Error
T3	2	1	Set Status to "Done, success"
T4	2	1	Set Status to "Done, error", set output variable Error
T5	4	1	–
T6	5	4	Set DSreq = false
T7	6	4	Set DSreq = false
T8	5, 6	4	Set DSreq = true
T9	1	3	Set Status to "Teach success/idle" and "Busy teach process". Reset output variable Error
T10	3	1	–
T11	3	1	Set Status to "Done, error" and "Teach error", set output variable Error
T12	3	14	Invoke SystemCommand according Table E.10. Set Status to "Busy teach abort"
T13	13	1	Set Status to "Done, success" and "Teach success/idle"

TRANSITION	SOURCE STATE	TARGET STATE	ACTION
T14	7	8, 9, 11	Invoke write to Index TeachSelect" with the value of TeachChannel
T15	8	10	Invoke SystemCommand according Table E.10
T16	9	9	Invoke SystemCommand according Table E.10
T17	9	9	Invoke SystemCommand according Table E.10
T18	9	10	Invoke SystemCommand according Table E.10
T19	9	10	Invoke SystemCommand according Table E.10
T20	11	12	Invoke SystemCommand according Table E.10
T21	12	10	Invoke SystemCommand according Table E.10
T22	13	1	Invoke SystemCommand ParamDownloadStore", see B.2.2 in [1] Set Status to "Done, success" and "Teach success/idle"
T23	10	13	–
T24	13	1	Set Status to "Done, success" and "Teach success/idle"
T25	7, 10	1	Set Status to "Done, error" and "Teach error"
T26	4	1	Invoke SystemCommand ParamDownloadStore", see B.2.2 in [1]
INTERNAL ITEMS		TYPE	DEFINITION
ComError		Boolean	Any detected error during communication to the Device
REQ		Trigger	Rising edge of the FB Request input
FUNC		Integer	Selected function from Function input
DS		Boolean	State of BackupEnable input at FB
TREQ		Trigger	Rising edge of the FB TeachRequest input with selected TeachFunction as guard
Failure		Boolean	Result of the previous action indicates failure like teach failed or requested function not available
DSreq		Boolean	Flag if DS shall be invoked after any communication accesses

Table E.9 defines the parameters to be used in relation to the selected TeachChannel.

Table E.9 – Parameter assigned to TeachChannel

TeachChannel	SSCParam Index a)	SSCConfig Index b)	TeachResult Flags c)	Remark
-1	0x0038	0x0039	TeachFlags SP / SP1	Unavailable structure elements of ConfigIn/Out or ParamIn/Out shall be set to "0" and not transmitted toward the Device via communication
1	0x003C	0x003D	TeachFlags SP / SP1	
2	0x003E	0x003F	TeachFlags SP2	
11	0x400C	0x400D	TeachFlags SP / SP1	
12	0x400E	0x400F	TeachFlags SP2	
21	0x401C	0x401D	TeachFlags SP / SP1	
22	0x401E	0x401F	TeachFlags SP2	
31	0x402C	0x402D	TeachFlags SP / SP1	
32	0x402E	0x402F	TeachFlags SP2	
All other	Not supported			

TeachChannel	SSCParam Index a)	SSCConfig Index b)	TeachResult Flags c)	Remark
NOTE a) See Table D.4 and Table D.12 for SSCParam structure b) See Table D.5 and Table D.13 for SSCConfig structure c) See Figure D.1 and Figure D.2 for the TeachResult structure				

1629

1630 Table E.10 defines the SystemCommand in relation to TeachMode and TeachFunction.

1631

Table E.10 – SystemCommand assigned to TeachFunction

TeachMode a)	TeachFunction a)	System- Command b)
single_value	teach 1	Teach SP Teach SP1
two_value	teach 1	Teach SP TP1 Teach SP1 TP1
	teach 2	Teach SP1 TP2
	apply	Teach Apply
	abort	Teach Cancel
dynamic	teach 1	Teach SP Start Teach SP1 Start
	teach 2	Teach SP Stop Teach SP1 Stop
	abort	Teach Cancel
single_value_SP2	teach 1	Teach SP2
two_value_SP2	teach 1	Teach SP2 TP1
	teach 2	Teach SP2 TP2
	apply	Teach Apply
	abort	Teach Cancel
dynamic_SP2	teach 1	Teach SP2 Start
	teach 2	Teach SP2 Stop
	abort	Teach Cancel
NOTE a) See Table E.4 b) See Table D.3		

1632

1633

E.4 Proxy Function Block for Measurement Data Channel (MDC)

The Measurement Data Channel defines the Process Data structure, functions and representation of measuring sensors. A proxy Function Block is defined providing derived status signals and allowing a standardized interface for user application programs.

Figure E.5 demonstrates the layout of a proxy Function Block for the Measurement Data Channel of measuring Devices.

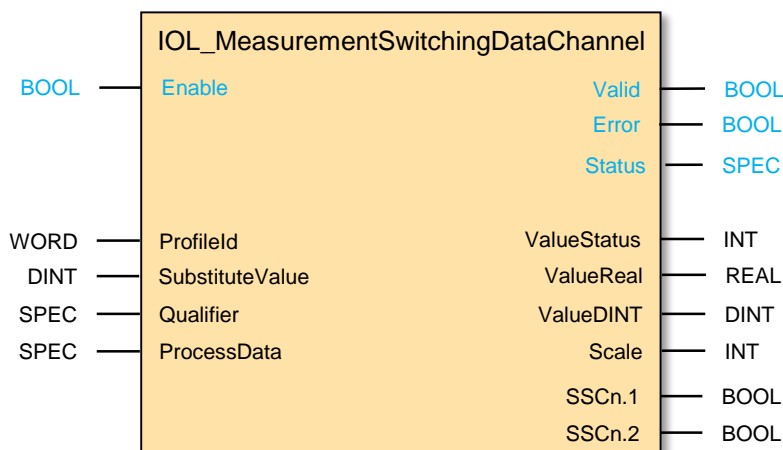


Figure E.5 – Function Block for Measurement Data Channel

Table E.11 describes the signal and variables of the Measurement Data Channel Function Block.


Table E.11 – Variables of the Measurement Data Channel Function Block

Variable	Data type	Description
Inputs		
Enable a)	BOOL	Enables the function of the FB
ProfileID	WORD	Selected ProfileID, respectively process data layout, see Table 12 and Table 15 1 = FunctionClass 0x800A (SSP 3.1, SSP 3.3, SSP 4.1.x) 2 = FunctionClass 0x800B (SSP 3.2, SSP 3.4, SSP 4.2.x)
SubstituteValue	DINT	The provided value is applied at the ValueReal and ValueDINT if ValueStatus is not equal "0"
Qualifier	SPEC b)	This signal corresponds to the ProcessDataInvalid information from the sensor. The format is system specific. 'false' = ProcessData are invalid 'true' = ProcessData are valid
ProcessData	SPEC b)	The Process Data Input from the sensor is applied to this input. The format is system specific. NOTE: the Process Data Input width depends on the profile for the DMS (either INT16 or INT32)
Outputs		
Valid a)	BOOL	If "true" the provided values are valid and may be used for further calculations
Error a)	BOOL	If "true" an internal error is occurred and further information is provided by the Function Block via the Status variable

Variable	Data type	Description
Status a)	SPEC b)	Provides internal error codes
ValueStatus	INT	Status of process data input 0 = ok 1 = PD invalid 2 = No Data 3 = Out of range (+) 4 = Out of range (-)
ValueReal	REAL	Process data in real format for evaluation within the PLC
ValueDINT	DINT	Process data in double integer format
Scale	INT	Process data scale factor
SSCn.1	BOOL	Switching information, channel 1, directly derived from process data offset 0
SSCn.2	BOOL	Switching information, channel 2, directly derived from process data offset 1
Key a) This variable name may be adapted to the PLC specific naming guide lines b) SPEC represents the applicable data type for this specific parameter, this may vary over different PLC systems		

1646

1647 The function analyses the received Process Data Input value and creates corresponding indi-
 1648 cations in case of invalid values, no data, out-of-range+, and out-of-range-. The user provides
 1649 the qualifier, and a substitute value. Figure E.6 shows the calculation procedure for the meas-
 1650 urement value and substitute values, the constants are defined in Table B.9.

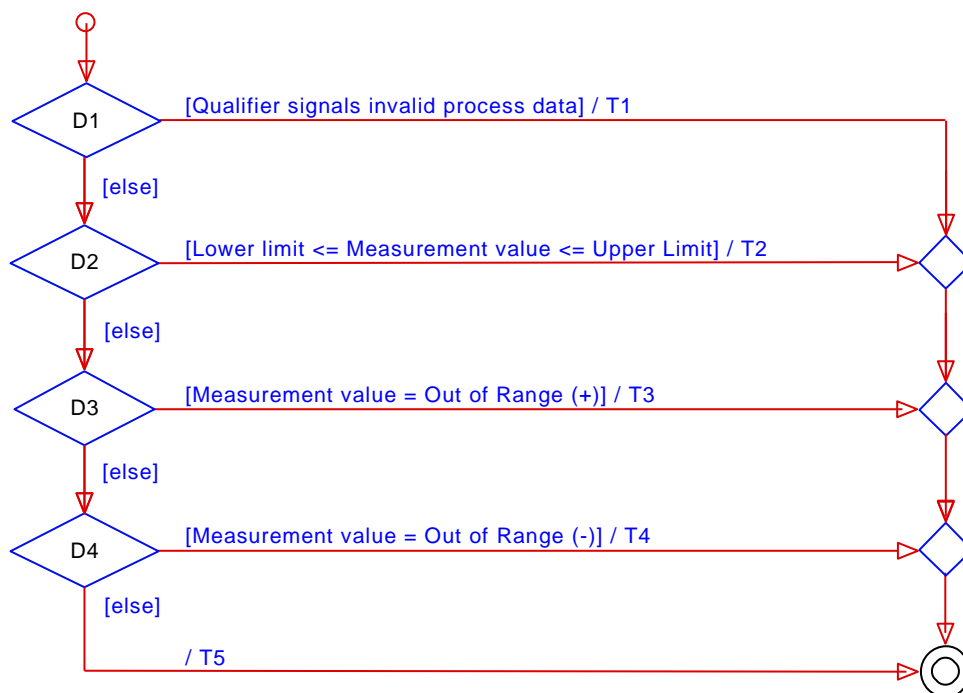

1651

Figure E.6 – Determination of measurement value or substitute values

1652

1653 Table E.12 shows the state transition table for the measurement data calculation of the Meas-
 1654 urement Data Channel proxy FB.

1655 **Table E.12 – State and transition table for Measurement Data FB**

STATE NAME		STATE DESCRIPTION	
No states defined			
TRANSITION	SOURCE STATE	TARGET STATE	ACTION
T1	Initial		Set ValueStatus = PD Invalid, ValueReal = SubstituteValue, and ValueDINT = SubstituteValue
T2	Initial		Set ValueStatus to ok, ValueReal = measurement value * 10 exp scale, ValueDINT = measurement value
T3	Initial		Set ValueStatus = Out of range (-), ValueReal = SubstituteValue, and ValueDINT = SubstituteValue
T4	Initial		Set ValueStatus = Out of range (+), ValueReal = SubstituteValue, and ValueDINT = SubstituteValue
T5	Initial		Set ValueStatus = No Data, ValueReal = SubstituteValue, and ValueDINT = SubstituteValue
INTERNAL ITEMS		TYPE	DEFINITION
No internal items defined			

Annex F (normative)

IODD definitions and rules

F.1 Overview

The objective to create the Smart Sensor Profile Ed.2 was to eliminate the optional functionalities in profiled Devices by specifying completely defined profiles. As the parameter and the behavior is specified the look and feel of the Devices should also be harmonized, otherwise the appearance of the same profile is different between different manufacturer.

To achieve a common look and feel, the IODD content has to be defined as well. This clause includes the rules for the naming conventions and menu layout.

F.2 Constraints and rules

The constraints and rules defined in clause D.2 in [7] are observed and fulfilled by the following definitions.

F.3 Name definitions

F.3.1 Profile type characteristic names

The profile characteristic names (see Table 4, Table 7, Table 12) shall be used whenever the profile functionality is referenced in the IODD.

F.3.2 Parameter set for Fixed or Adjustable Switching Signal profile

Table F.1 specifies the name predefinitions for the SSCConfig.Logic object including the predefinitions for the SingleValues, see Table D.4.

Table F.1 – SSCConfig.Logic predefinitions

Variable name predefinition	SingleValue	Name predefinition
SSC Config - Logic	0	High active
	1	Low active

F.3.3 Parameter set for Adjustable Switching Signal profile

The SSCConfig object is defined in Table F.1.

Table F.2 specifies the name predefinitions for the SSCParam.SP object, see Table D.5.

Table F.2 – SSCParam.SP predefinitions

Variable name predefinition	Value name predefinition
SSC Param - SP	n/a

1687 Table F.3 specifies the name predefinitions for the TeachResult object including the predefini-
1688 tions for the SingleValues, see Table D.6.

1689

Table F.3 – TeachResult predefinitions

Variable name predefinition	Subindex	Parameter name predefinition	SingleValue	Name predefinition
Teach Result	3	Flag SP TP2	0	Initial or not ok
	2	Flag SP TP1	1	OK
	1	State	0	Idle
			1	Success
			4	Wait for command
			5	Busy
			7	Error
			12 .. 15	Custom

Table F.4 specifies the predefinitions for the teach commands defined for the SystemCommand object, see Table D.3.

Table F.4 – Teach command predefinition

Variable name	SingleValue	Name predefinitions
SystemCommand	0x40	Teach Apply
	0x41	Teach SP
	0x43	Teach SP TP1
	0x44	Teach SP TP2
	0x47	Teach SP Start
	0x48	Teach SP Stop
	0x4B .. 0x4E	Teach Custom
	0x4F	Teach Cancel

F.3.4 Parameter set for MAdSS & DMSS & MSDC

Table F.5 specifies the name predefinitions for the SSCConfig object which is associated to the specific Profile types in Table 8 and Table 16. The predefinitions for the SingleValues are defined in Table D.4.

Table F.5 – SSCConfig predefinitions

Variable name predefinition	Subindex	RecordItem name predefinition	SingleValue	Name predefinition
SSCm.n Config ^{a)}	1	Logic	0	High active
			1	Low active
	2	Mode	0	Deactivated
			1	Single point
			2	Window
			3	Two point
			0x80 .. 0xFF	Custom
	3	Hyst	0	Off / Default
Key a) m.n is defined as single value in Table 8 and defined as two digit value in Table 16				

1702 Table F.6 specifies the name predefinitions for the SSCParam parameter which is associated
1703 to the specific Profile types in Table 8 and Table 16.

1704 **Table F.6 – SSCParam predefinition**

Variable name predefinition	Subindex	RecordItem name predefinition	Value name predefinition
SSCm.n Param a)	1	SP1	n/a
	2	SP2	n/a
Key a) m.n is defined as single value in Table 8 and defined as two digit value in Table 16			

1705

1706 Table F.7 specifies the name predefinitions for the TeachSelect parameter parameter including
1707 the predefinitions for the SingleValues, see Table D.9.

1708 **Table F.7 – TeachSelect predefinition**

Variable name predefinition	SingleValue	Name predefinition
Teach Select	0x01	SSC1.1
	0x02	SSC1.2
	0x0B	SSC2.1
	0x0C	SSC2.2
	0x15	SSC3.1
	0x16	SSC3.2
	0x1F	SSC4.1
	0x20	SSC4.2
	0xFF	All SSC
	All other	Custom

1709

1710 Table F.8 specifies the predefinitions for the teach commands defined for the SystemCommand
1711 parameter, see Table D.3.

1712 **Table F.8 – Teach command predefinition**

Variable name	SingleValue	name predefinitions
SystemCommand	0x40	Teach Apply
	0x41	Teach SP1
	0x42	Teach SP2
	0x43	Teach SP1 TP1
	0x44	Teach SP1 TP2
	0x45	Teach SP2 TP1
	0x46	Teach SP2 TP2
	0x47	Teach SP1 Start
	0x48	Teach SP1 Stop
	0x49	Teach SP2 Start
	0x4A	Teach SP2 Stop
	0x4B .. 0x4E	Teach Custom
	0x4F	Teach Cancel

1713

Table F.9 specifies the name predefinitions for the TeachResult parameter including the pre-definitions for the SingleValues, see Table D.6 and Table D.10.

Table F.9 – TeachResult predefinition

Variable name predefinition	Subindex	Parameter name predefinition	SingleValue	name predefinition
Teach Result	5	Flag SP2 TP2	0	Initial or not ok
	4	Flag SP2 TP1		OK
	3	Flag SP1 TP2	1	
	2	Flag SP1 TP1		
	1	State	0	Idle
			1	SP1 success
			2	SP2 success
			3	SP1, SP2 success
			4	Wait for command
			5	Busy
			7	Error
			12 .. 15	Custom

F.3.5 Parameter set for Digital Measuring Sensor profile

Table F.10 specifies the predefinitions for the MDC object which is associated to the specific Profile types in Table 13 and Table 16. The structure of the RecordItem is defined in Table D.14.

Table F.10 – MDC descriptor predefinition

Variable name pre-definition	Subindex	Parameter name predefinitions	Value name predefinition
MDCm Descriptor a)	1	Lower value	n/a
	2	Upper value	
	3	Unit code	
	4	Scale	
Key a) m is defined as single value in Table 16 and omitted in Table 13			

F.4 IODD Menu definitions

F.4.1 Overview

Examples for layouts of Port and Device configuration tools are shown in 13.5.3 in [1].

Within these examples the IODD defines the parameter layout of the connected device. In this clause the object and parameter layout of the different FunctionClasses are specified.

F.4.2 Common rules for building profile menu entries

The following clauses define the layout and structure of the different menu artifacts. Whenever a Device supports a Smart Sensor Profile FunctionClass the corresponding menu artifacts shall be referenced in the menu section of the Device's IODD.

The shown figures and SingleValues are examples.

F.4.2.1 Menu section

Each artifact is associated with a specific section of the menu.

F.4.2.2 SystemCommand

The naming of the SystemCommand is depending on the parametrization tool, any other parameter shall be displayed as shown in the figures.

F.4.2.3 Order of menu artifacts

The artifacts shall be ordered by the following priority, enumerations within these sub classes shall be in ascending order

- Sensor channel
- SSC parameter
- Teach parameter
 - Single Point Teach
 - Two Point Teach
 - Dynamic teach

F.4.2.4 Extension of menu by vendor specific parameter

Any part of the predefined menu structure can be extended by vendor specific parameters. To guarantee the overall unified outline, these parameters shall be placed at the end of the defined structure. The naming can be adapted to the associated profile parameters, but shall not use predefined namings from other profiles.

F.4.2.5 Explanation of used object layout

Figure F.1 shows the basic layout objects to describe the look of the profile parameters in any IODD based tooling.

The content description is placed at the corresponding positions.

Sub menu header		
Parameter name (selectable value)	Selection	v
Parameter name (value)	Value	
Command (Triggered action)	Command name	
Parameter name (read only)	Value / Selection	

Drop-down indicator

Figure F.1 – IODD object layout description

F.4.3 Menu structure of the Fixed Switching Signal Channel

In Figure F.2 the menu structure of the FunctionClass Fixed Switching Signal Channel [0x8005] is specified, it shall be located in the Parameter section of the menu.

Switching Signal Channel			
SSC Config - Logic	High active	v	

Figure F.2 – Menu FSS

F.4.4 Menu structure of an Adjustable Switching Signal Channel

In Figure F.3 the menu structure of the FunctionClass Adjustable Switching Signal Channel [0x8006] is specified, it shall be located in the Parameter section of the menu.

Switching Signal Channel			
SSC Param - SP	1234		
SSC Config - Logic	High active	v	

Figure F.3 – Menu AdSS

F.4.5 Menu structure of Teach single value

In Figure F.4 the menu structure of the FunctionClass Teach single value [0x8007] is specified, it shall be located in the Parameter section of the menu.

Teach Single Value		
<i>SystemCommand</i>	Teach SP	
Teach Result - State	Idle	

Figure F.4 – Menu Teach single value

F.4.6 Menu structure Teach two value

In Figure F.5 the menu structure of the FunctionClass Teach two value [0x8008] is specified, it shall be located in the Parameter section of the menu.

Teach Two Value		
<i>SystemCommand</i>	Teach SP TP1	
<i>SystemCommand</i>	Teach SP TP2	
<i>SystemCommand</i>	Teach Apply	
<i>SystemCommand</i>	Teach Cancel	
Teach Result - Flag SP TP1	Ok	
Teach Result - Flag SP TP2	Ok	
Teach Result - State	Idle	

Figure F.5 – Menu Teach two value

F.4.7 Menu structure Teach dynamic

In Figure F.6 the menu structure of the FunctionClass Teach dynamic [0x8009] is specified, it shall be located in the Parameter section of the menu.

Teach Dynamic		
<i>SystemCommand</i>	Teach Start	
<i>SystemCommand</i>	Teach Stop	
<i>SystemCommand</i>	Teach Cancel	
Teach Result - State	Idle	

Figure F.6 – Menu teach dynamic**F.4.8 Menu structure Multiple adjustable Switching Signal Channel**

In Figure F.7 the menu structure of the FunctionClass Multiple Adjustable Switching Signal Channel [0x800D] is specified, it shall be located in the Parameter section of the menu.

Switching Signal Channel m.n			
SSCm.n Param - SP1	1234		
SSCm.n Param - SP2	1234		
SSCm.n Config - Logic	High active	v	
SSCm.n Config - Mode	Two point	v	
SSCm.n Config - Hyst	0		

Figure F.7 – Menu Multiple Adjustable Switching Signal**F.4.9 Menu structure of Multi channel Teach single value**

In Figure F.8 the menu structure of the FunctionClass Multi Channel Teach single value [0x8010] is specified, it shall be located in the Parameter section of the menu.

Teach Single Value			
Teach Select	SSCn	v	
<i>SystemCommand</i>	Teach SP1		
<i>SystemCommand</i>	Teach SP2		
Teach Result - State	Idle		

Figure F.8 – Menu Teach single value**F.4.10 Menu structure Multi channel Teach two value**

In Figure F.9 the menu structure of the FunctionClass Multi channel Teach two value [0x8011] is specified, it shall be located in the Parameter section of the menu.

Teach Two Value			
Teach Select	SSCn	v	
<i>SystemCommand</i>	Teach SP1 TP1		
<i>SystemCommand</i>	Teach SP1 TP2		
<i>SystemCommand</i>	Teach SP2 TP1		
<i>SystemCommand</i>	Teach SP2 TP2		
<i>SystemCommand</i>	Teach Apply		
<i>SystemCommand</i>	Teach Cancel		
Teach Result - Flag SP1 TP1	Ok		
Teach Result - Flag SP1 TP2	Ok		
Teach Result - Flag SP2 TP1	Ok		
Teach Result - Flag SP2 TP2	Ok		
Teach Result - State	Idle		

Figure F.9 – Menu Teach two value

F.4.11 Menu structure Multi channel Teach dynamic

In Figure F.10 the menu structure of the FunctionClass Multi channel Teach dynamic [0x8012] is specified, it shall be located in the Parameter section of the menu.

Teach Dynamic			
Teach Select	SSCn	v	
<i>SystemCommand</i>	Teach SP1 Start		
<i>SystemCommand</i>	Teach SP1 Stop		
<i>SystemCommand</i>	Teach SP2 Start		
<i>SystemCommand</i>	Teach SP2 Stop		
<i>SystemCommand</i>	Teach Cancel		
Teach Result - State	Idle		

Figure F.10 – Menu teach dynamic

F.4.12 Menu structure of a Digital Measuring Sensor

In Figure F.11 the menu structure of the FunctionClass Digital measuring Sensor [0x800A, 0x800B, and 0x800E] is specified, it shall be located at the bottom of the Diagnosis section of the menu.

Measuring Data Channel m		
MDCm Descriptor - Lower value	0	
MDCm Descriptor - Upper value	1000	
MDCm Descriptor – Unit Code	Pa	
MDCm Descriptor – Scale	-1	

1819

1820

1821

Figure F.11 – Menu DMS

Annex G (normative)

Profile testing and conformity

G.1 General

G.1.1 Overview

It is the responsibility of the vendor/manufacture of a Smart Sensor profile Device to perform a conformity testing and to provide a document similar to the manufacturer declaration defined in [1] or based on the template downloadable from the IO-Link website (www.io-link.com).

G.1.2 Test extension for profile Devices

The standard test cases to achieve the conformity are extended by profile test cases specified in G.3.

G.2 IODD test

As defined in clause 7 in [7] the IODD shall comply to the IODD schema and also comply to specific IODD business rules. The system is extended by this profile with some new parameters or defining some parameters as mandatory. The IODD checker tool is extended by specific rules if the /IODevice/ProfileBody/DeviceFunction/Features/@profileCharacteristic contains at minimum one entry. See clause 7.2 in [7] for further explanations.

G.2.1 Extended business rule set for Smart Sensor Profiles

Beside this specification an xml based file provides detailed snippets instantiating the different parts of the predefined IODD content. These snippets can be used as an example how to build a Smart Sensor Profile compliant IODD as well as it is the base for the extended IODD checker business rules to achieve conformity to the standard.

G.3 Specific unit test

In this clause the extended test cases regarding dynamic functionality are defined. The test cases may be tested manually, but after implementation in the conformance tester tools, they require the automated test.

G.3.1 FSS hidden FunctionClasses

Table G.1 defines the test conditions for this test case

Table G.1 – FSS-hidden FunctionClasses

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0001
Name	TCD_SSP2_FSS_HIDDENFC
Purpose (short)	Already incorporated FunctionClasses by FSS shall not be listed
Equipment under test (EUT)	Device with profile type SSP 1.1 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	Table 4
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	The FSS 0x0002 incorporates already the FunctionClass 0x8005 and this Function-Class shall not be listed in the ProfileCharacteristic.
Precondition	Device is in SDCI communication mode and sensor channel provide a valid and stable signal
Procedure	a) Read parameter ProfileCharacteristic
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Check after step a) for positive result 2. Check absence of intrinsic FunctionClass 0x8005
Test passed	All performed evaluations without failure
Test failed (examples)	Any failure in 1) to 2)
Results	FSS – Hiding FunctionClasses correct <ok/nok>

G.3.2 AdSS hidden FunctionClasses

Table G.2 defines the test conditions for this test case

Table G.2 – AdSS-hidden FunctionClasses

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0002
Name	TCD_SSP2_ADSS_HIDDENFC
Purpose (short)	Already incorporated FunctionClasses by AdSS shall not be listed
Equipment under test (EUT)	Device with one of profile type SSP 2 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	6.1, Table 7
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	All already by the AdSS 0x0004 to 0x0006 and 0x000E incorporated FunctionClasses shall not be listed in the ProfileCharacteristic.
Precondition	Device is in SDCl communication mode and sensor channel provide a valid and stable signal
Procedure	a) Read parameter ProfileCharacteristic
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Check after step a) for positive result 2. If ProfileCharacteristic contains 0x0004; check absence of intrinsic FunctionClasses 0x8006 and 0x8007 3. If ProfileCharacteristic contains 0x0005; check absence of intrinsic FunctionClasses 0x8006 and 0x8008 4. If ProfileCharacteristic contains 0x0006; check absence of intrinsic FunctionClasses 0x8006 and 0x8009 5. If ProfileCharacteristic contains 0x000E; check absence of intrinsic FunctionClasses 0x800D and 0x8010
Test passed	All performed evaluations without failure
Test failed (examples)	Any failure in 1) to 5)
Results	AdSS – Hiding FunctionClasses correct <ok/nok>

G.3.3 DMS hidden FunctionClasses

Table G.3 defines the test conditions for this test case

Table G.3 – DMS-hidden FunctionClasses

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0003
Name	TCD_SSP2_DMS_HIDDENFC
Purpose (short)	Already incorporated FunctionClasses by DMS shall not be listed
Equipment under test (EUT)	Device with one of the profile types SSP 3 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	Table 12
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	All already by the DMS 0x000A and 0x000B incorporated FunctionClasses as 0x800A or 0x800B shall not be listed in the ProfileCharacteristic.
Precondition	Device is in SDCI communication mode and sensor channel provide a valid and stable signal
Procedure	a) Read parameter ProfileCharacteristic
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Check after step a) for positive result 2. If ProfileCharacteristic contains 0x000A; check absence of intrinsic FunctionClass 0x800A 3. If ProfileCharacteristic contains 0x000B; check absence of intrinsic FunctionClasses 0x800B
Test passed	All performed evaluations without failure
Test failed (examples)	Any failure in 1) to 3)
Results	DMS – Hiding FunctionClasses correct <ok/nok>

G.3.4 DMSS hidden FunctionClasses

Table G.4 defines the test conditions for this test case

Table G.4 – DMSS-hidden FunctionClasses

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0004
Name	TCD_SSP2_DMSS_HIDDENFC
Purpose (short)	Already incorporated FunctionClasses by DMSS shall not be listed
Equipment under test (EUT)	Device with one of the profile types SSP 4 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	Table 15
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	All already by the DMSS 0x0010 to 0x0017 incorporated FunctionClasses as 0x800A, 0x800B or 0x800D shall not be listed in the ProfileCharacteristic.
Precondition	Device is in SDCI communication mode and sensor channel provide a valid and stable signal
Procedure	a) Read parameter ProfileCharacteristic
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Check after step a) for positive result 2. If ProfileCharacteristic contains 0x0010, 0x0011, 0x0012, or 0x0013; check absence of intrinsic FunctionClass 0x800A 3. If ProfileCharacteristic contains 0x0014, 0x0015, 0x0016, or 0x0017; check absence of intrinsic FunctionClasses 0x800B 4. If ProfileCharacteristic contains 0x0018, 0x0019, 0x001A, or 0x001B; check absence of intrinsic FunctionClasses 0x800E
Test passed	All performed evaluations without failure
Test failed (examples)	Any failure in 1) to 4)
Results	DMSS – Hiding FunctionClasses correct <ok/nok>

G.3.5 FSS / AdSS config parameter validation

Table G.5 defines the test conditions for this test case

Table G.5 – FSS/AdSS-SSCConfig validation

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0005
Name	TCD_SSP2_FSS_ADSS_CONFIG
Purpose (short)	Test of parameter SSCConfig of profile SSP 1 or SSP 2.1 to SSP 2.3 which provide AdSS functionality
Equipment under test (EUT)	Device with profile type SSP 1, SSP 2.1 to SSP 2.3 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	B.2, D.4.2
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	Test for implementation of parameter SSCConfig, including check of reaction process data input
Precondition	Device is in SDCI communication mode and sensor channel provide a valid and stable signal. In case of Sensor Control / Sensor Control Wide supported, set PDOOut valid and CSCs to '0'.
Procedure	a) Read parameter SSCConfig and memorize b) Read PDIn and memorize c) Invert SSCConfig.Logic (0 -> 1 or 1 -> 0) and write SSCConfig d) Read PDIn e) Write original value to SSCConfig f) Read PDIn
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Check after step a) for positive result and correct size 2. Check after step c) for positive result 3. Check after step d) for toggling of PDIN compared to step b) 4. Check after step e) for positive result 5. Check after step f) for equivalence of PDIN compared to step b)
Test passed	All evaluations are positive and without any communication failure
Test failed (examples)	No response, invalid parameter length, or no reaction on PDIn
Results	FSS – SSCConfig correct <ok/nok>

G.3.6 MAdSS Config parameter validation

Table G.6 defines the test conditions for this test case

Table G.6 – MAdSS-SSCConfig validation

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0007
Name	TCD_SSP2_MADS_CONFIG
Purpose (short)	Test of parameter SSCConfig of profiles with MAdSS supported
Equipment under test (EUT)	Device with one of profile types SSP 2.7 or SSP 4 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	B.4, D.5.5
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	Test for implementation of parameter SSCConfig, including check of reaction process data input
Precondition	Device is in SDCI communication mode and sensor channel provide a valid and stable signal. In case of Sensor Control / Sensor Control Wide supported, set PDOut valid and CSCs to '0'.
Procedure	For each supported SSC a) Write parameter SSCm.nConfig to HighActive b) Read PDIn.SSCm.n and memorize c) Write SSCm.nConfig.Logic to LowActive d) Read PDIn.SSCm.n e) Write parameter SSCm.nConfig to HighActive f) Read PDIn.SSCm.n
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	Check for each iteration 1. Check after step a) for positive result and correct size 2. Check after step c) for positive result 3. Check after step d) for toggling of PDIN compared to step b) 4. Check after step e) for positive result 5. Check after step f) for equivalence of PDIN compared to step b)
Test passed	All evaluations are positive and without any communication failure
Test failed (examples)	No response, invalid parameter length, or no reaction on PDIn
Results	MAdSS – SSCConfig correct <ok/nok>

G.3.7 AdSS Teach compliance

Table G.7 defines the test conditions for this test case

Table G.7 – AdSS Teach compliant to FunctionBlock

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0008
Name	TCD_SSP2_ADSS_FBCOMPLIANCE
Purpose (short)	Check compliance to Teach FB IOL_AdjustableSwitchingSensor
Equipment under test (EUT)	Device with SSP types 2.1 to 2.3 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	B.5, E.2
Configuration / setup	PLC Environment with Teach FB according E.2
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	Check if Teach state machine is fully implemented and reacts according to defined behavior implemented by the FB
Precondition	Device is in SDCI communication mode. In case of Sensor Control / Sensor Control Wide supported, set PDOOut valid and CSCs to '0'.
Procedure	a) Perform multiple teaches according supported Device functionalities
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Confirm teach procedures without failures and with expected results
Test passed	All evaluations are positive
Test failed (examples)	No response or invalid parameter length
Results	AdSS – teach compliant <ok/nok>

G.3.8 MAdSS Teach compliance

Table G.8 defines the test conditions for this test case

Table G.8 – MAdSS Teach compliant to FunctionBlock

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0009
Name	TCD_SSP2_MADS_FBCOMPLIANCE
Purpose (short)	Check compliance to Teach FB IOL_MultipleAdjustableSwitchingSensor
Equipment under test (EUT)	Device with SSP types 2.7, or 4 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	B.5, E.3
Configuration / setup	PLC Environment with Teach FB according E.3
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	Check if Teach state machine is fully implemented and reacts according defined behavior implemented by the FB. In case of Sensor Control / Sensor Control Wide supported, set PDOOut valid and CSCs to '0'.
Precondition	Device is in SDCI communication mode
Procedure	a) Perform multiple teaches according supported Device functionalities
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. Confirm teach procedures without failures and with expected results
Test passed	All evaluations are positive
Test failed (examples)	No response or invalid parameter length
Results	MAdSS – teach compliant <ok/nok>

G.3.9 MAdSS Teach channel selection

Table G.9 defines the test conditions for this test case

Table G.9 – MAdSS Teach channel selection

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0010
Name	TCD_SSP2_MADS_TEACSELECT
Purpose (short)	Check for support of mandatory teach channels
Equipment under test (EUT)	Device with SSP types 2.7 or 4 implemented
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	B.5.4, 7, 8
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	Check if all mandatory teach channels can be selected
Precondition	Device is in SDCI communication mode and TeachState is Idle. In case of supported Sensor Control / Sensor Control Wide, set PDOOut valid and CSCs to '0'.
Procedure	a) Write "1" to TeachSelect b) Write "2" to TeachSelect If SSP 4.x.2, 4.x.3, or 4.x.4 supported c) Write "11" to TeachSelect d) Write "12" to TeachSelect If SSP 4.x.3 or 4.x.4 supported e) Write "21" to TeachSelect f) Write "22" to TeachSelect If 4.x.4 supported g) Write "31" to TeachSelect h) Write "32" to TeachSelect
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. If performed check after each step for positive result
Test passed	All evaluations are positive
Test failed (examples)	No response
Results	MAdSS – teach channel support <ok/nok>

G.3.10 Sensor Control reactivity on MDC

Table G.10 defines the test conditions for this test case

Table G.10 – Sensor Control reactivity

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0011
Name	TCD_SSP2_TRCO_DISABLE
Purpose (short)	Check for reaction of ControlSignalChannel
Equipment under test (EUT)	Device with SSP types 3 or SSP 4 and additional FunctionClass Sensor Control or Sensor Control Wide
Test case version	1.0
Category / type	Device application test; test to pass
Specification (clause)	B.7
Configuration / setup	Device-Tester-Unit
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	Check if the MDC process data reaction is correct when disabling the sensor channel per channel
Precondition	Device is in SDCI communication mode and all process data are valid and in normal range
Procedure	a) Set CSC1 to TRUE b) Read MDC1 c) Set CSC1 to FALSE d) Read MDC1 until data ≠ NoData If SSP 4.x.2, 4.x.3, or 4.x.4 supported e) Set CSC2 to TRUE f) Read MDC2 g) Set CSC2 to FALSE h) Read MDC2 until data ≠ NoData If SSP 4.x.3 or 4.x.4 supported i) Set CSC3 to TRUE j) Read MDC3 k) Set CSC3 to FALSE l) Read MDC3 until data ≠ NoData If SSP 4.x.4 supported m) Set CSC4 to TRUE n) Read MDC4 o) Set CSC4 to FALSE p) Read MDC4 until data ≠ NoData q) Set all supported CSC to TRUE, set PDOOut to invalid r) Read all supported MDC until all data ≠ NoData
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. If performed, check after steps b), f), j), and n) for data = NoData and PD valid 2. If performed, check after steps d), h), l), and p) for data ≠ NoData and PD valid 3. Check after step r) for data ≠ NoData on all MDC
Test passed	All evaluations are positive
Test failed (examples)	Timeout or invalid data
Results	Sensor Control – reactivity <ok/nok>

G.3.11 MDC Scale consistency

Table G.11 defines the test conditions for this test case

Table G.11 – MDC Scale consistency

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0012
Name	TCD_SSP2_MDC_SCALECON
Purpose (short)	Test of consistency between Scale in process data input and parameter MDCDescr – Scale
Equipment under test (EUT)	Device with SSP types 3.x, 4.1.x, or 4.2.x
Test case version	1.0
Category / type	Device application test; test to pass (positive testing)
Specification (clause)	B.6
Configuration / setup	Device-Tester
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	The test verifies that the scale value which is sent in every process data cycle equals the scale value which is readable via ISDU parameter MDCDescr Scale
Precondition	Device is in SDCI communication mode and all process data are valid and in normal range
Procedure	a) Read parameter MDC1Descr – Scale b) Read Scale1 from process data input If SSP 4.x.2, 4.x.3, or 4.x.4 supported c) Read parameter MDC2Descr – Scale d) Read Scale2 from process data input If SSP 4.x.3 or 4.x.4 supported e) Read parameter MDC3Descr – Scale f) Read Scale3 from process data input If SSP 4.x.4 supported g) Read parameter MDC4Descr – Scale h) Read Scale4 from process data input
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. If performed check after steps a), c), e), and g) for positive result 2. If performed, check after steps b), d), f), and h) for MDCnDescr-Scale = Scalen
Test passed	All evaluations are positive
Test failed (examples)	Any mismatch of the comparison
Results	Read MDCDescr – Scale response < ok/nok > Process data input scale < ok/nok >

G.3.12 MDC Measurement range correctness

Table G.12 defines the test conditions for this test case

Table G.12 – MDC Measurement range correctness

TEST CASE ATTRIBUTES	IDENTIFICATION / REFERENCE
Identification (ID)	SSP_TC_0013
Name	TCD_SSP2_MDC_RANGECOR
Purpose (short)	Test of correct range information in parameter MDCDescr – UpperValue and LowerValue
Equipment under test (EUT)	Device with SSP types 3.x, 4.1.x, or 4.2.x
Test case version	1.0
Category / type	Device application test; test to pass (positive testing)
Specification (clause)	B.6
Configuration / setup	Device-Tester
TEST CASE	CONDITIONS / PERFORMANCE
Purpose (detailed)	The test verifies the correctness of the UpperValue and LowerValue information in the MDCxDscr. The test checks against the previously entered figures provided by the tester.
Precondition	Device is in SDCI communication mode
Procedure	a) Read parameter MDC1Descr If SSP 4.x.2, 4.x.3, or 4.x.4 supported b) Read parameter MDC2Descr If SSP 4.x.3 or 4.x.4 supported c) Read parameter MDC3Descr If SSP 4.x.4 supported d) Read parameter MDC4Descr e) Ask UpperValue and LowerValue for each read MDCxDscr
Input parameter	-
Post condition	-
TEST CASE RESULTS	CHECK / REACTION
Evaluation	1. If performed check after steps a), b), c), and d) for positive result 2. Check Uppervalue and LowerValue for each MDCxDscr on equality of read and provided data
Test passed	All evaluations are positive
Test failed (examples)	Any mismatch of the comparison
Results	Read MDCDescr response < ok/nok > Process data input range < ok/nok >

Annex H (informative)

Information on conformity testing of profile Devices

Information about testing profile Devices for conformity with this document can be obtained from the following organization:

IO-Link Community

Haid-und-Neu-Str. 7

76131 Karlsruhe

Germany

Phone: +49 (0) 721 / 98 61 97 0

Fax: +49 (0) 721 / 98 61 97 11

E-mail: info@io-link.com

Web site: <http://www.io-link.com>

Bibliography

1947

1948 [1] IO-Link Community, *IO-Link Interface and System*, V1.1.3, June 2019, Order No.
1949 10.002

1950 [2] IO-Link Community, *IO Device Description (IODD)*, V1.1.3, January 2021, Order No.
1951 10.012

1952 [3] IEC/TR 62390:2005, *Common automation device profile guideline*

1953 [4] IEC 60050 (all parts), *International Electrotechnical Vocabulary*

1954 NOTE See also the IEC Multilingual Dictionary – Electricity, Electronics and Telecommunications (avail-
1955 able on CD-ROM and at <<http://domino.iec.ch/iev>>).

1956 [5] IEC 61131-3:2013, *Programmable controllers - Part 3: Programming languages*

1957 [6] IO-Link Community, *IO-Link Test*, V1.1.3, January 2021, Order No. 10.032

1958 [7] IO-Link Community, *IO-Link Common Profile*, V1.1, 2021, Order No. 10.072

1959

1960

1961

1962

© Copyright by:

IO-Link Community
Haid-und-Neu-Str. 7
76131 Karlsruhe
Germany

Phone: +49 (0) 721 / 98 61 97 0

Fax: +49 (0) 721 / 98 61 97 11

e-mail: info@io-link.com

<http://www.io-link.com/>



IO-Link